

## **Attachment 5**

Revised Drainage and  
Sewerage Impact Assessment

*Prepared by*

***Ramboll Hong Kong Limited***

**PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT  
RATIO AT 201 AND 203 WAI YIP STREET, KWUN TONG**

**DRAINAGE AND SEWERAGE IMPACT ASSESSMENT**

Date **March 2025**

Prepared by **Sally Chiu**  
**Assistant Environmental Consultant**

Signed



---

Approved by **Tony Cheng**  
**Environmental Consultant**

Signed



---

Project Reference **HHPWYSDCSI00**

Document No. **R9543\_v1.2.docx**

No part of this document may be reproduced or transmitted, in any form or by any means electronic, mechanical, photographic, recording or otherwise, or stored in a retrieval system of any nature without the written permission of Ramboll Hong Kong Ltd, application for which shall be made to Ramboll Hong Kong Ltd, 21/F, BEA Harbour View Centre, 56 Gloucester Road, Wan Chai, Hong Kong.

Disclaimer: This report is made on behalf of Ramboll Hong Kong Ltd. No individual is personally liable in connection with the preparation of this report. By receiving this report and acting on it, the client or any third party relying on it accepts that no individual is personally liable in contract, tort or breach of statutory duty (including negligence).

Ramboll Hong Kong Limited

21/F, BEA Harbour View Centre  
56 Gloucester Road, Wan Chai, Hong Kong

Tel: (852) 3465 2888  
Fax: (852) 3465 2899  
Email: hkinfo@ramboll.com

Q:\Projects\HHPWYSDCSI00\04 Deliverables\03 SIA Report - Hotel\v1.2\R9543\_v1.2.docx

## CHAPTERS

	Page
<b>1. INTRODUCTION .....</b>	<b>1-1</b>
1.1 Background and Objectives.....	1-1
1.2 Application Site and its Environs .....	1-1
1.3 Proposed Development.....	1-1
<b>2. SEWERAGE IMPACT ASSESSMENT.....</b>	<b>2-1</b>
2.1 Scope of Work.....	2-1
2.2 Assessment Criteria and Methodology .....	2-1
2.3 Existing and Future Sewerage System.....	2-1
2.4 Wastewater Generated by the Proposed Development.....	2-1
2.5 Assessment of Sewerage Impact .....	2-3
<b>3. OVERALL CONCLUSION.....</b>	<b>3-1</b>

## TABLES

Table 1.1 Development Schedule of the Proposed Development ..... 1-1

## FIGURES

Figure 1 Location of the Application Site and its Environs  
Figure 2.1 Existing/Proposed Sewerage System in the vicinity of the Application Site  
Figure 2.2 Existing/Proposed Sewerage System and Catchments Area in the vicinity of the Application Site

## APPENDIX

Appendix 1.1 Master Layout Plan of the Application Site  
Appendix 2.1 Detailed Sewerage Impact Assessment Calculations

## 1. INTRODUCTION

### 1.1 Background and Objectives

- 1.1.1 The Application Site is located at 201 and 203 Wai Yip Street, Kwun Tong, which falls within an area zoned "Other Specified Uses (Business)" under the Approved Kwun Tong (South) Outline Zoning Plan No. S/K14S/26.
- 1.1.2 Ramboll Hong Kong Limited is commissioned to conduct the sewerage impact assessment based on the information regarding the proposed scheme.

### 1.2 Application Site and its Environs

- 1.2.1 The Application Site is bounded by Hung To Road to the north-east, Hoi Yuen Road to the south-east, Wai Yip Street to the south-west and Tsun Yip Street to the north-west.
- 1.2.2 **Figure 1** shows the location and the environs of the Proposed Development.

### 1.3 Proposed Development

- 1.3.1 Under the current application, the Application Site is proposed for a hotel development. Details of the proposed development schedule are summarised in **Table 1.1** below and the layout plan is shown in **Appendix 1.1**.

**Table 1.1 Development Schedule of the Proposed Development**

<b>Total Site Area</b>	About 1872 m <sup>2</sup>
<b>Plot Ratio</b>	14.4
<b>Total GFA</b>	About 26,957 m <sup>2</sup> <sup>[1]</sup>
<b>No. of Blocks</b>	1
<b>Building Height</b>	120mPD
<b>No. of Storeys</b>	33 <sup>[2]</sup>

Remarks:

[1] Excluding an approvable bonus GFA of about 793m<sup>2</sup> (i.e. equivalent to a PR of about 0.424) in accordance with the Building (Planning) Regulations to be claimed from the Building Department during GBP stage that comprises of:

- 2.5m SBL from the lot boundary abutting Wai Yip Street
- 1.5m SBL along the back alley

[2] Including one level of refuge floor on 17/F but excluding one level of basement car park floor.

## 2. SEWERAGE IMPACT ASSESSMENT

### 2.1 Scope of Work

- 2.1.1 The aim of this study is to compare the sewage flow generated from the proposed development with the sewage flow generated from the existing usage, and to determine whether adverse sewage impact is anticipated.

### 2.2 Assessment Criteria and Methodology

- 2.2.1 The Commercial and Industrial Floor Space Utilization Survey (CIFSUS) conducted by the Planning Department has been used to determine the worker density for various economic activities and planned usage types.
- 2.2.2 Environmental Protection Department's (EPD's) Guidelines for Estimating Sewage Flows for Sewerage Infrastructure Planning, Version 1 (GESF) has been referred to for the purposes of estimating the quantity of the sewage generated from the Proposed Development and the existing catchment area. Sewage flow parameters and global peaking factors in this document have been adopted for this SIA.
- 2.2.3 According to the GESF, the overall unit flow is composed of flows due to employees and the associated activities. The following unit flow factors have been adopted in the SIA calculation in accordance with Tables T-1, T-2 and T-3 of the GESF:
- J10 Restaurants & Hotels: 1.58 m<sup>3</sup>/day

### 2.3 Existing and Future Sewerage System

- 2.3.1 With reference to the sewerage system shown in Geoinfo Map, the sewage generated from the proposed development will be discharged to the existing manhole FMH4043092 from the proposed terminal manhole.
- 2.3.2 The existing and proposed sewerage system are shown in **Figure 2.1**

### 2.4 Wastewater Generated by the Proposed Development

- 2.4.1 The sewage generated by the proposed development is given in **Table 2.1** shown below.

**Table 2.1 Estimated Peak Flow**

<b>Calculation for Sewage Generation Rate of the Proposed Development at the Application Site</b>		
<b>1. Hotel</b>		
Assumer Area	=	25378 m <sup>2</sup> [1]
Assumed floor area per employee	=	31.3 m <sup>2</sup> per employee – (refer to Table 8 of CIFSUS – Hotels and Boarding Houses)
Total number of employees	=	813 employees
Design flow for commercial employees	=	1.58 m <sup>3</sup> /employee/day -- (refer to Table T-2 of GESF - J10 Restaurant & Hotels)
Sewage generation rate	=	<b>1283.1</b> m <sup>3</sup> /day
<b>2. Restaurant &amp; Café</b>		
Assumer Area	=	861 m <sup>2</sup> [1]
Assumed floor area per employee	=	19.6 m <sup>2</sup> per employee – (refer to Table 8 of CIFSUS – Restaurants)
Total number of employees	=	44 employees
Design flow for commercial employees	=	1.58 Litre/employee/day – (refer to Table T-2 of GESF – Job T10 Restaurants & Hotels)
Sewage generation rate	=	<b>69.4</b> m <sup>3</sup> /day
<b>3. Shop</b>		
Assumer Area	=	107 m <sup>2</sup> [1]
Assumed floor area per employee	=	28.6 m <sup>2</sup> per employee – (refer to Table 8 of CIFSUS – Retail Trade)
Total number of employees	=	4 employees
Design flow for commercial employees	=	0.28 Litre/employee/day – (refer to Table T-2 of GESF – Job T10 Wholesale & Retail)
Sewage generation rate	=	<b>1.0</b> m <sup>3</sup> /day
<b>3. Swimming Pool</b>		
Assumed area	=	120 m <sup>2</sup>
Assumed depth of water	=	1.5 m
Volume of water	=	180.0 m <sup>3</sup>
Turnover Rate	=	4.0 hr CAP132, Section 42 Swimming Pools Regulation (covered))
Surface loading rate of filter	=	50.0 m <sup>3</sup> /m <sup>2</sup> /hr
Filter areas required	=	0.9 m <sup>2</sup>
Backwashing flow rate	=	30.0 m <sup>3</sup> /m <sup>2</sup> /hr
Design flow for backwashing	=	27.0 m <sup>3</sup> /hr
Backwash duration	=	7.0 min/day
Backwash generation rate	=	1.35 m <sup>3</sup> /day
Backwash generation rate	=	<b>7.5</b> litre/sec
<b>Total Flow from the Proposed Development</b>		
Flow rate	=	1353.6 m <sup>3</sup> /day
Flow rate with P <sub>CIF</sub>	=	1488.9 m <sup>3</sup> /day (refer to Table T-4 of GESF – East Kowloon - 1.1)
Contributing population	=	5515 people
Peaking factor	=	5 (refer to Table T-5 of GESF for a population between 5,000 – 10,000 incl. stormwater allowance)



Peak Flow (without swimming pool)	=	7444.6	m <sup>3</sup> /day
	=	86.2	litre/sec
Peak flow (with swimming pool)	=	<b>93.7</b>	litre/sec

Remark:

[1] Excluding GFA of about 1403m<sup>2</sup> from landscape garden, lounge, hotel lobby, back of house, plant room, TX. room and filtration plant room.

## 2.5 Assessment of Sewerage Impact

- 2.5.1 As shown in **Figure 2.1**, sewerage generated from the proposed development will be discharged from the terminal manhole located within the Application Site to Manhole S1 FMH4043092 which is located at the back alley of the proposed development.
- 2.5.2 Catchments in the vicinity of the Application Site are shown in **Figure 2.2**.
- 2.5.3 Detailed calculation of sewage generation, peak flow estimation and the capacity of the public sewer can be referred to **Appendix 2.1**. Based on the assessment results, the capacity of sewers FWD4048770, FWD4048771, FWD4048772, FWD4048554, FWD4048555, FWD4048556, FWD4048557 and FWD4049140 are not sufficient for the sewerage generated from the proposed development and the surrounding catchment. Therefore, sewers FWD4048770, FWD4048771 and FWD4048772 are proposed to upgrade to 375mm with total length of 21.4m while FWD4048554 will be upgraded to 1250mm with the length of 23.6m. For sewers FWD4048555, FWD4048556, FWD4048557 and FWD4049140 are proposed to upgrade to 1800mm with the total length of 164.8m.
- 2.5.4 Hence, upgrading works on the public sewers FWD4048770, FWD4048771, FWD4048772, FWD4048554, FWD4048555, FWD4048556, FWD4048557 and FWD4049140 by the project proponent are required.
- 2.5.5 Beside upgrading works on the above-mentioned pipes, a new 375mm sewer is proposed to connect manhole FMH4043095 and FMH4042874.
- 2.5.6 The proposed development is expected to be completed by the year of 2028/2029 and hence the proposed upgrading works and new pipe will be completed before 2028/2029 or prior to the commissioning of the proposed development.

### 3. DRAINAGE IMPACT ASSESSMENT


#### 3.1 Discussion

- 3.1.1 Surface runoff is mainly from rainfall and it will be directed to existing public storm drains. As the existing site is currently on hard-paved ground, it is anticipated that the proposed development will not affect the drainage path or lead to any changes in the runoff behaviour.
- 3.1.2 There is no change or abandonment of existing drains and hence no extra stormwater discharge is imposed. Therefore, adverse impact on the existing drainage system is not anticipated and a detailed drainage impact assessment is therefore unnecessary.

## 4. OVERALL CONCLUSION

- 4.1.1 The Application Site is located at 201 and 203 Wai Yip Street, which falls within an area zoned "Other Specified Uses (Business)" under the Approved Kwun Tong (South) Outline Zoning Plan No. S/K14S/26.
- 4.1.2 The Proposed development is to develop a hotel building. The development consists of a 27-storey hotel guest rooms with a swimming pool, 3-storey restaurant and café and 1-storey shop.
- 4.1.3 The estimated sewage generation rate of the Proposed Development has been quantitatively addressed. The estimated peak sewage generation from the Proposed Development is about 93.7 litre/sec.
- 4.1.4 Based on the calculations, as shown in **Appendix 2.1**, the capacity of existing sewers are not sufficient to cater for the sewage generated from the Proposed Development. Upgrading works on the public sewers FWD4048770, FWD4048771, FWD4048772, FWD4048554, FWD4048555, FWD4048556, FWD4048557 and FWD4049140 are required. Beside upgrading works on the above-mentioned pipes, a new 375mm sewer is proposed to connect manhole FMH4043095 and FMH4042874. After the proposed upgrading and new pipe works, there would not have any adverse impact on the public sewerage system.

## Figures

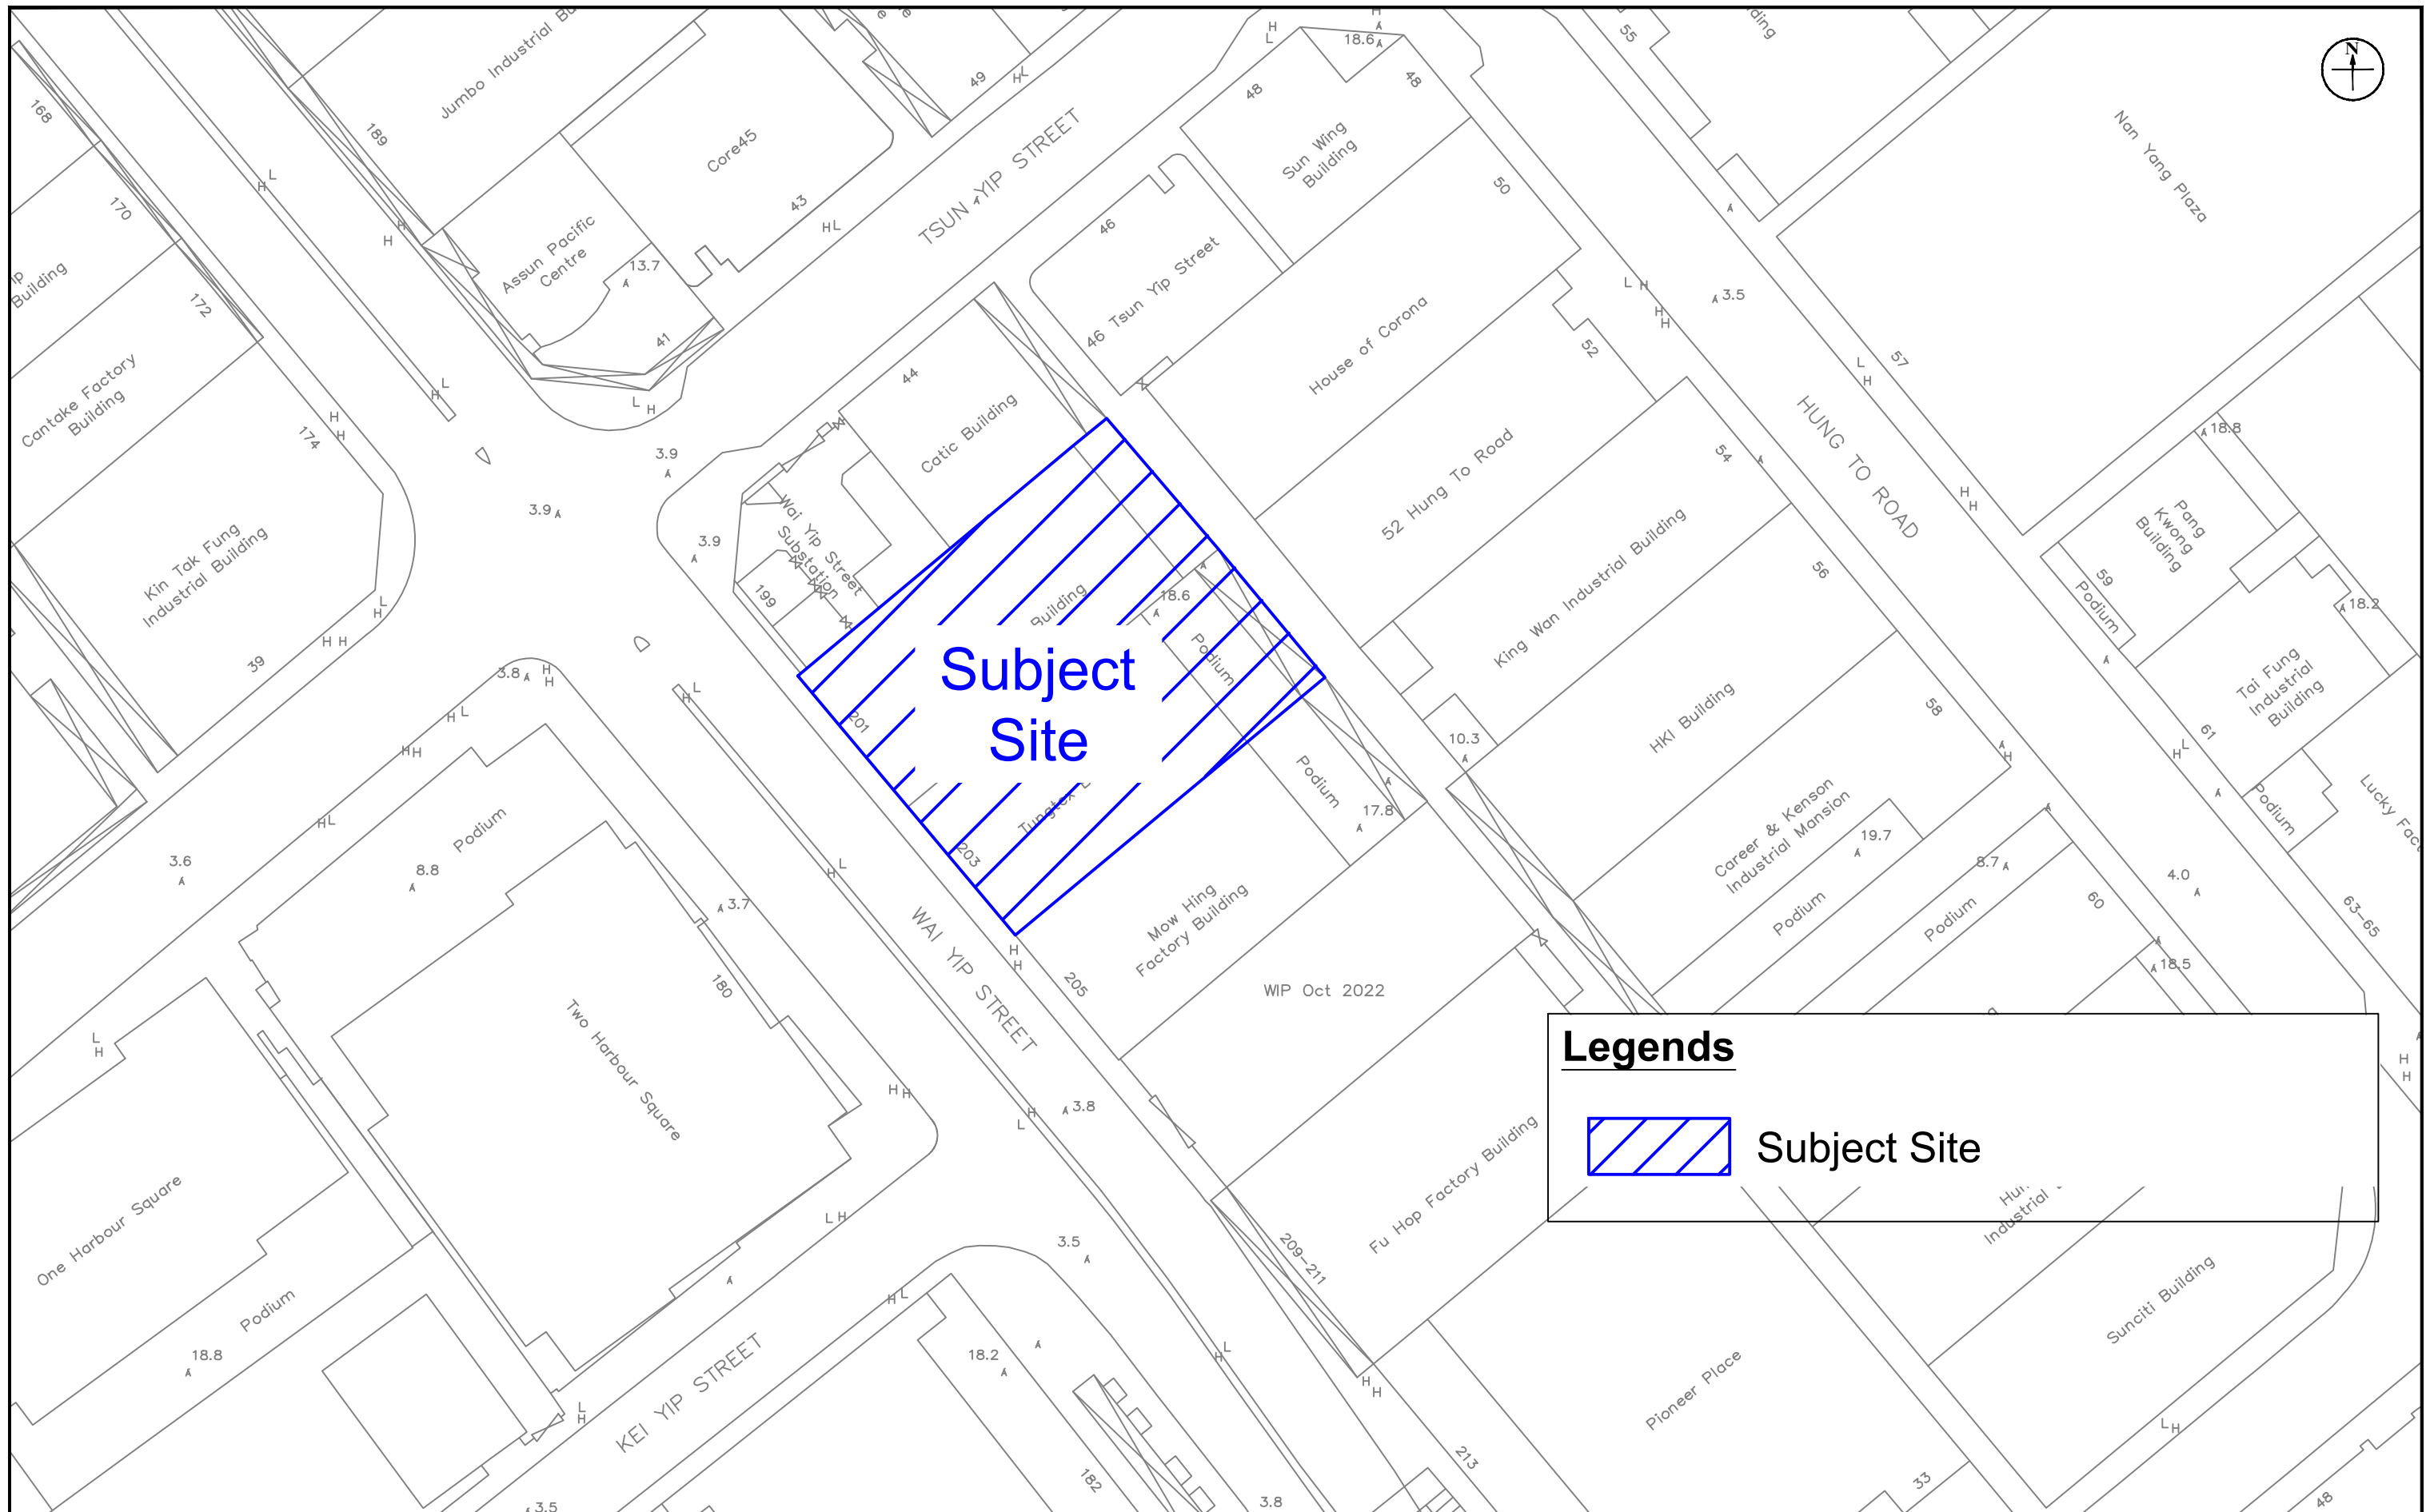


**Figure: 1**  
**Title:** Location of the Application Site  
**Project:** Proposed Re-development at 201 and 203 Wai Yip Street

**Legends**

 Subject Site

<b>RAMBOLL</b>	
Drawn by:	SC
Checked by:	TC
Rev.:	1.0
Date:	Oct 2023

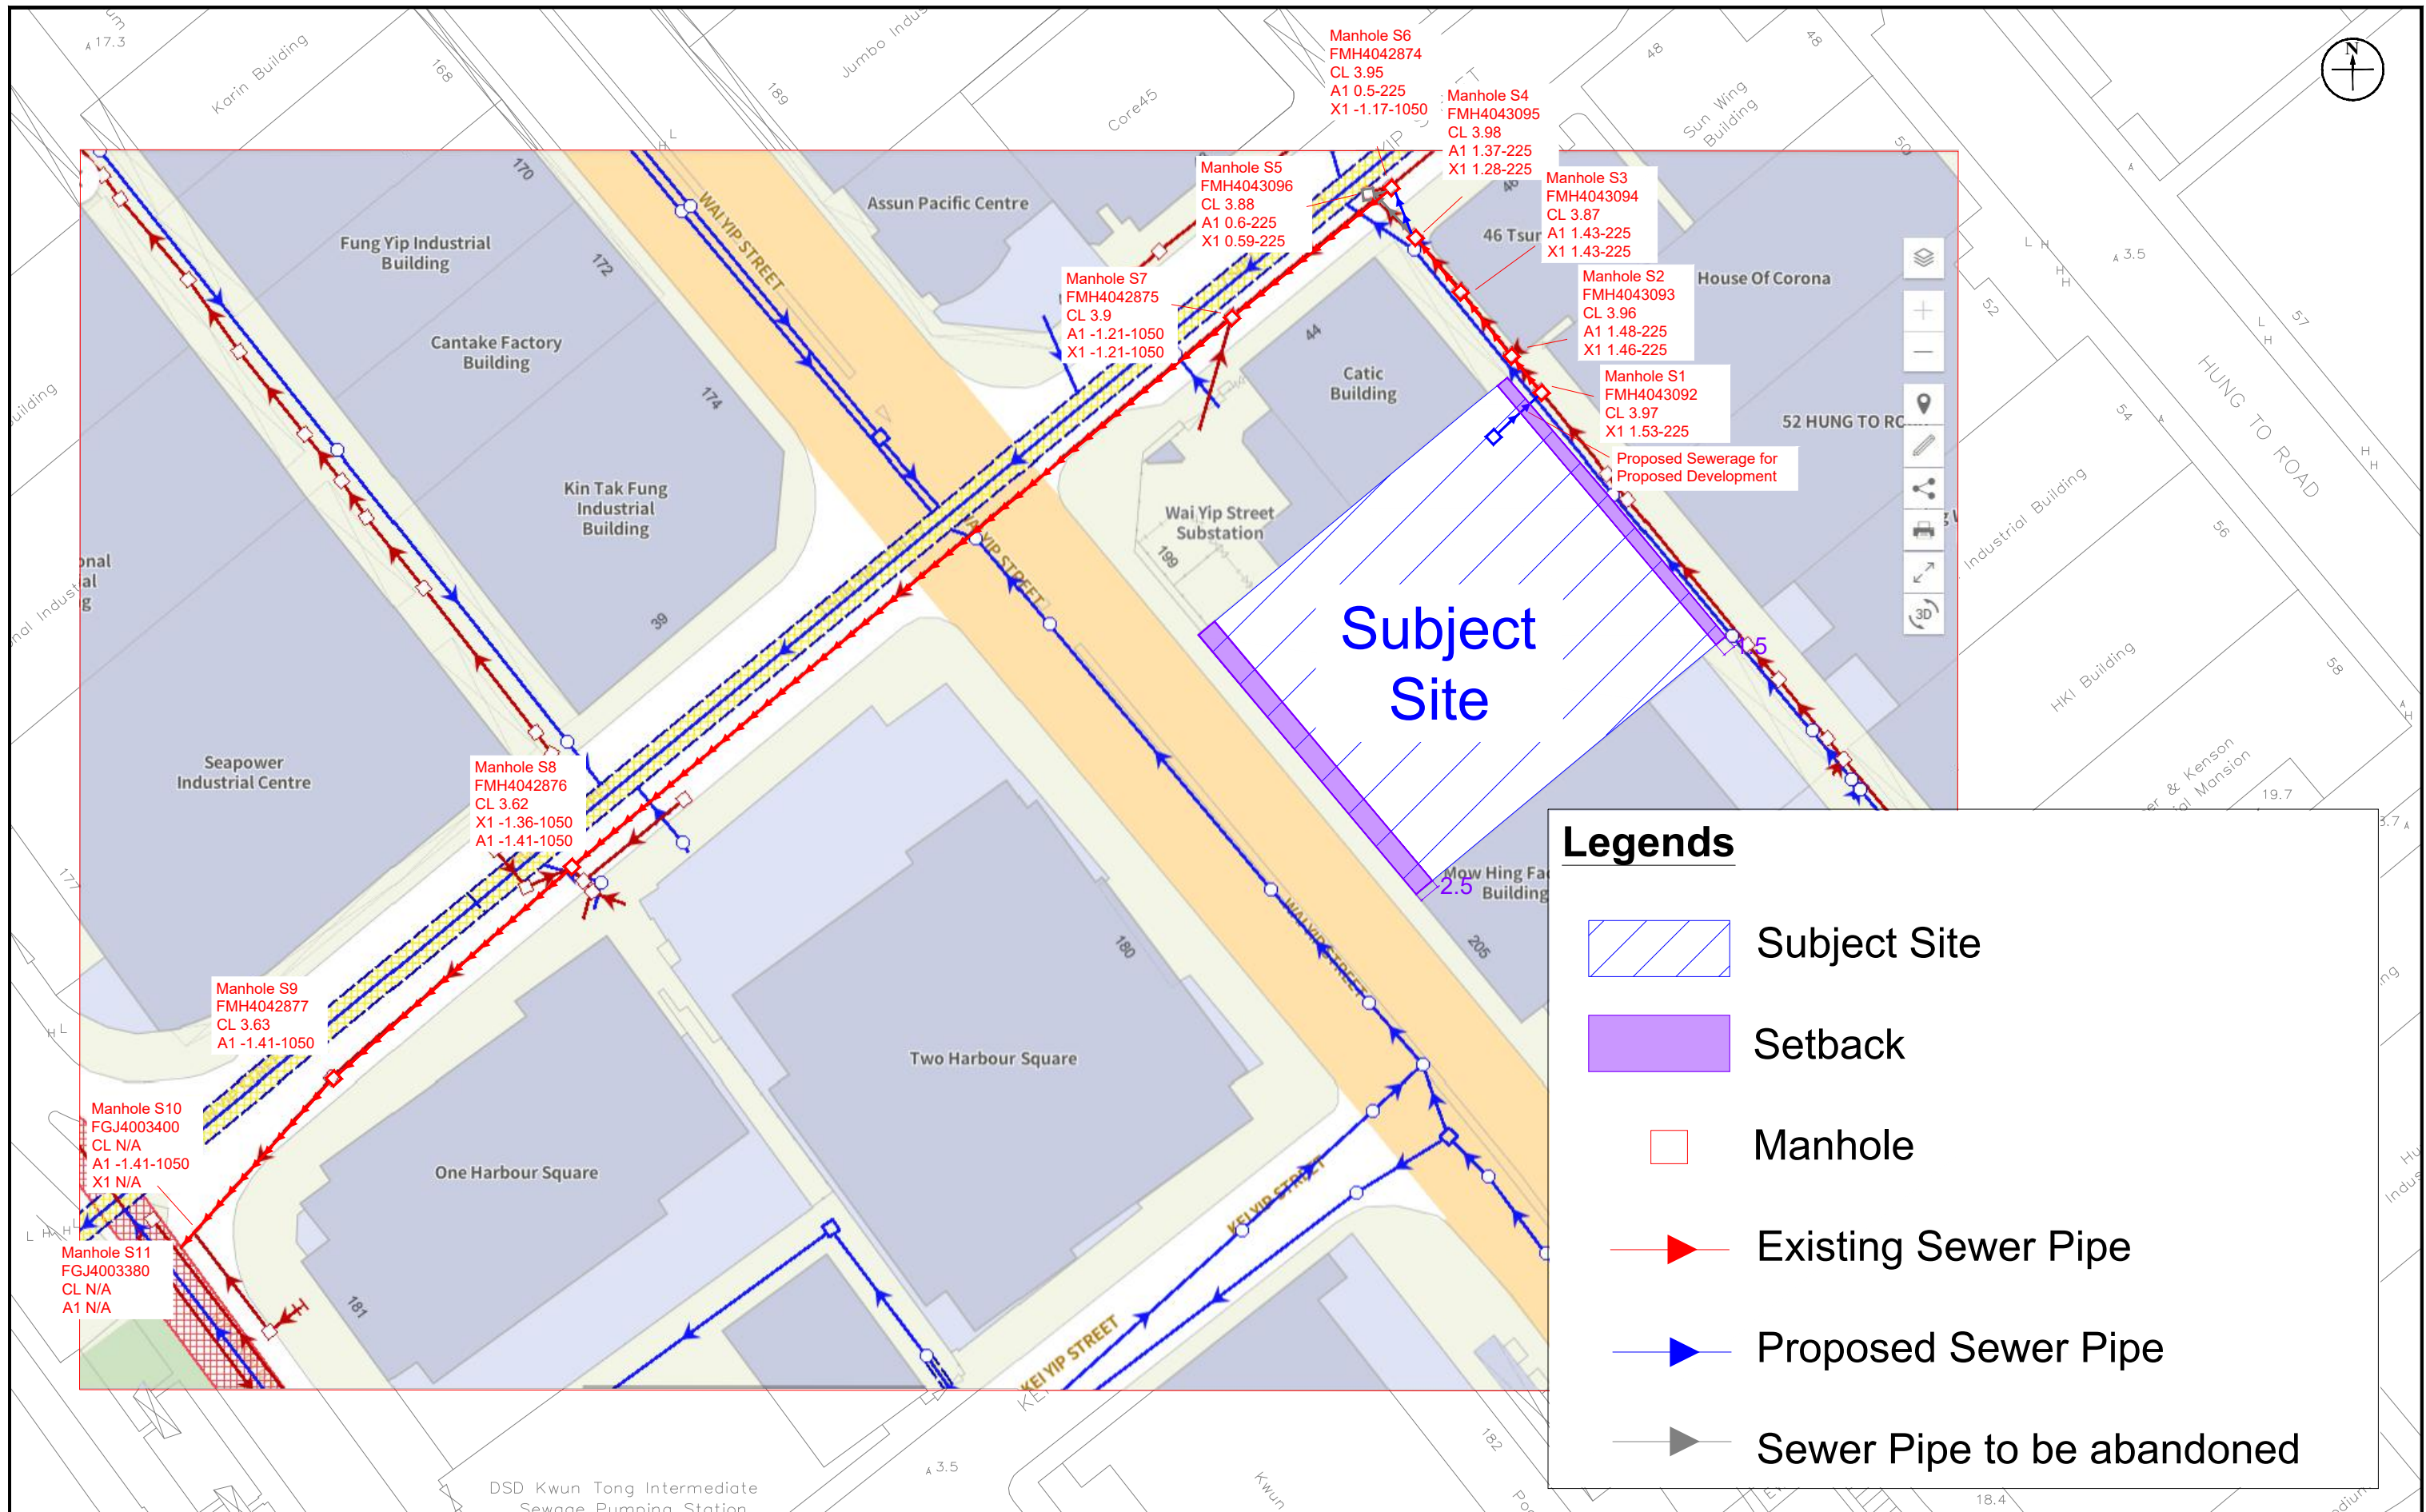

**Figure: 2.1**

**Title:** Existing and Proposed Sewerage System

**Project:** Proposed Re-development at 201 and 203 Wai Yip Street


**RAMBOLL**

Drawn by: SC

Checked by: TC

Rev.: 1.0

Date: Oct 2023

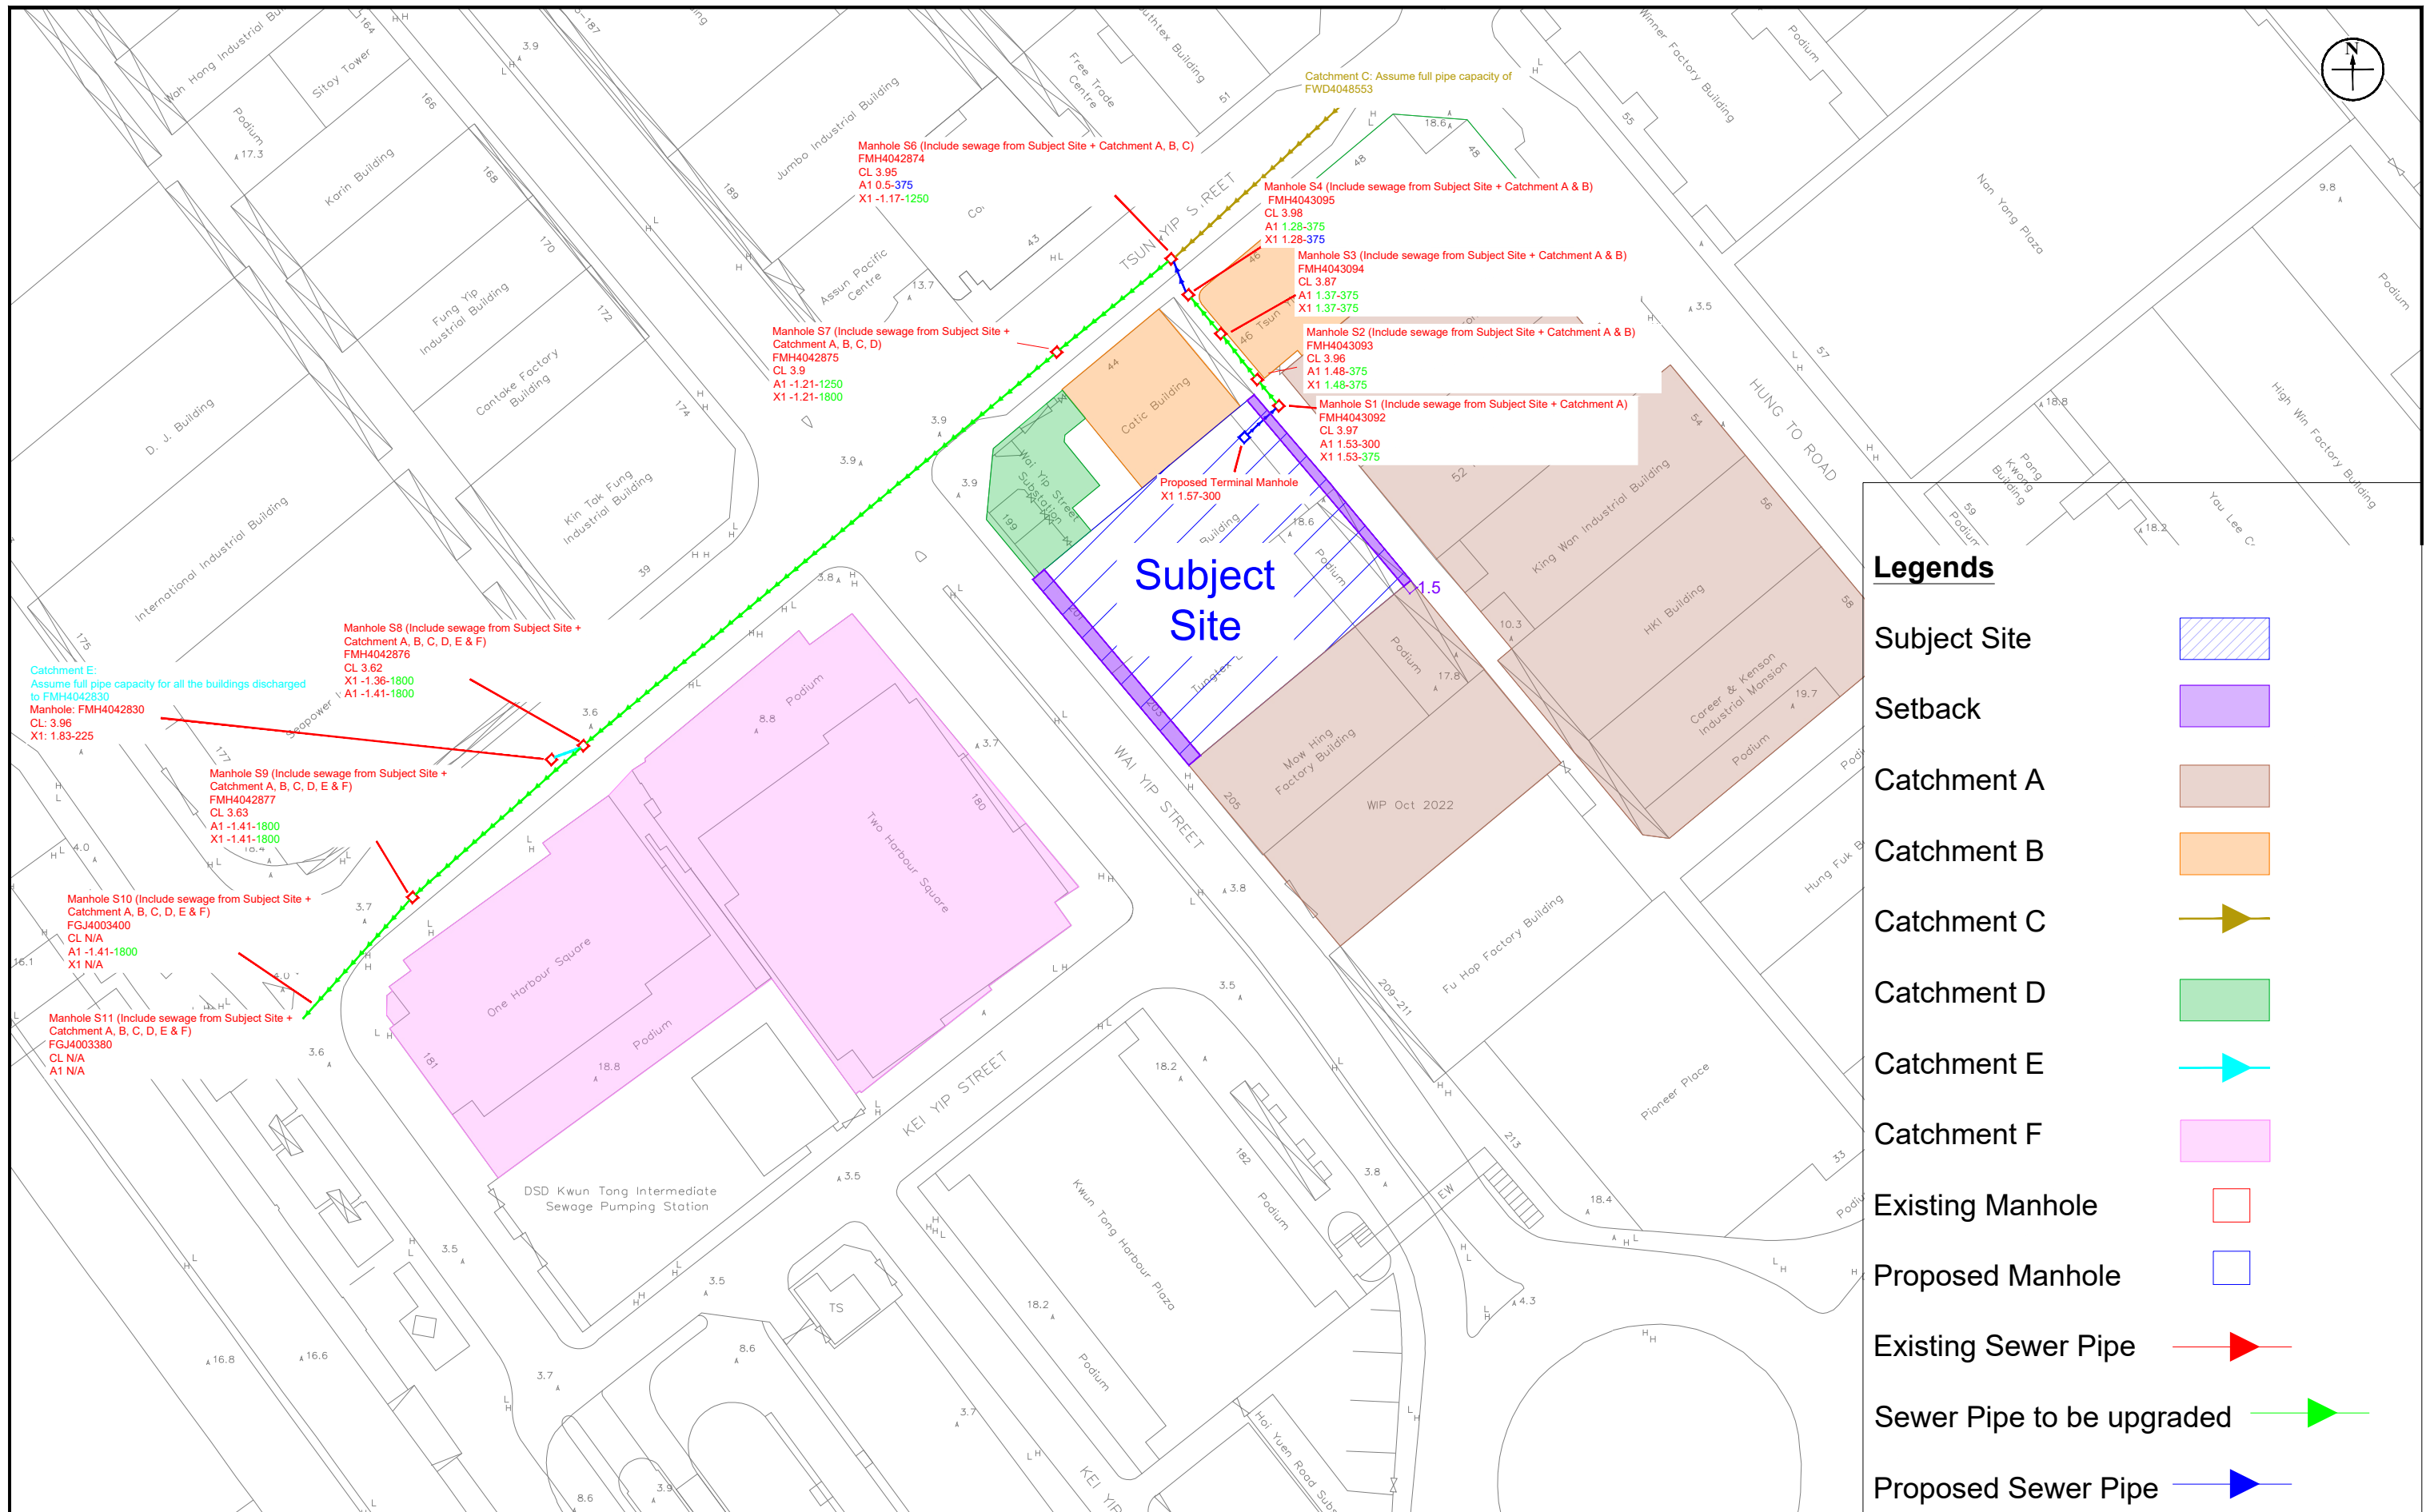


Legends	
Subject Site	
Setback	
Catchment A	
Catchment B	
Catchment C	
Catchment D	
Catchment E	
Catchment F	
Existing Manhole	
Proposed Manhole	
Existing Sewer Pipe	
Sewer Pipe to be upgraded	
Proposed Sewer Pipe	

<b>Figure:</b> 2.2	
<b>Title:</b> Existing/Proposed/ Upgrading Sewerage System and Catchments Area	
<b>Project:</b> Proposed Re-development at 201 and 203 Wai Yip Street	Drawn by: SC Checked by: TC Rev.: 1.0 Date: Oct 2023

**Appendix 1.1      Master Layout Plan of the Application Site**



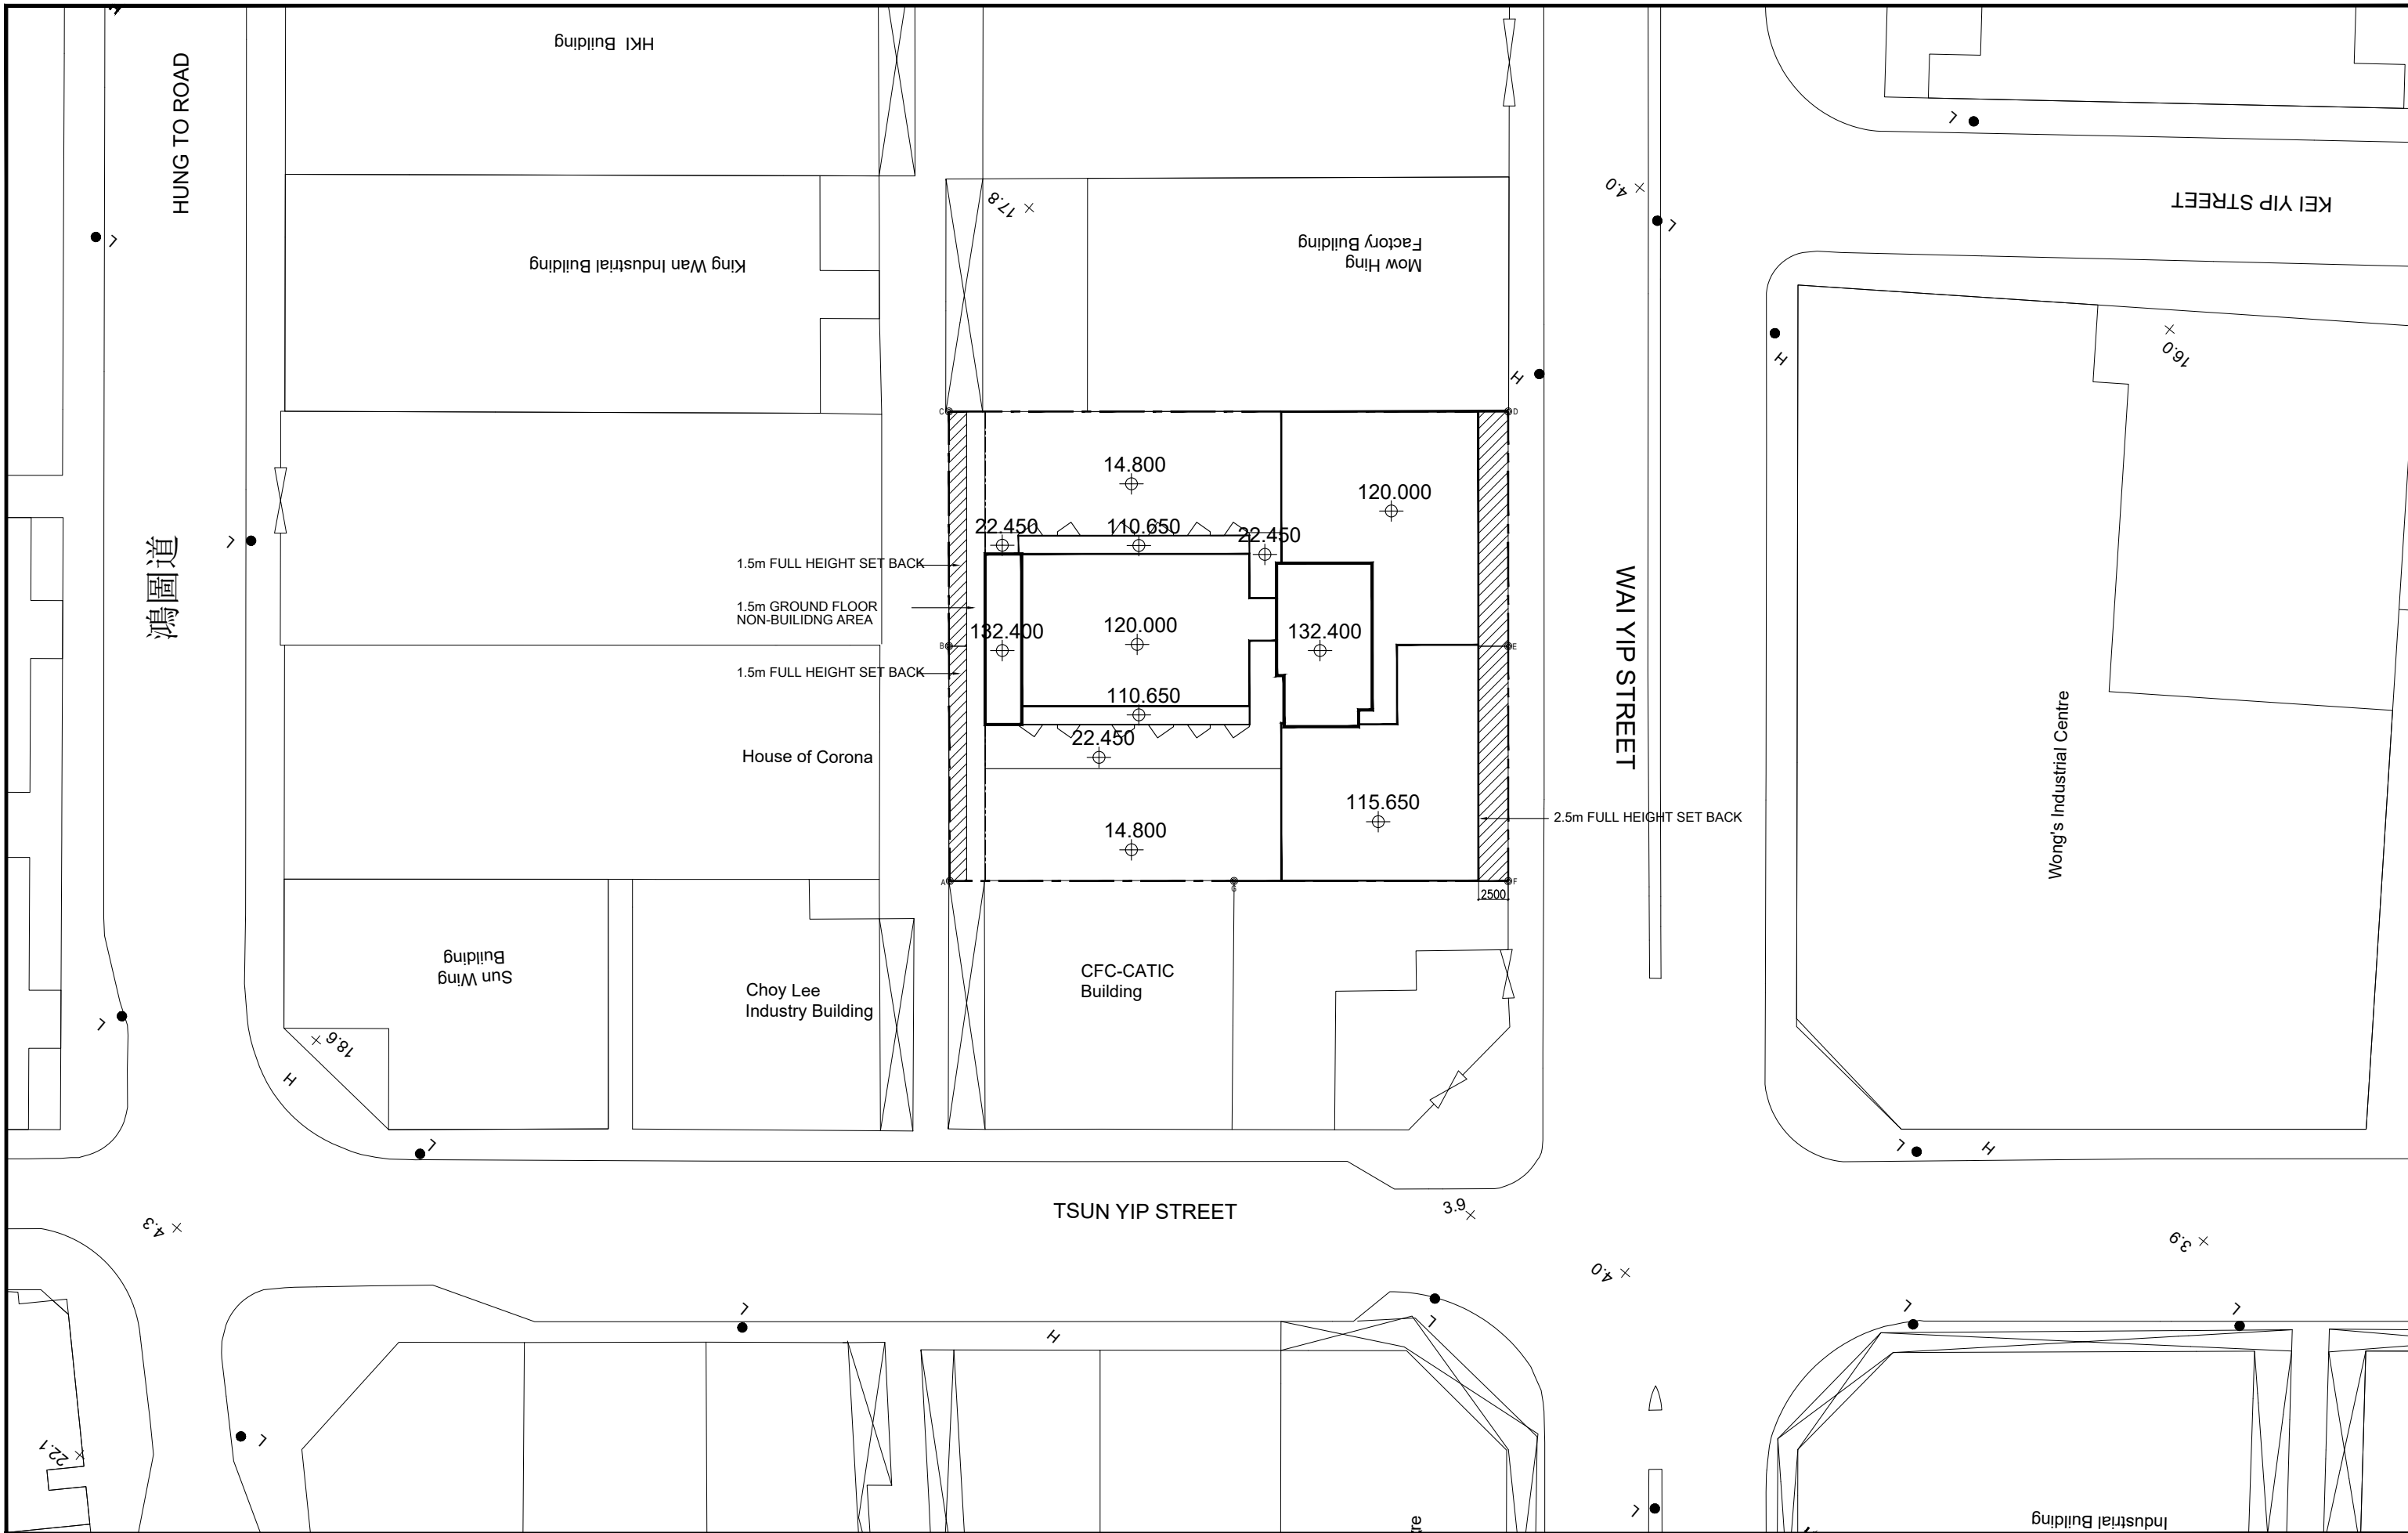

Drawing Title	Scale	Project	Job No.	
	Date			
	14/03/2025			

## PLOT RATIO & SITE COVERAGE CALCULATION

(UNDER O.Z.P.)

SITE AREA	=	1871.980 S.M. (20150.000 S.F.)
CLASS OF SITE	=	'A'
HEIGHT RESTRICTION	=	120.000 mPD
MEAN LEVEL	=	4.000 M.
HEIGHT OF NEW BUILDING		
120.000 mPD - 4.000 mPD(MEAN LEVEL)	=	116.000 M
PERMITTED NON-DOMESTIC SITE COVERAGE (BELOW 15M)	=	100.000%
ACTUAL NON-DOMESTIC SITE COVERAGE (BELOW 15M)	=	1639.440 S.M. (87.577%)
PERMITTED NON-DOMESTIC SITE COVERAGE (OVER 61M)	=	60.000%
PERMITTED NON-DOMESTIC PLOT RATIO = 12 x (1 + 20%)	=	14.4
ROAD WIDENING AREA (SURRENDERED):	=	99.067 S.M.
SET BACK AREA (SURRENDERED):	=	59.444 S.M.
<b>TOTAL</b>	=	<b>158.511 S.M.</b>
BONUS: ROAD WIDENING x 1500 / SITE AREA x HEIGHT OF BUILDING		
$\frac{158.511 \text{ S.M.} \times 1500}{1871.980 \text{ S.M.} \times 116.000 \text{ M}}$	=	1.095 %
TOTAL PERMITTED NON-DOMESTIC SITE COVERAGE	=	61.095%
TOTAL PERMITTED NON-DOMESTIC SITE COVERAGE AREA		
$1871.980 \text{ S.M.} \times 61.095 \%$	=	1143.686 S.M.
ACTUAL NON-DOMESTIC SITE COVERAGE AREA (OVER 61M)	=	1142.646 S.M. < 1143.686 S.M.
		(61.039 %) (61.095 %)
PERMITTED NON-DOMESTIC G.F.A.		
$1871.980 \text{ S.M.} \times 14.4$	=	26956.512 S.M.
BONUS:		
$99.067 \text{ S.M.} \times 5$	=	495.335 S.M.
WAI YIP STREET - ROAD WIDENING (SURRENDERED)	=	297.220 S.M.
$59.444 \text{ S.M.} \times 5$	=	297.220 S.M.
BACK ALLEY - SET BACK AREA (SURRENDERED)		
<b>TOTAL</b>	=	<b>27749.067 S.M.</b>

ACTUAL GROSS FLOOR AREA FOR NON-DOMESTIC (AFTER BONUS):

GROUND FLOOR	=	499.489 S.M.
1ST FLOOR	=	589.722 S.M.
2ND FLOOR	=	638.421 S.M.
3/F - 4/F	948.885 X 2	= 1897.770 S.M.
5/F - 6/F	950.924 X 2	= 1901.848 S.M.
7/F - 11/F	943.348 X 5	= 4716.740 S.M.
12/F - 16/F, 18/F - 28/F	935.772 X 16	= 14972.352 S.M.
29/F - 30/F	944.479 X 2	= 1888.958 S.M.
31/F	=	461.692 S.M.
32/F	=	661.618 S.M.
<b>TOTAL</b>	=	<b>28228.610 S.M.</b>


DEDUCT		
EXEMPTED G.F.A. OF LIFT SHAFT	=	479.604 S.M.

**TOTAL = 27749.006 S.M. < 27749.067S.M.**

## NO. OF CARPARK CALCULATION

(ACCORDING TO H.K.P.S.G.)

NO. OF GUEST ROOM		
3/F - 4/F	31 x 2 STOREYS	= 62 NOS.
5/F - 16/F, 18/F - 28/F	16 x 23 STOREYS	= 368 NOS.
29/F - 30/F	9 x 2 STOREYS	= 18 NOS.
<b>TOTAL</b>		<b>= 448 NOS.</b>
CAR PARK NOS REQUIRED		
MOTOR VEHICLES (2.5 x 5.0 x 2.4H)		
HOTEL ROOMS :	448 / 100	= 5 NOS.
ANCILLARY FACILITIES :	589.722 + 638.421 / 200	= 7 NOS.
	(1/F) (3/F)	
<b>TOTAL</b>		<b>= 12 NOS.</b>
GOODS VEHICLES (LOADING & UNLOADING BAY)		
448 HOTEL ROOMS	(3.5 x 11.0 x 4.7H)	= 1 NOS.
	(3.5 x 7.0 x 3.6H)	= 3 NOS.
LAY-BYS FOR TAXI		
300 - 599 HOTEL ROOMS		= 3 NOS.
LAY-BYS FOR COACH / TOUR BUS		
300 - 899 HOTEL ROOMS	(3.5 x 12.0 x 3.8H)	= 3 NOS.

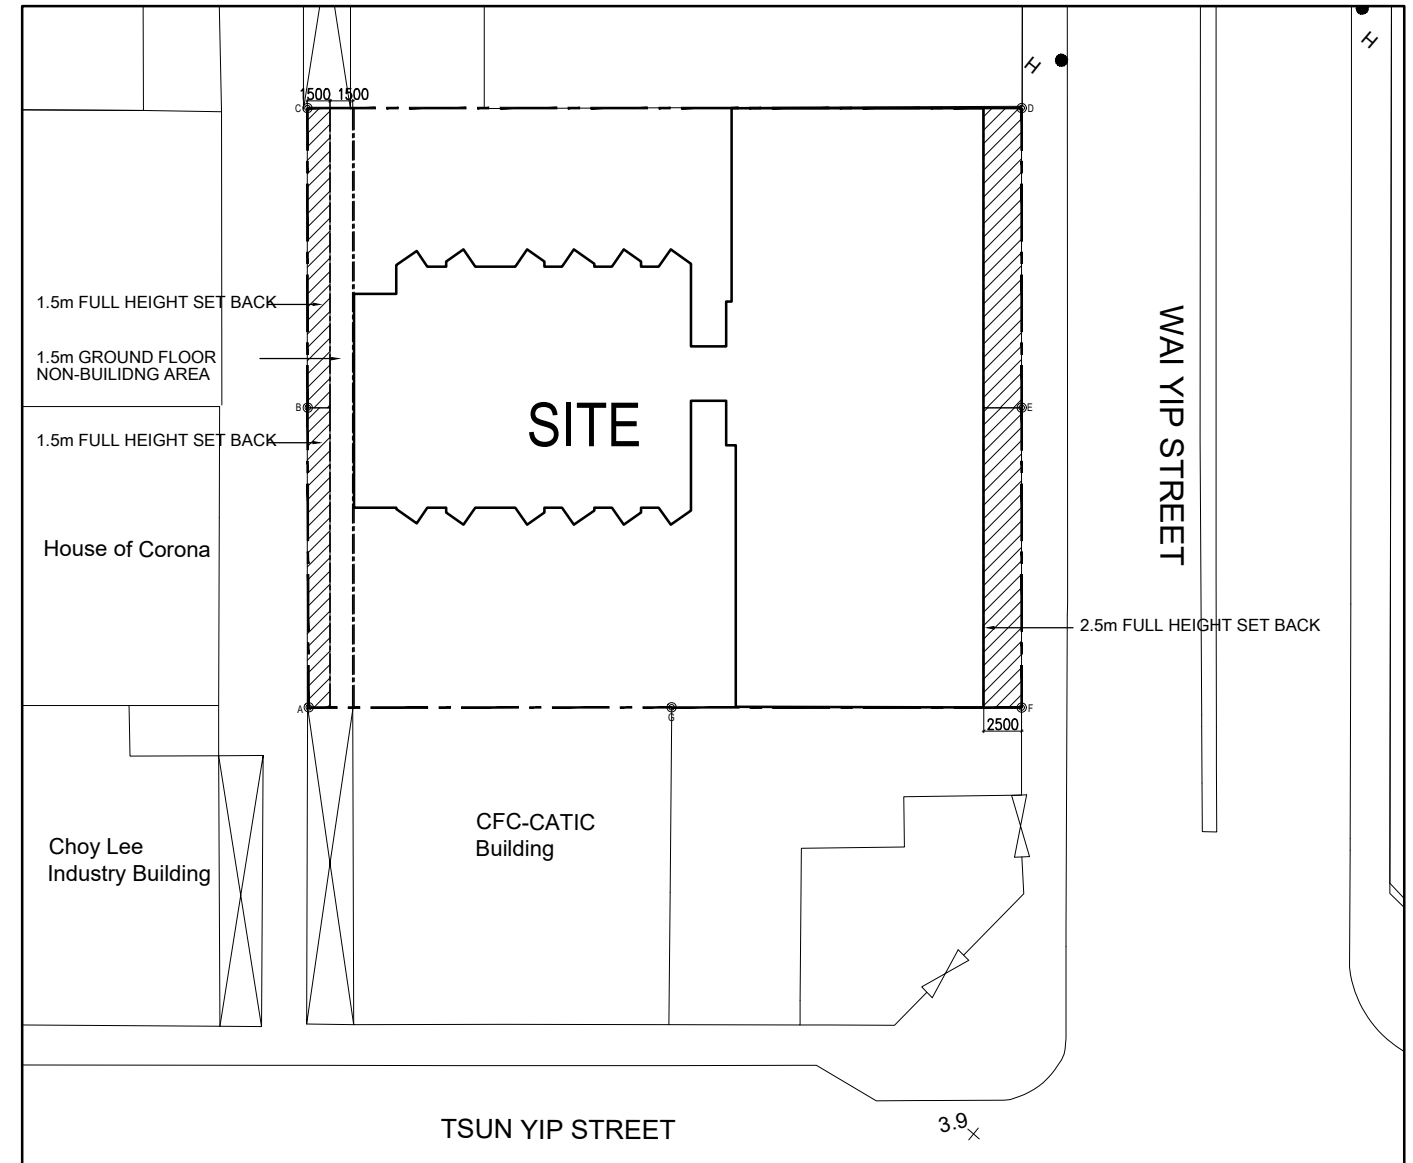

## BLOCK PLAN

## LIFT SHAFT AREA EXEMPTED IN G.F.A. CALCULATION :

G.F.A. OF NON-DOMESTIC	=	28228.610 S.M.
TOTAL G.F.A. OF LIFT SHAFT		
39.618 x 32 STOREYS	=	1467.744 S.M.
EXEMPTED G.F.A. OF LIFT SHAFT		
$(1467.744 / 28228.610) \times 100\% - 3.5\%$	=	1.699 %
$28228.610 \times 1.699\%$	=	479.604 S.M.

## TOTAL AREA OF BACK OF HOUSE

TOTAL NON-DOMESTIC G.F.A.	=	27749.006 S.M.
$27749.067 \times 5\%$	=	1387.450 S.M.
BACK OF HOUSE PROVIDED		
GROUND FLOOR	=	117.781 S.M.
1ST FLOOR	=	955.222 S.M.
3/F - 30/F	11.340 x 27	= 306.180 S.M.
<b>TOTAL</b>	=	<b>1379.183 S.M. &lt; 1387.450 S.M.</b>

## GREENERY AREA REQ. (PLANTER AREA)

SITE AREA = 1871.980 S.M. (1000 S.M. - 20000 S.M.)

SITE COVERAGE OF GREENERY REQ. :  
PRIMARY ZONE 10% & OVERALL 20%

GREENERY AREA REQ. (PLANTER AREA) PRO. (OVERALL)

(P1) PLANTER AREA (2/F)	=	274.305 S.M.
(P2) VERTICAL GREEN (1/F - 2/F)	=	94.163 S.M.
(P3) PLANTER AREA (R/F)	=	175.705 S.M.
<b>TOTAL</b>	=	<b>544.173 S.M.</b>

TOTAL SITE COVERAGE OF GREENERY

SITE COVERAGE OF GREENERY		
=	$\frac{\text{TOTAL GREENERY AREA}}{\text{SITE AREA}} \times 100\%$	
=	$\frac{544.173}{1871.980} \times 100\% = 29.033\% > 20\%$	(REQUIRED) i.e. OK

Drawing Title

CALCULATION

Scale

1:500

Date

14/03/2025


Project

SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET, KWUN TONG, KOWLOON


Job No.

A-2302


**ALKF+**  
ANDREW LEE KING FUN &  
ASSOCIATES ARCHITECTS LTD

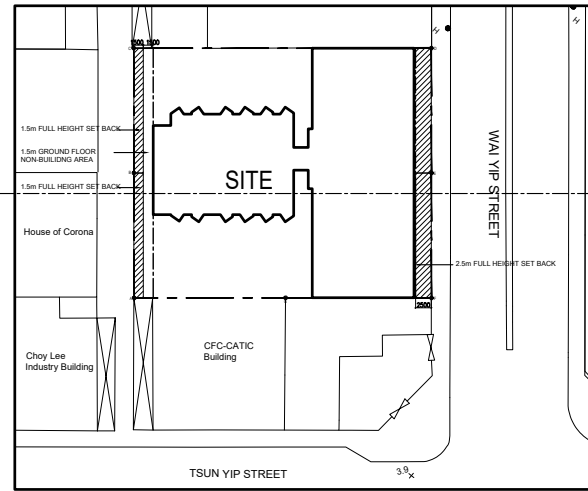

KEY PLAN

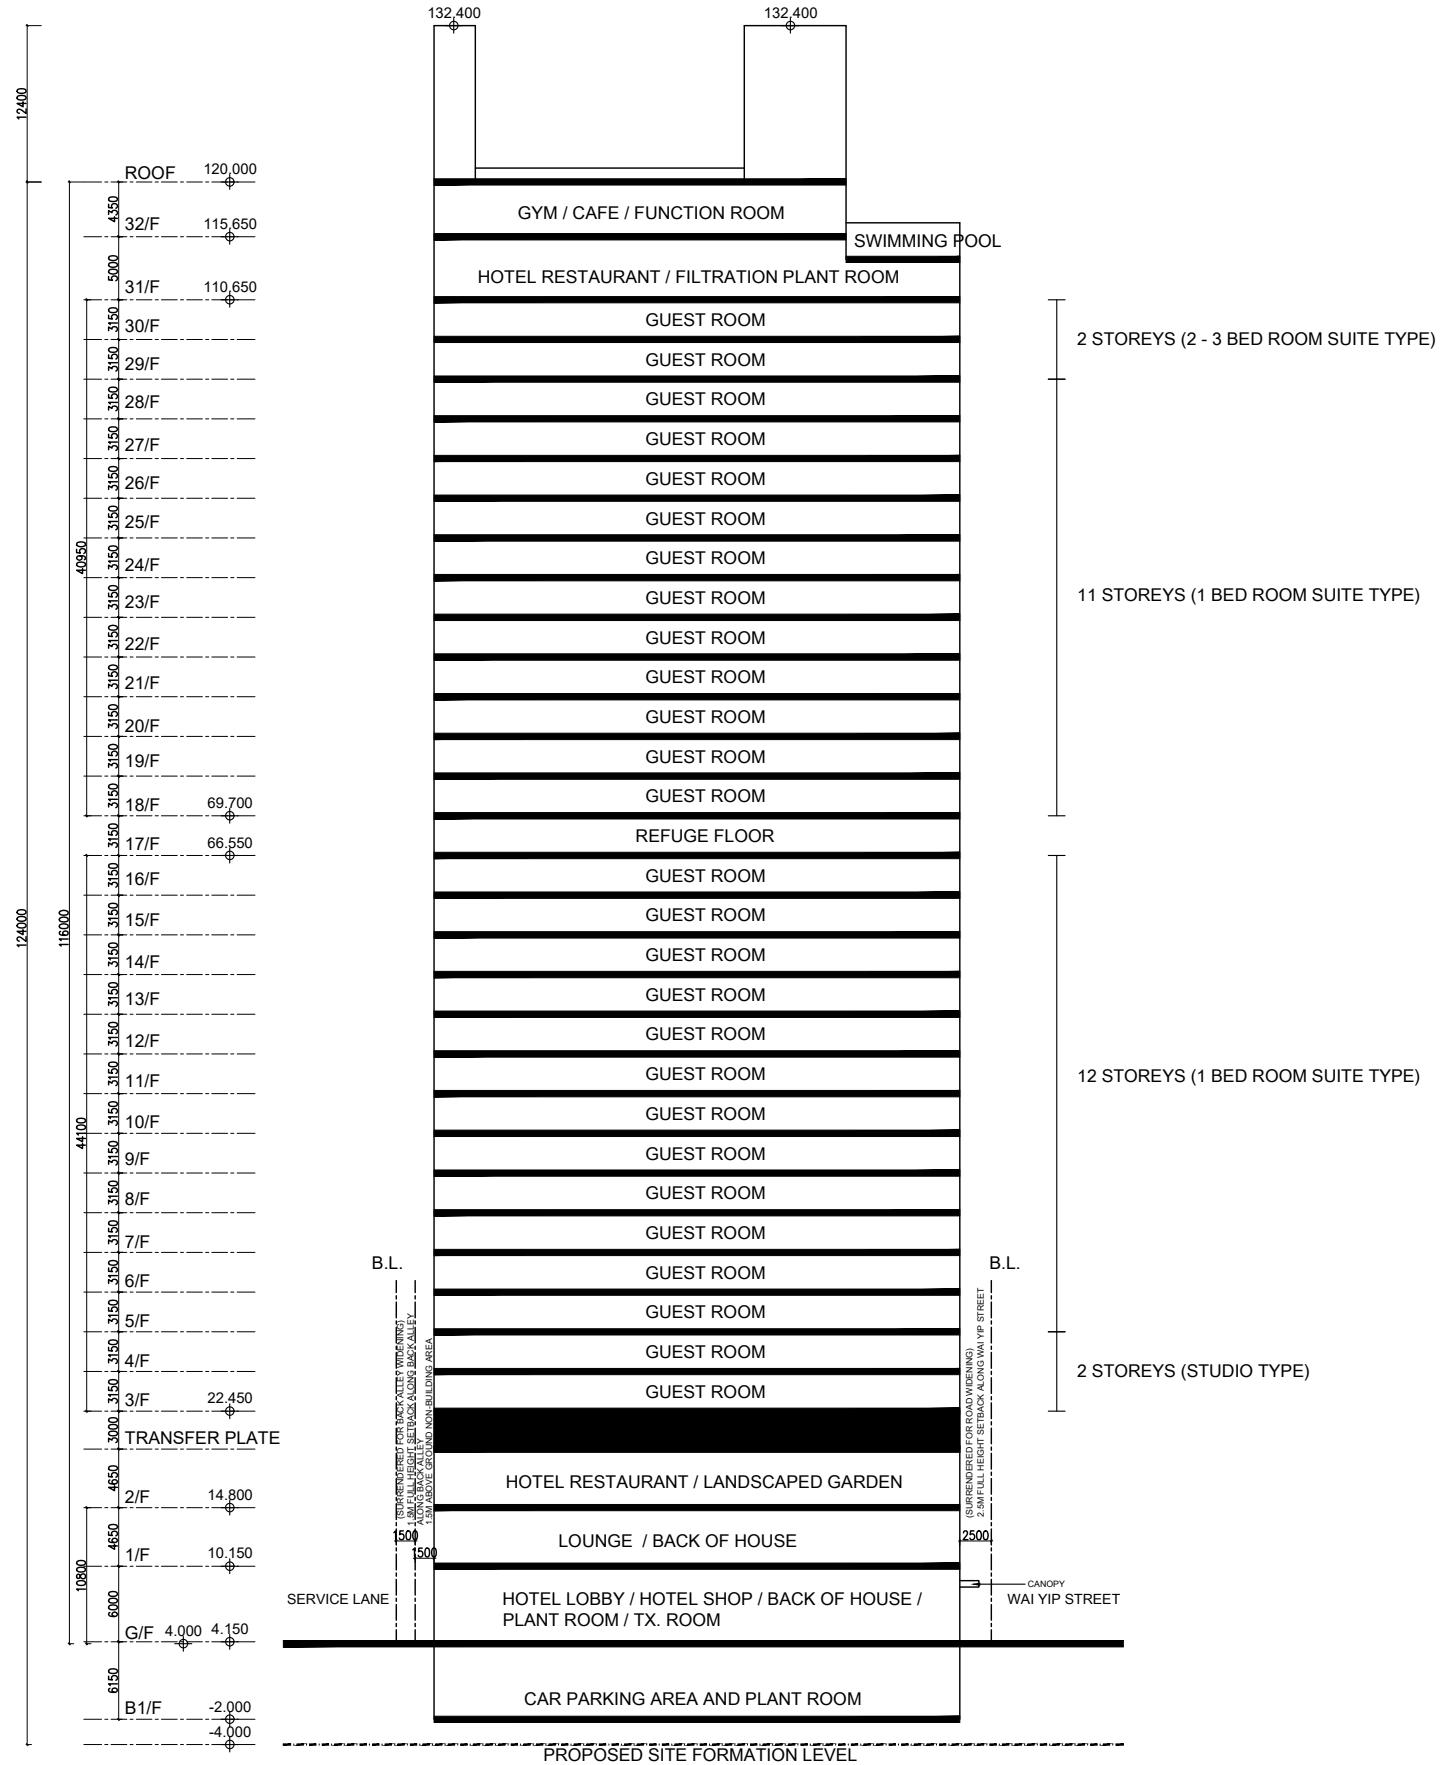

Drawing Title	SECTION		Scale	1:600	Project	SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET, KWUN TONG, KOWLOON	Job No.	A-2302	
	Date	14/03/2025							

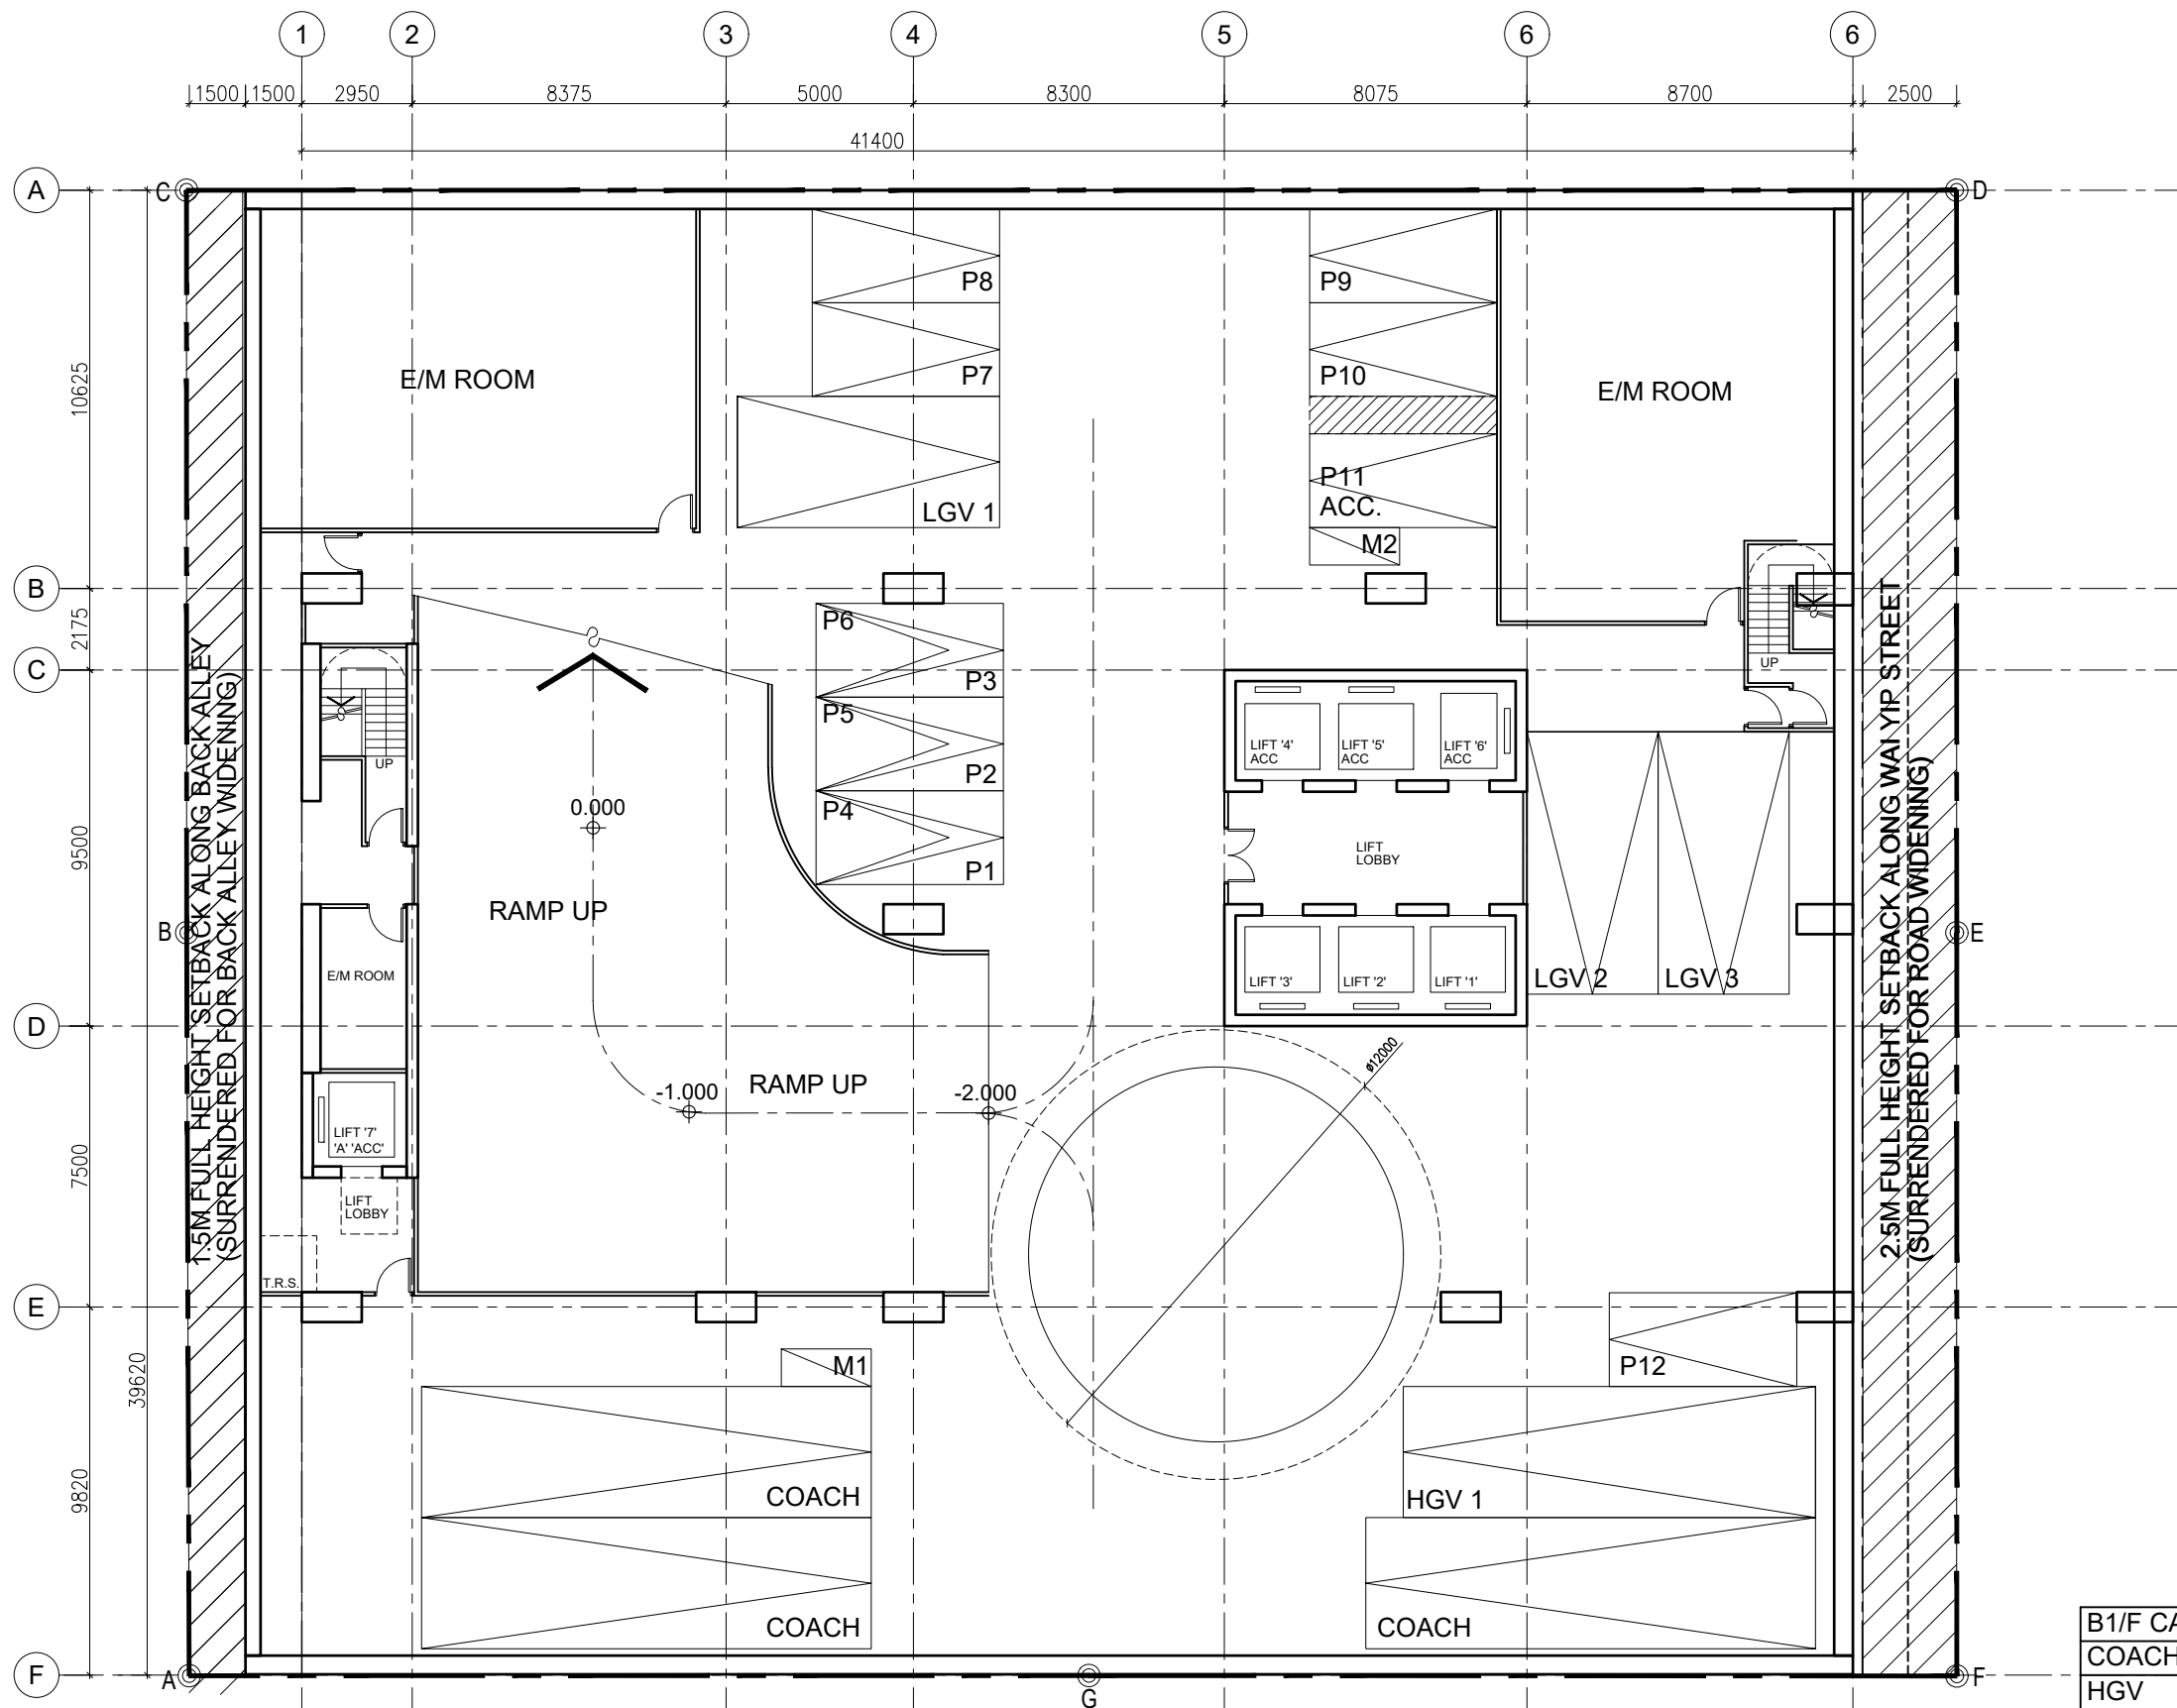

----- SITE BOUNDARY



B1/F CARPARK SPACE	
COACH	3
HGV	1
LGV	3
PRIVATE CAR	12
MOTOR CYCLE	2



Drawing Title  
**BASEMENT FLOOR PLAN**

Scale  
**1:200**  
Date  
**14/03/2025**

Project  
SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL  
WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING  
HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET,  
KWUN TONG, KOWLOON

Job No.  
**A-2302**



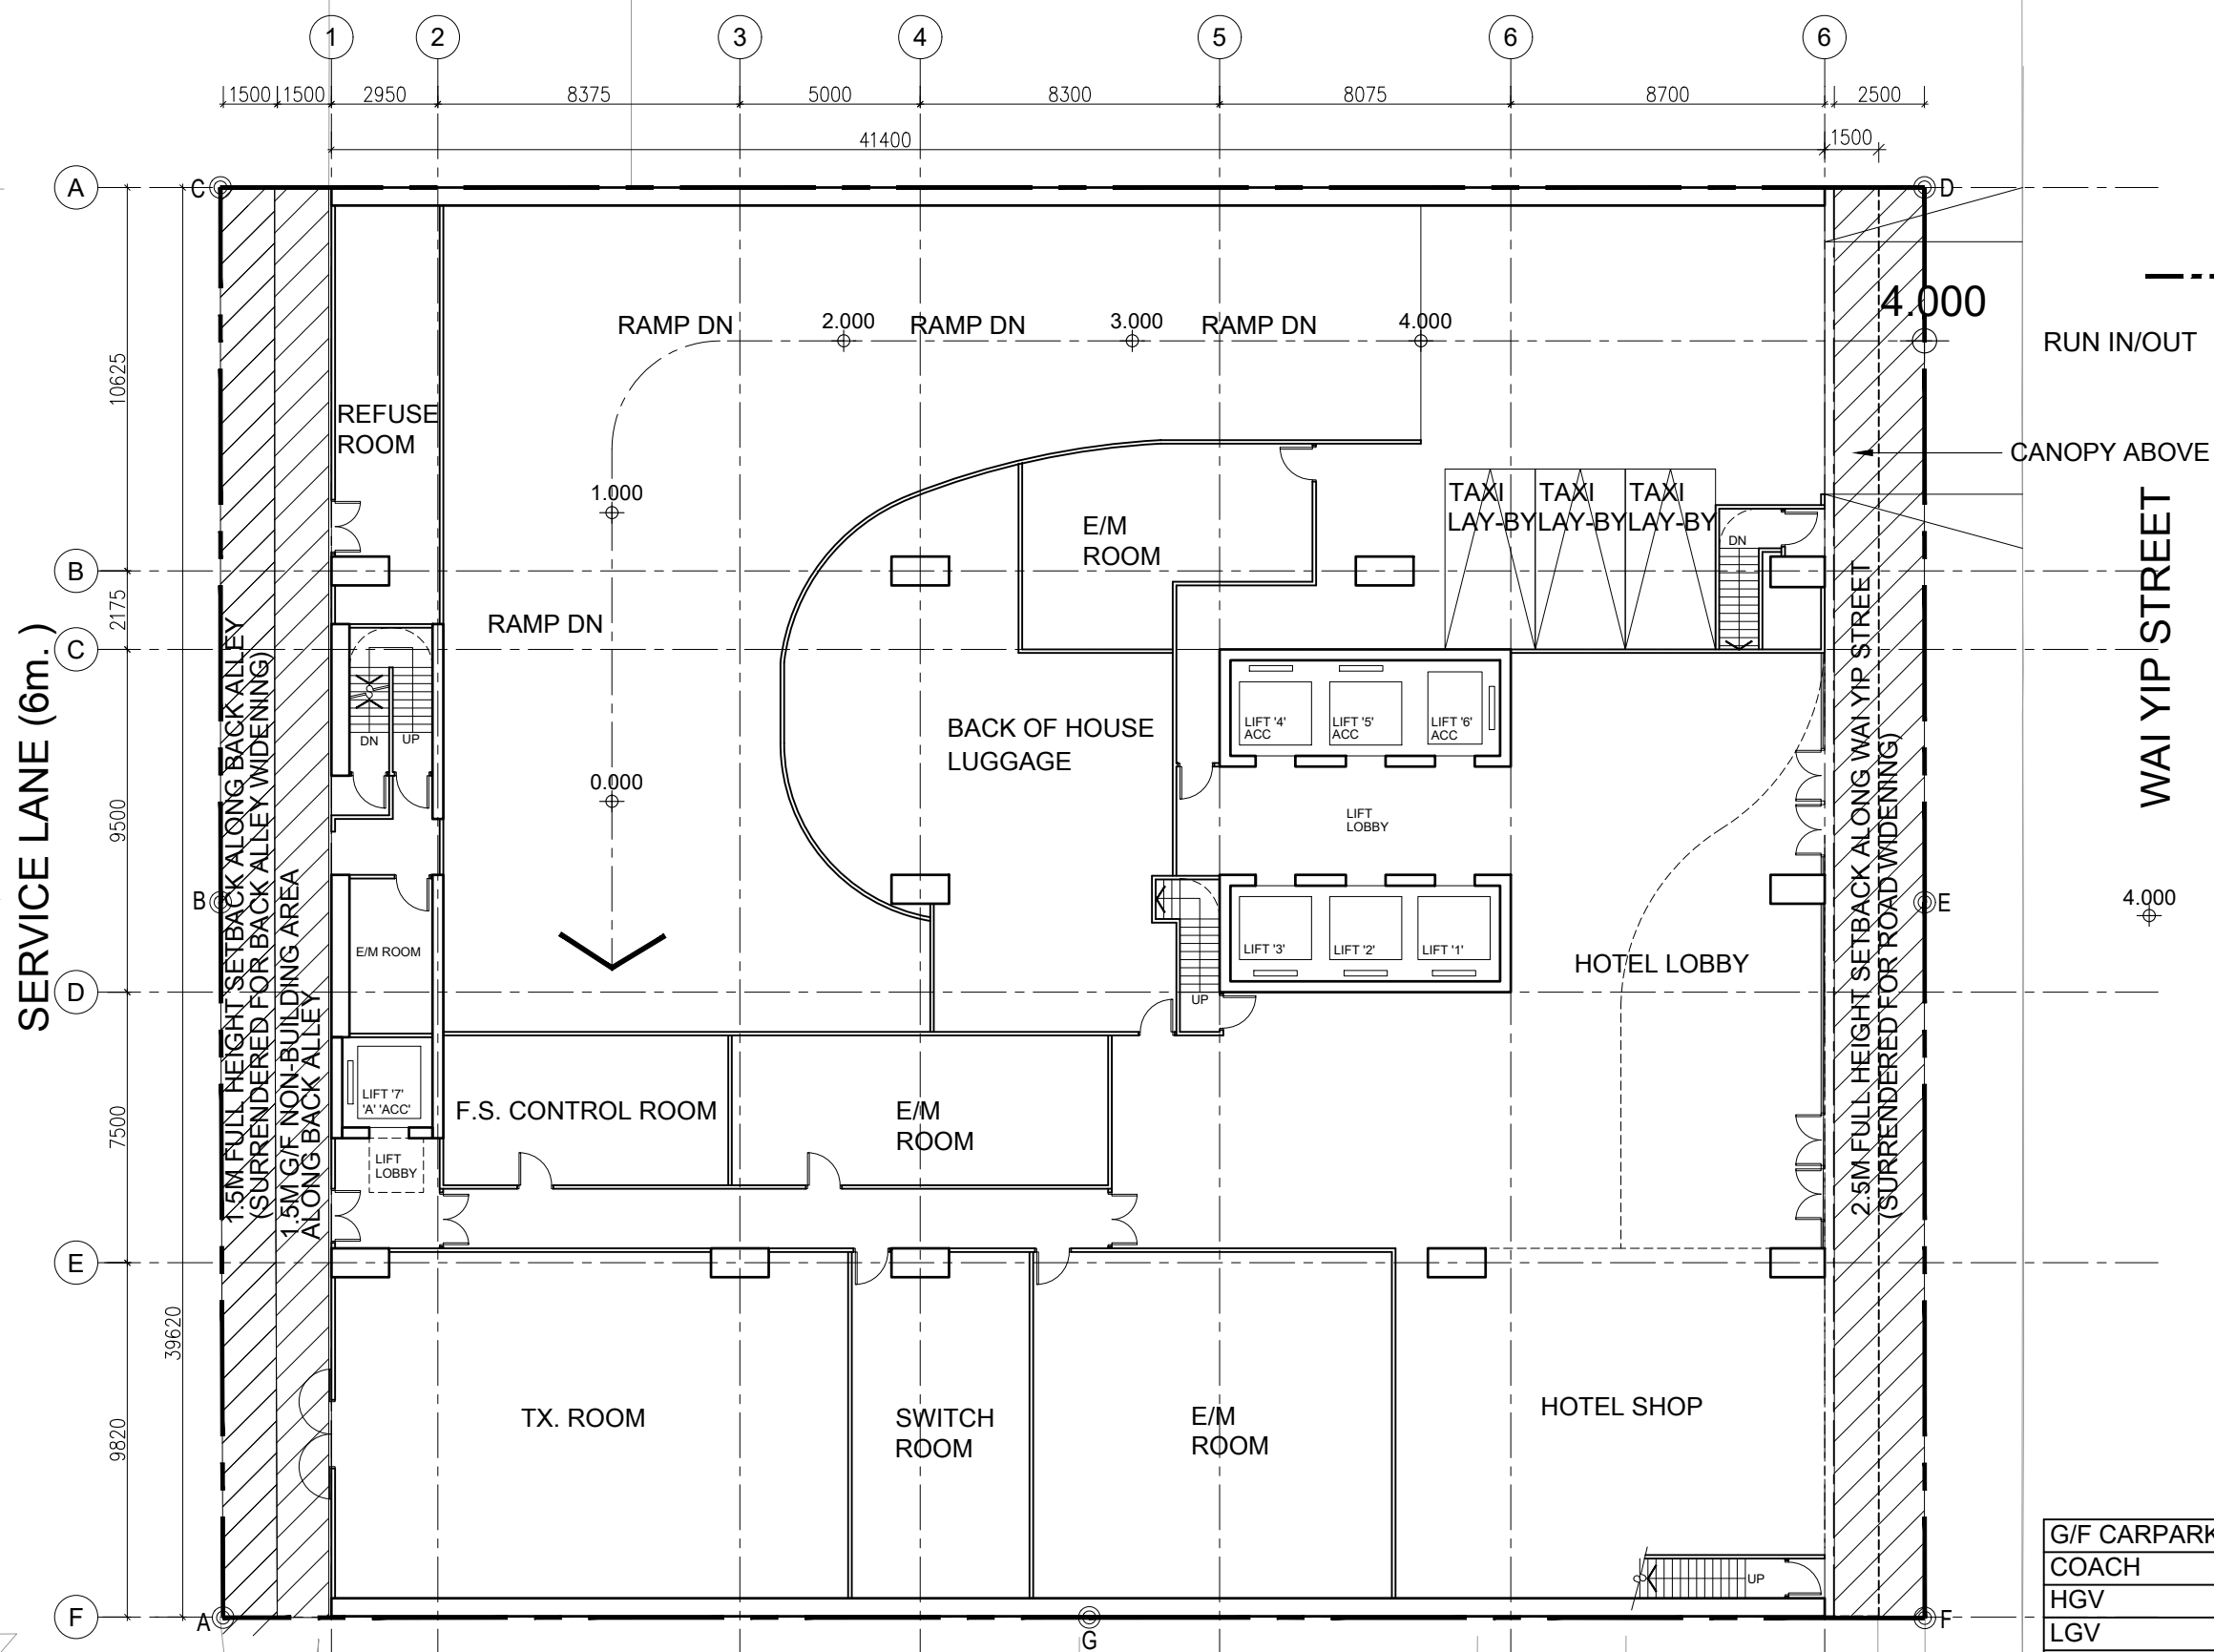

----- SITE BOUNDARY


--- RUN IN/OUT

--- CANOPY ABOVE

WAI YIP STREET



4.000


SERVICE LANE (6m.)





G/F CARPARK SPACE	
COACH	0
HGV	0
LGV	0
PRIVATE CAR	0
MOTOR CYCLE	0
TAXI LAY-BY	3

Drawing Title  <h2 style="text-align: center;">GROUND FLOOR PLAN</h2>	Scale <b>1:200</b>	Project SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET, KWUN TONG, KOWLOON	Job No. <b>A-2302</b>	 <small>ANDREW LEE KING FUN &amp; ASSOCIATES ARCHITECTS LTD</small>
	Date <b>14/03/2025</b>			

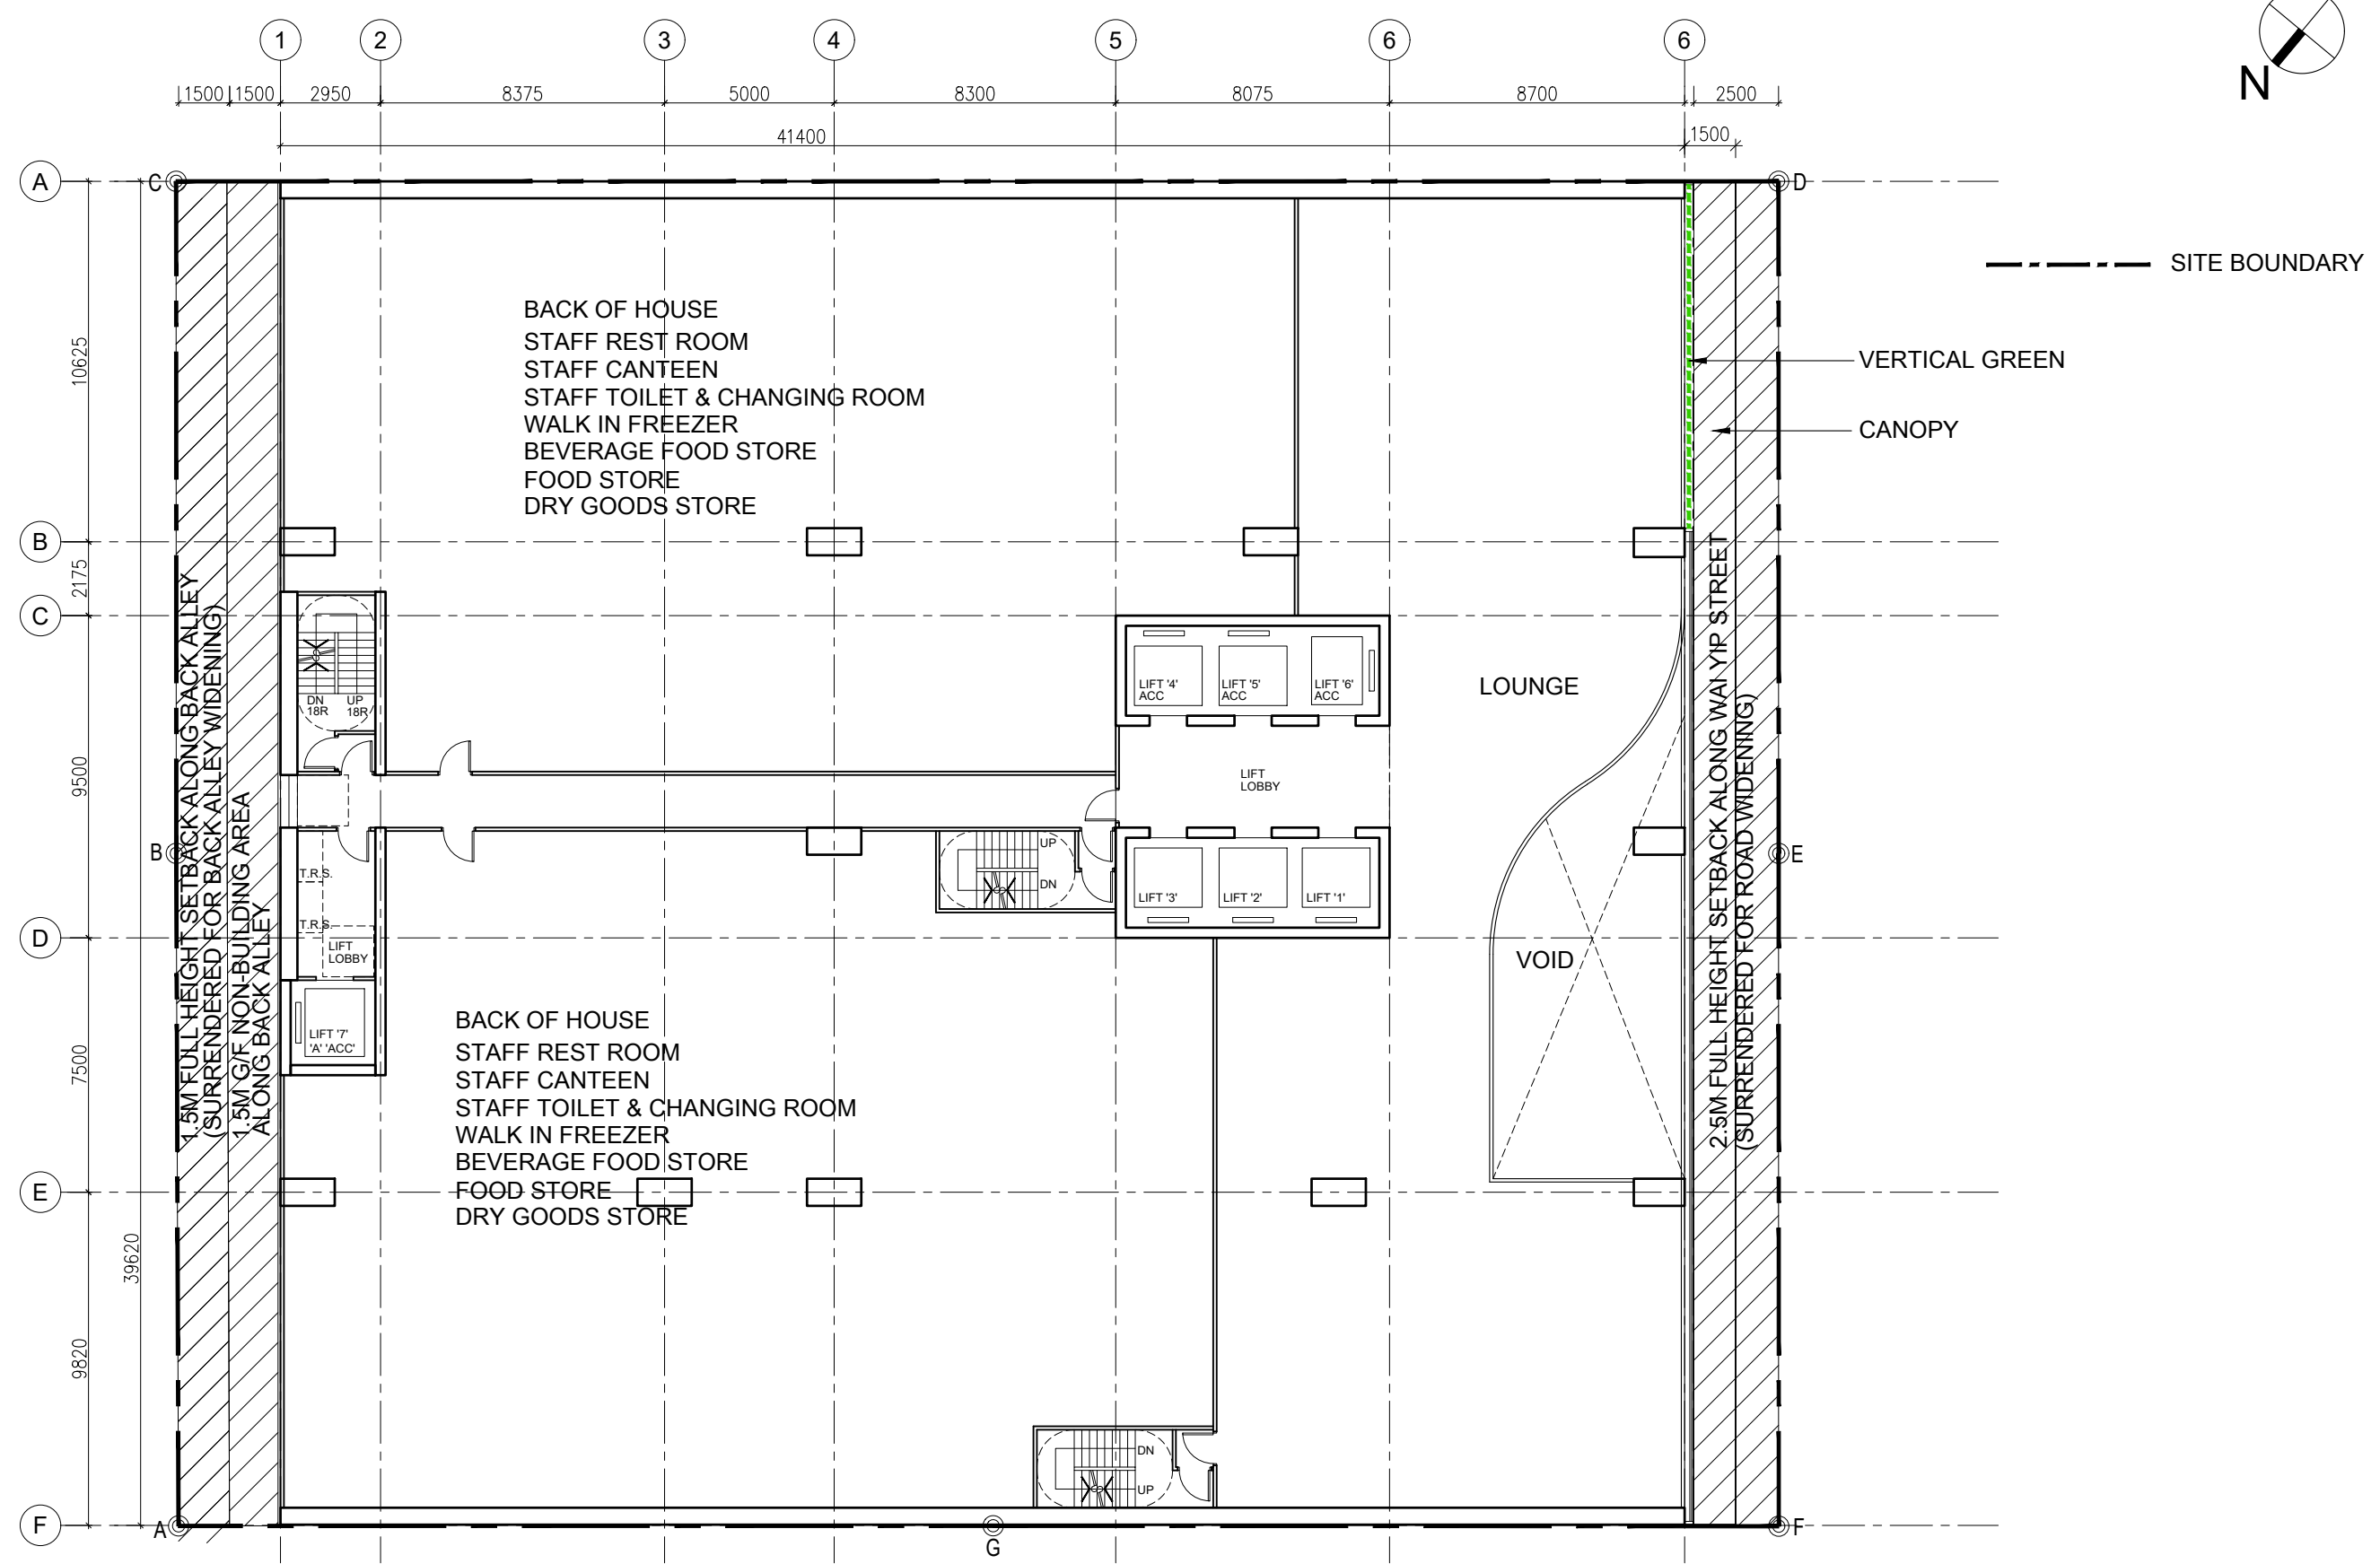

Drawing Title  <b>1/F PLAN</b>	Scale <b>1:200</b>	Project SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET, KWUN TONG, KOWLOON	Job No.  A-2302	 <b>ANDREW LEE KING FUN &amp; ASSOCIATES ARCHITECTS LTD</b>
	Date <b>14/03/2025</b>			

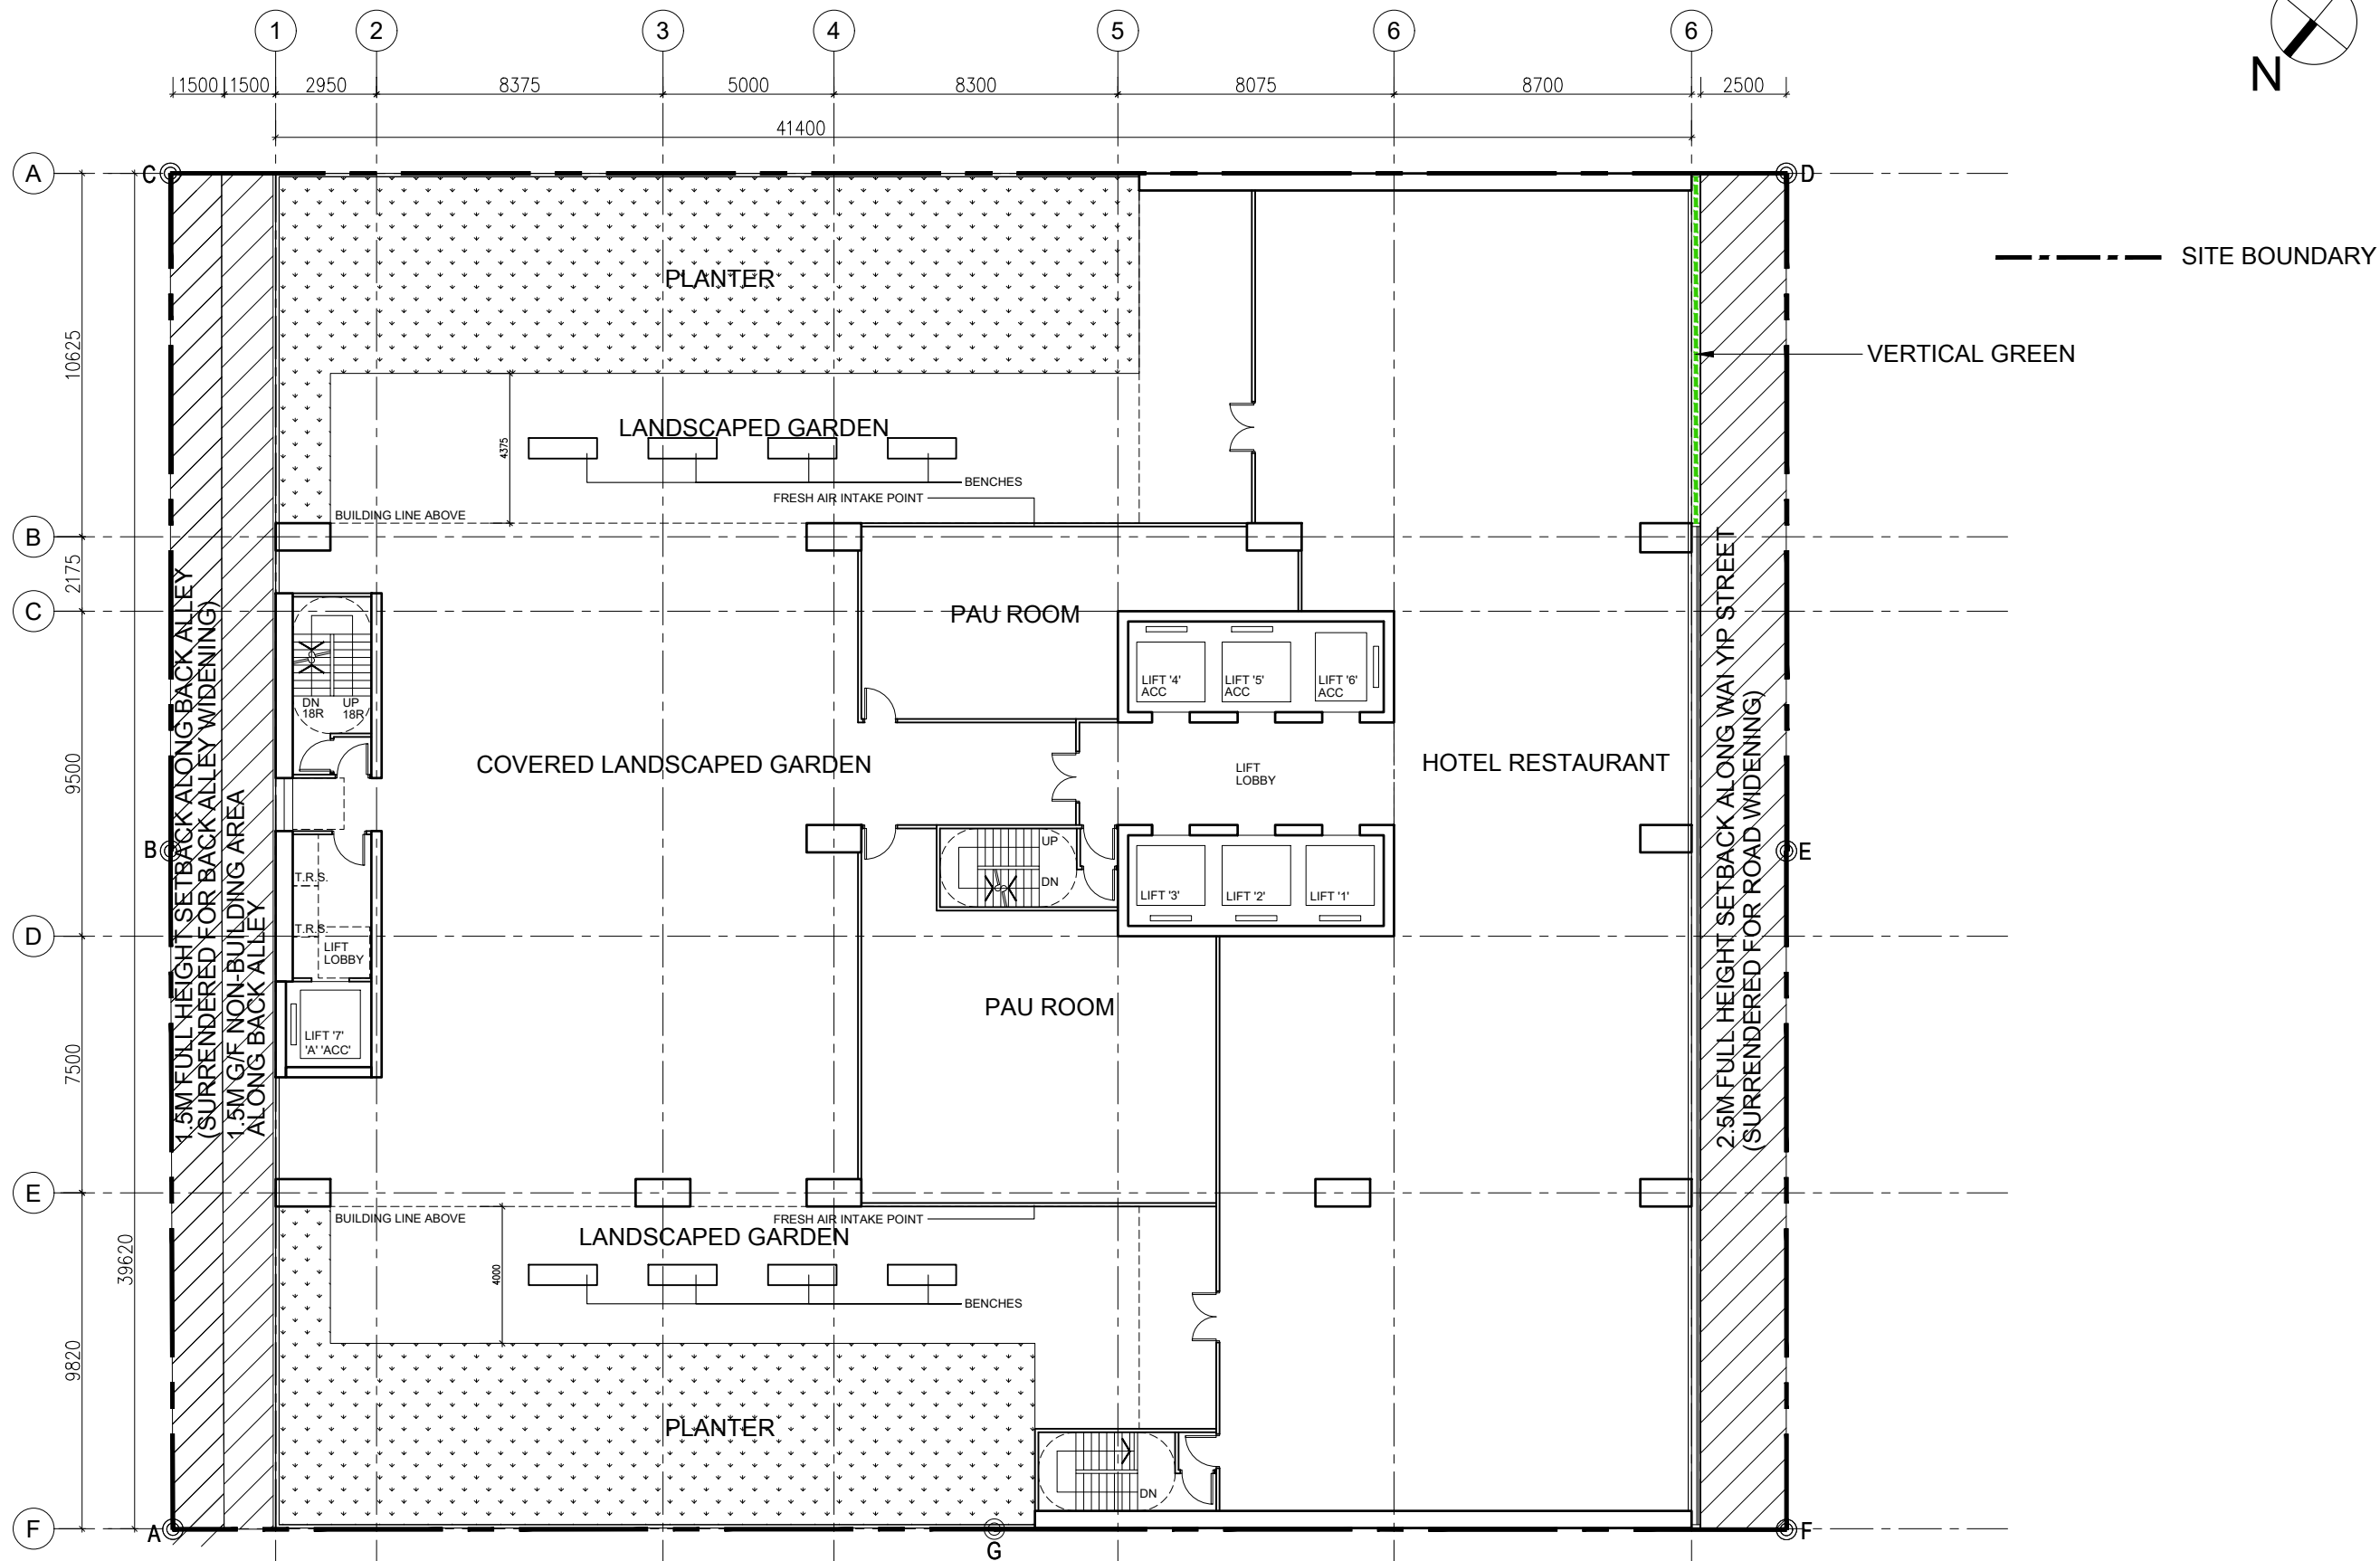




Drawing Title  
**2/F PLAN**

Scale  
**1:200**  
Date  
**14/03/2025**

Project  
SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL  
WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING  
HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET,  
KWUN TONG, KOWLOON

Job No.  
**A-2302**



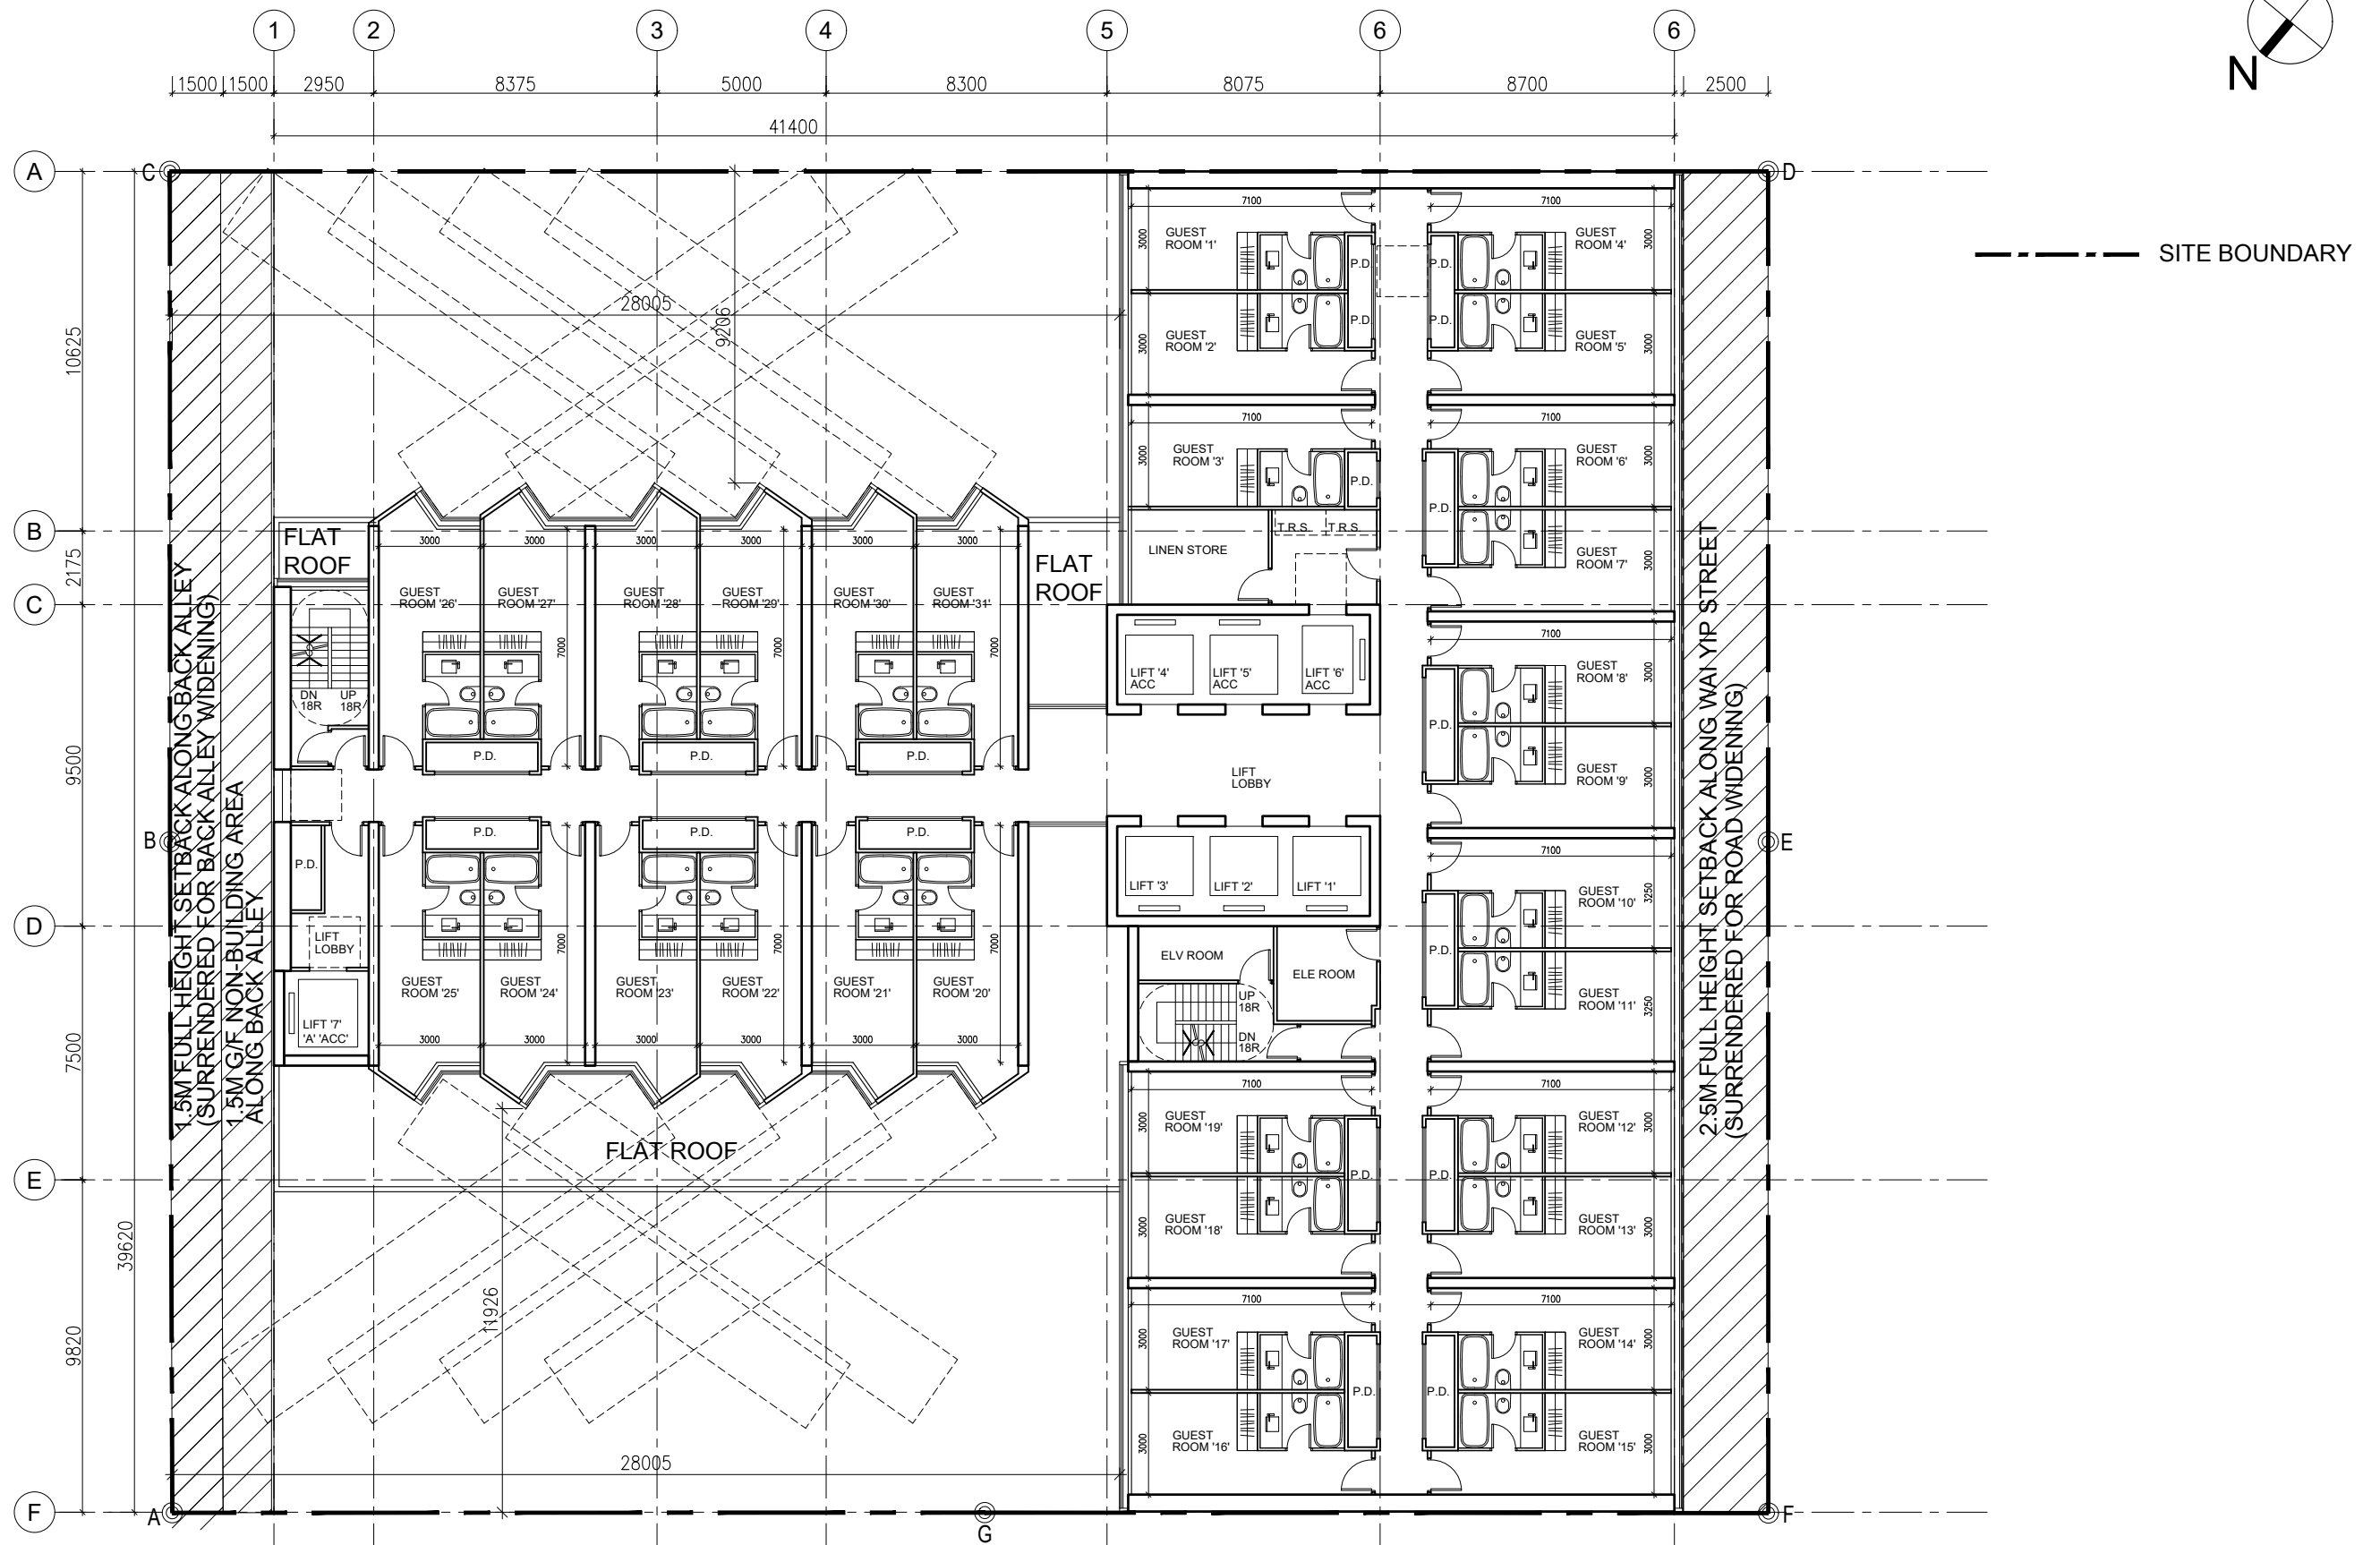

Drawing Title

**3/F - 4/F PLAN**

Scale

**1:200**

Date

**14/03/2025**

Project




SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET, KWUN TONG, KOWLOON

Job No.

**A-2302**






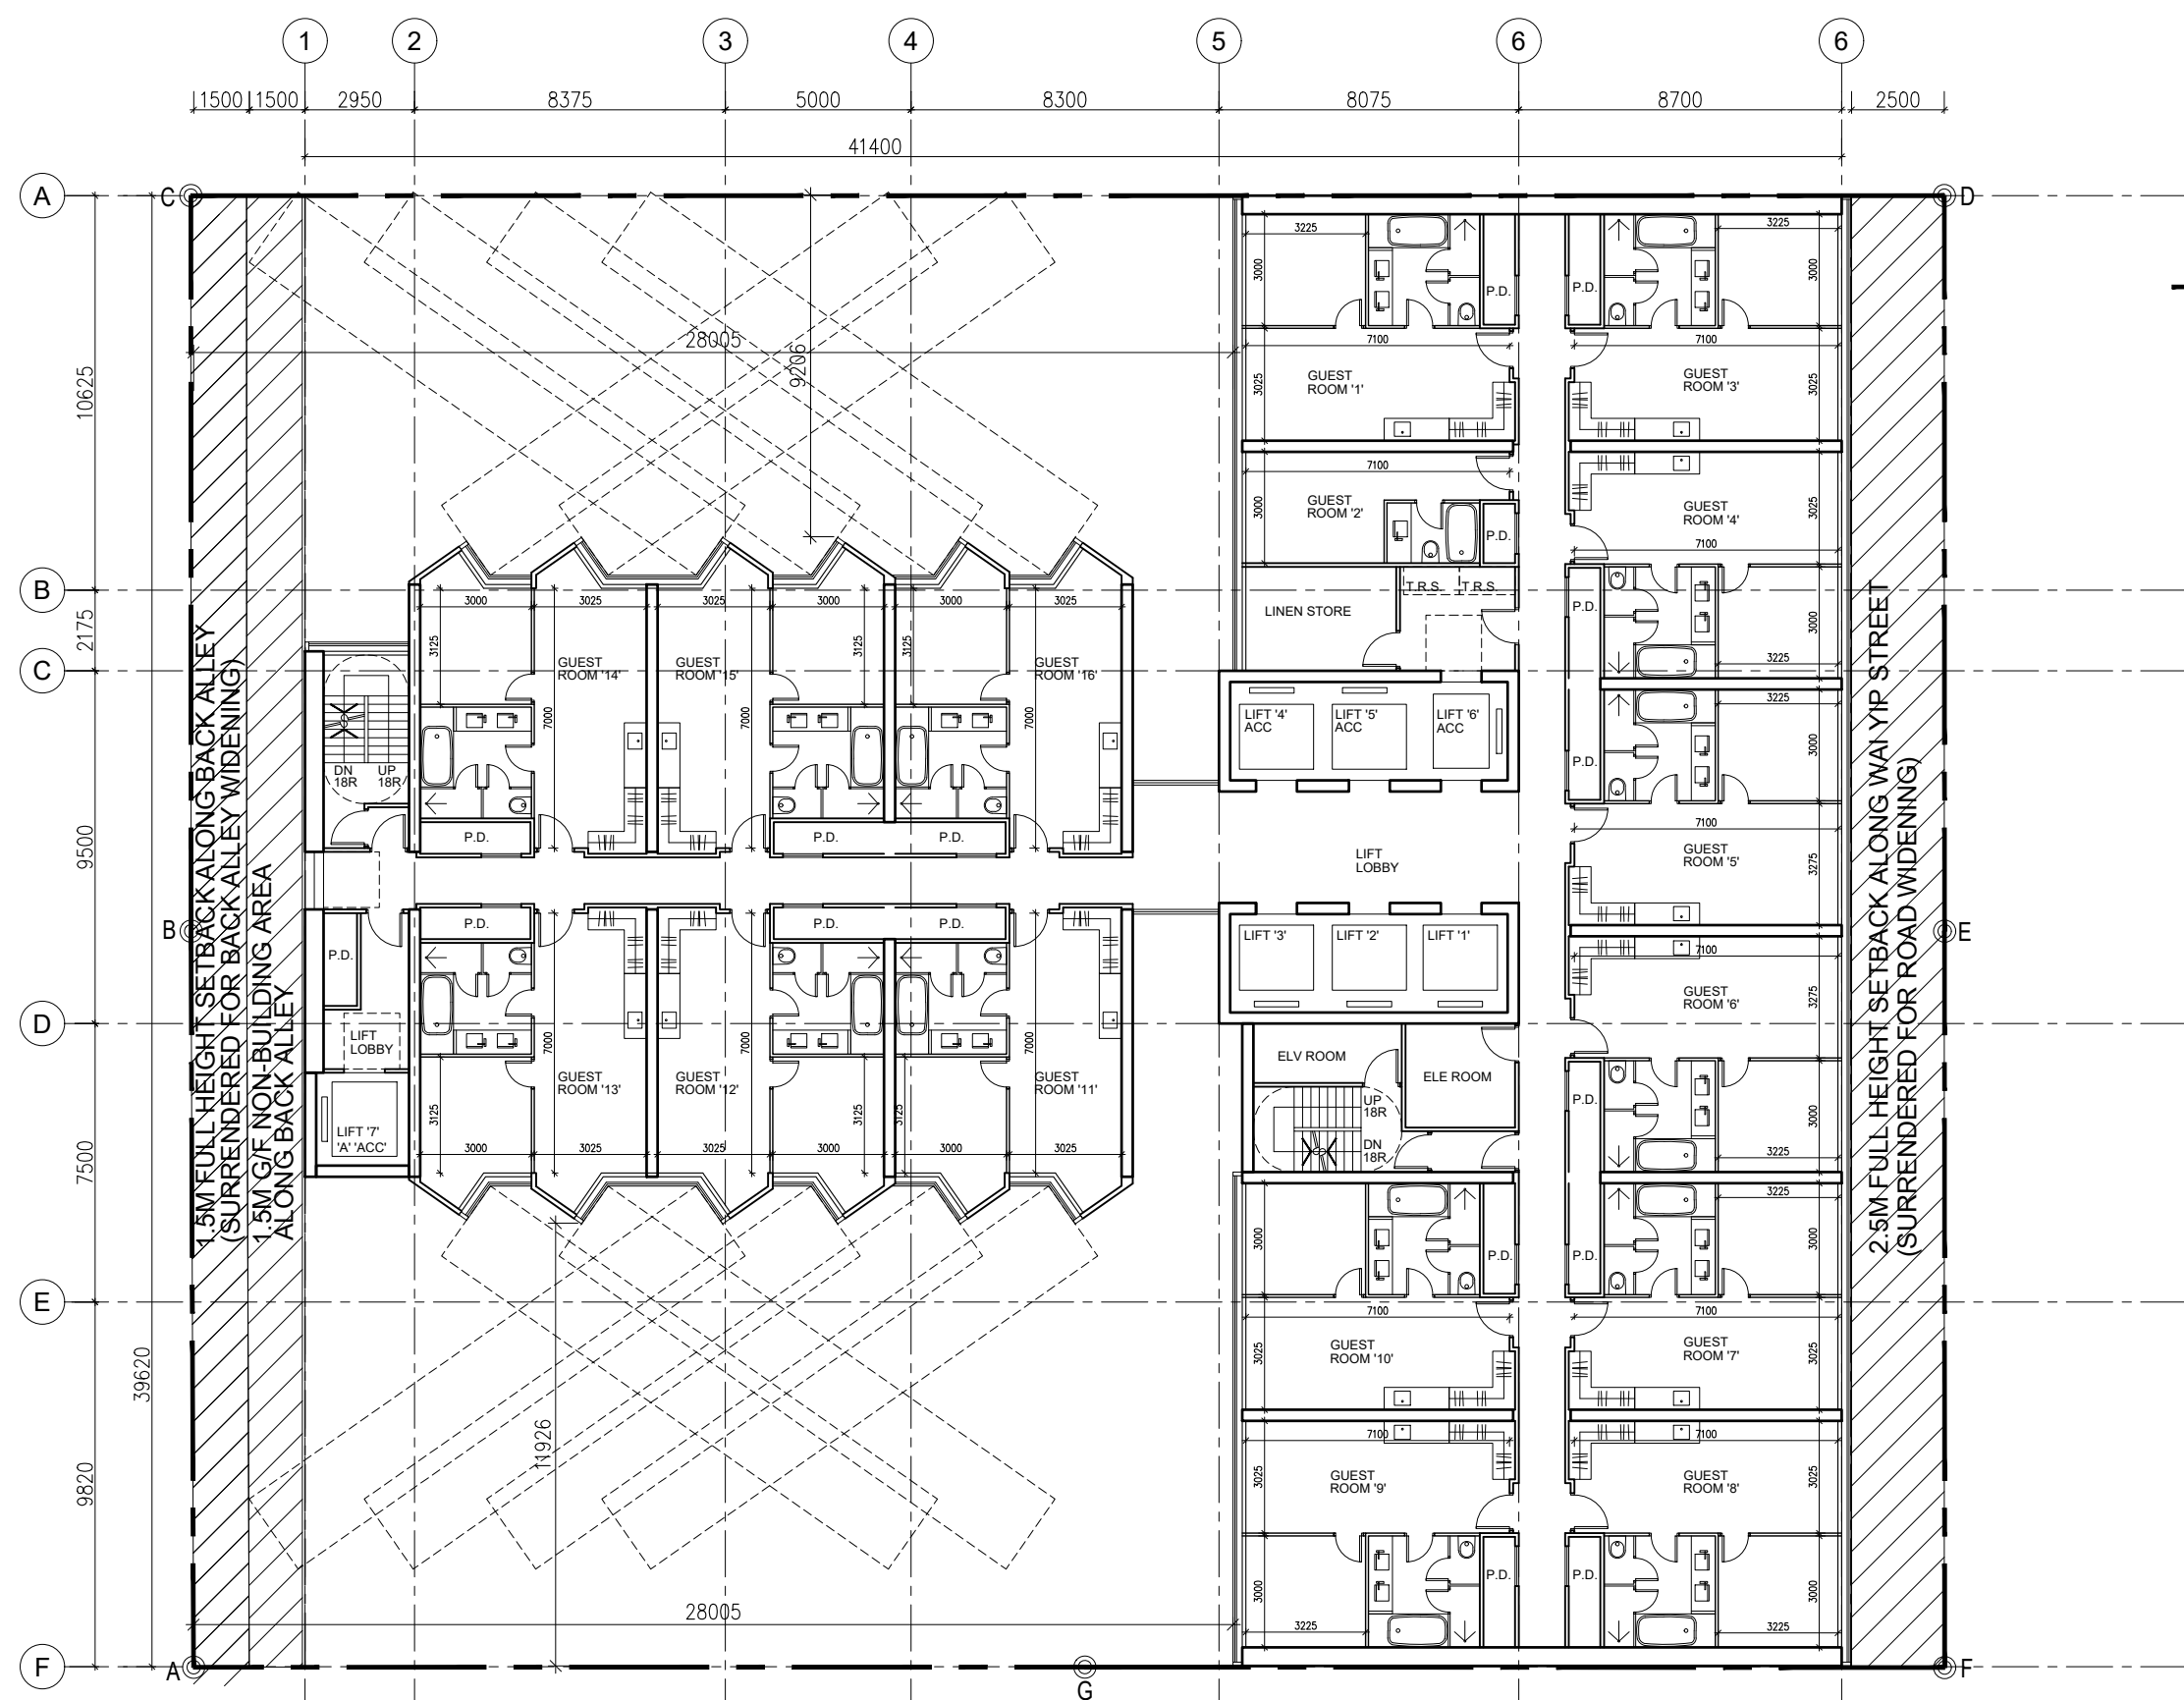


Drawing Title  <b>5/F - 6/F PLAN</b>	Scale <b>1:200</b>	Project SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET, KWUN TONG, KOWLOON	Job No.  A-2302
	Date <b>14/03/2025</b>		




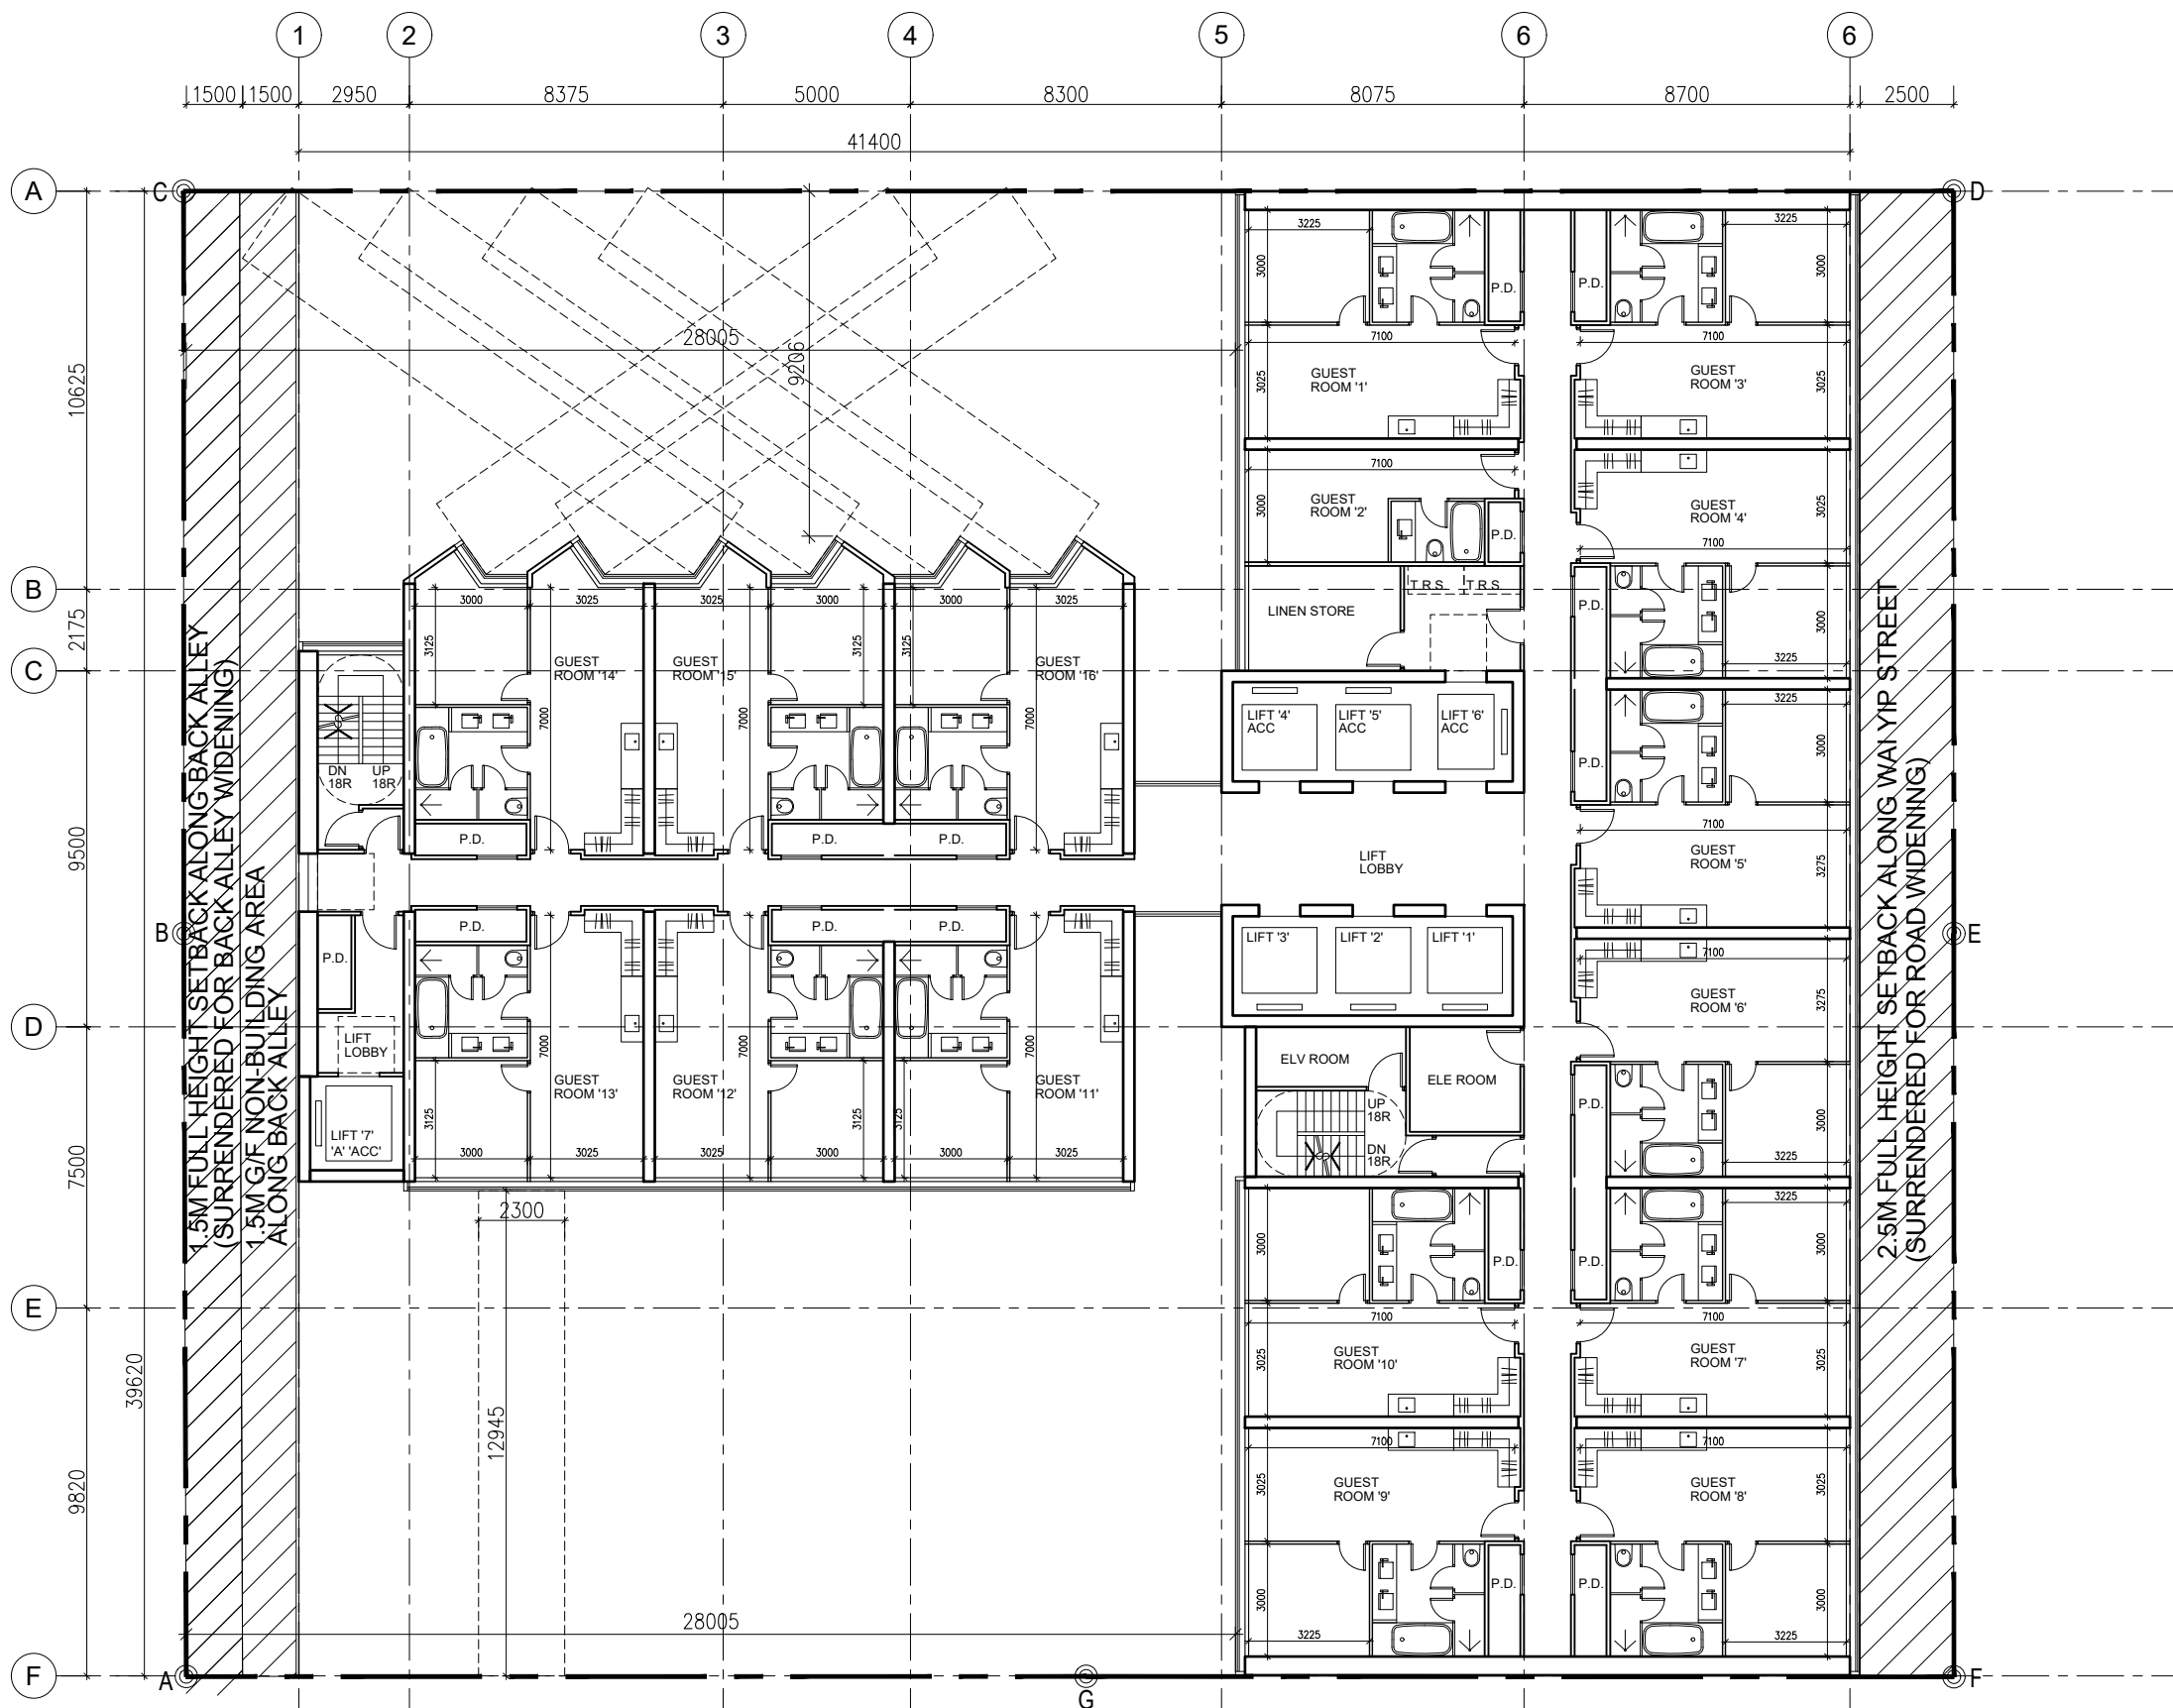


----- SITE BOUNDARY




Drawing Title	Scale	Project	Job No.
	1:200		
7/F - 11/F PLAN	Date		
	14/03/2025		



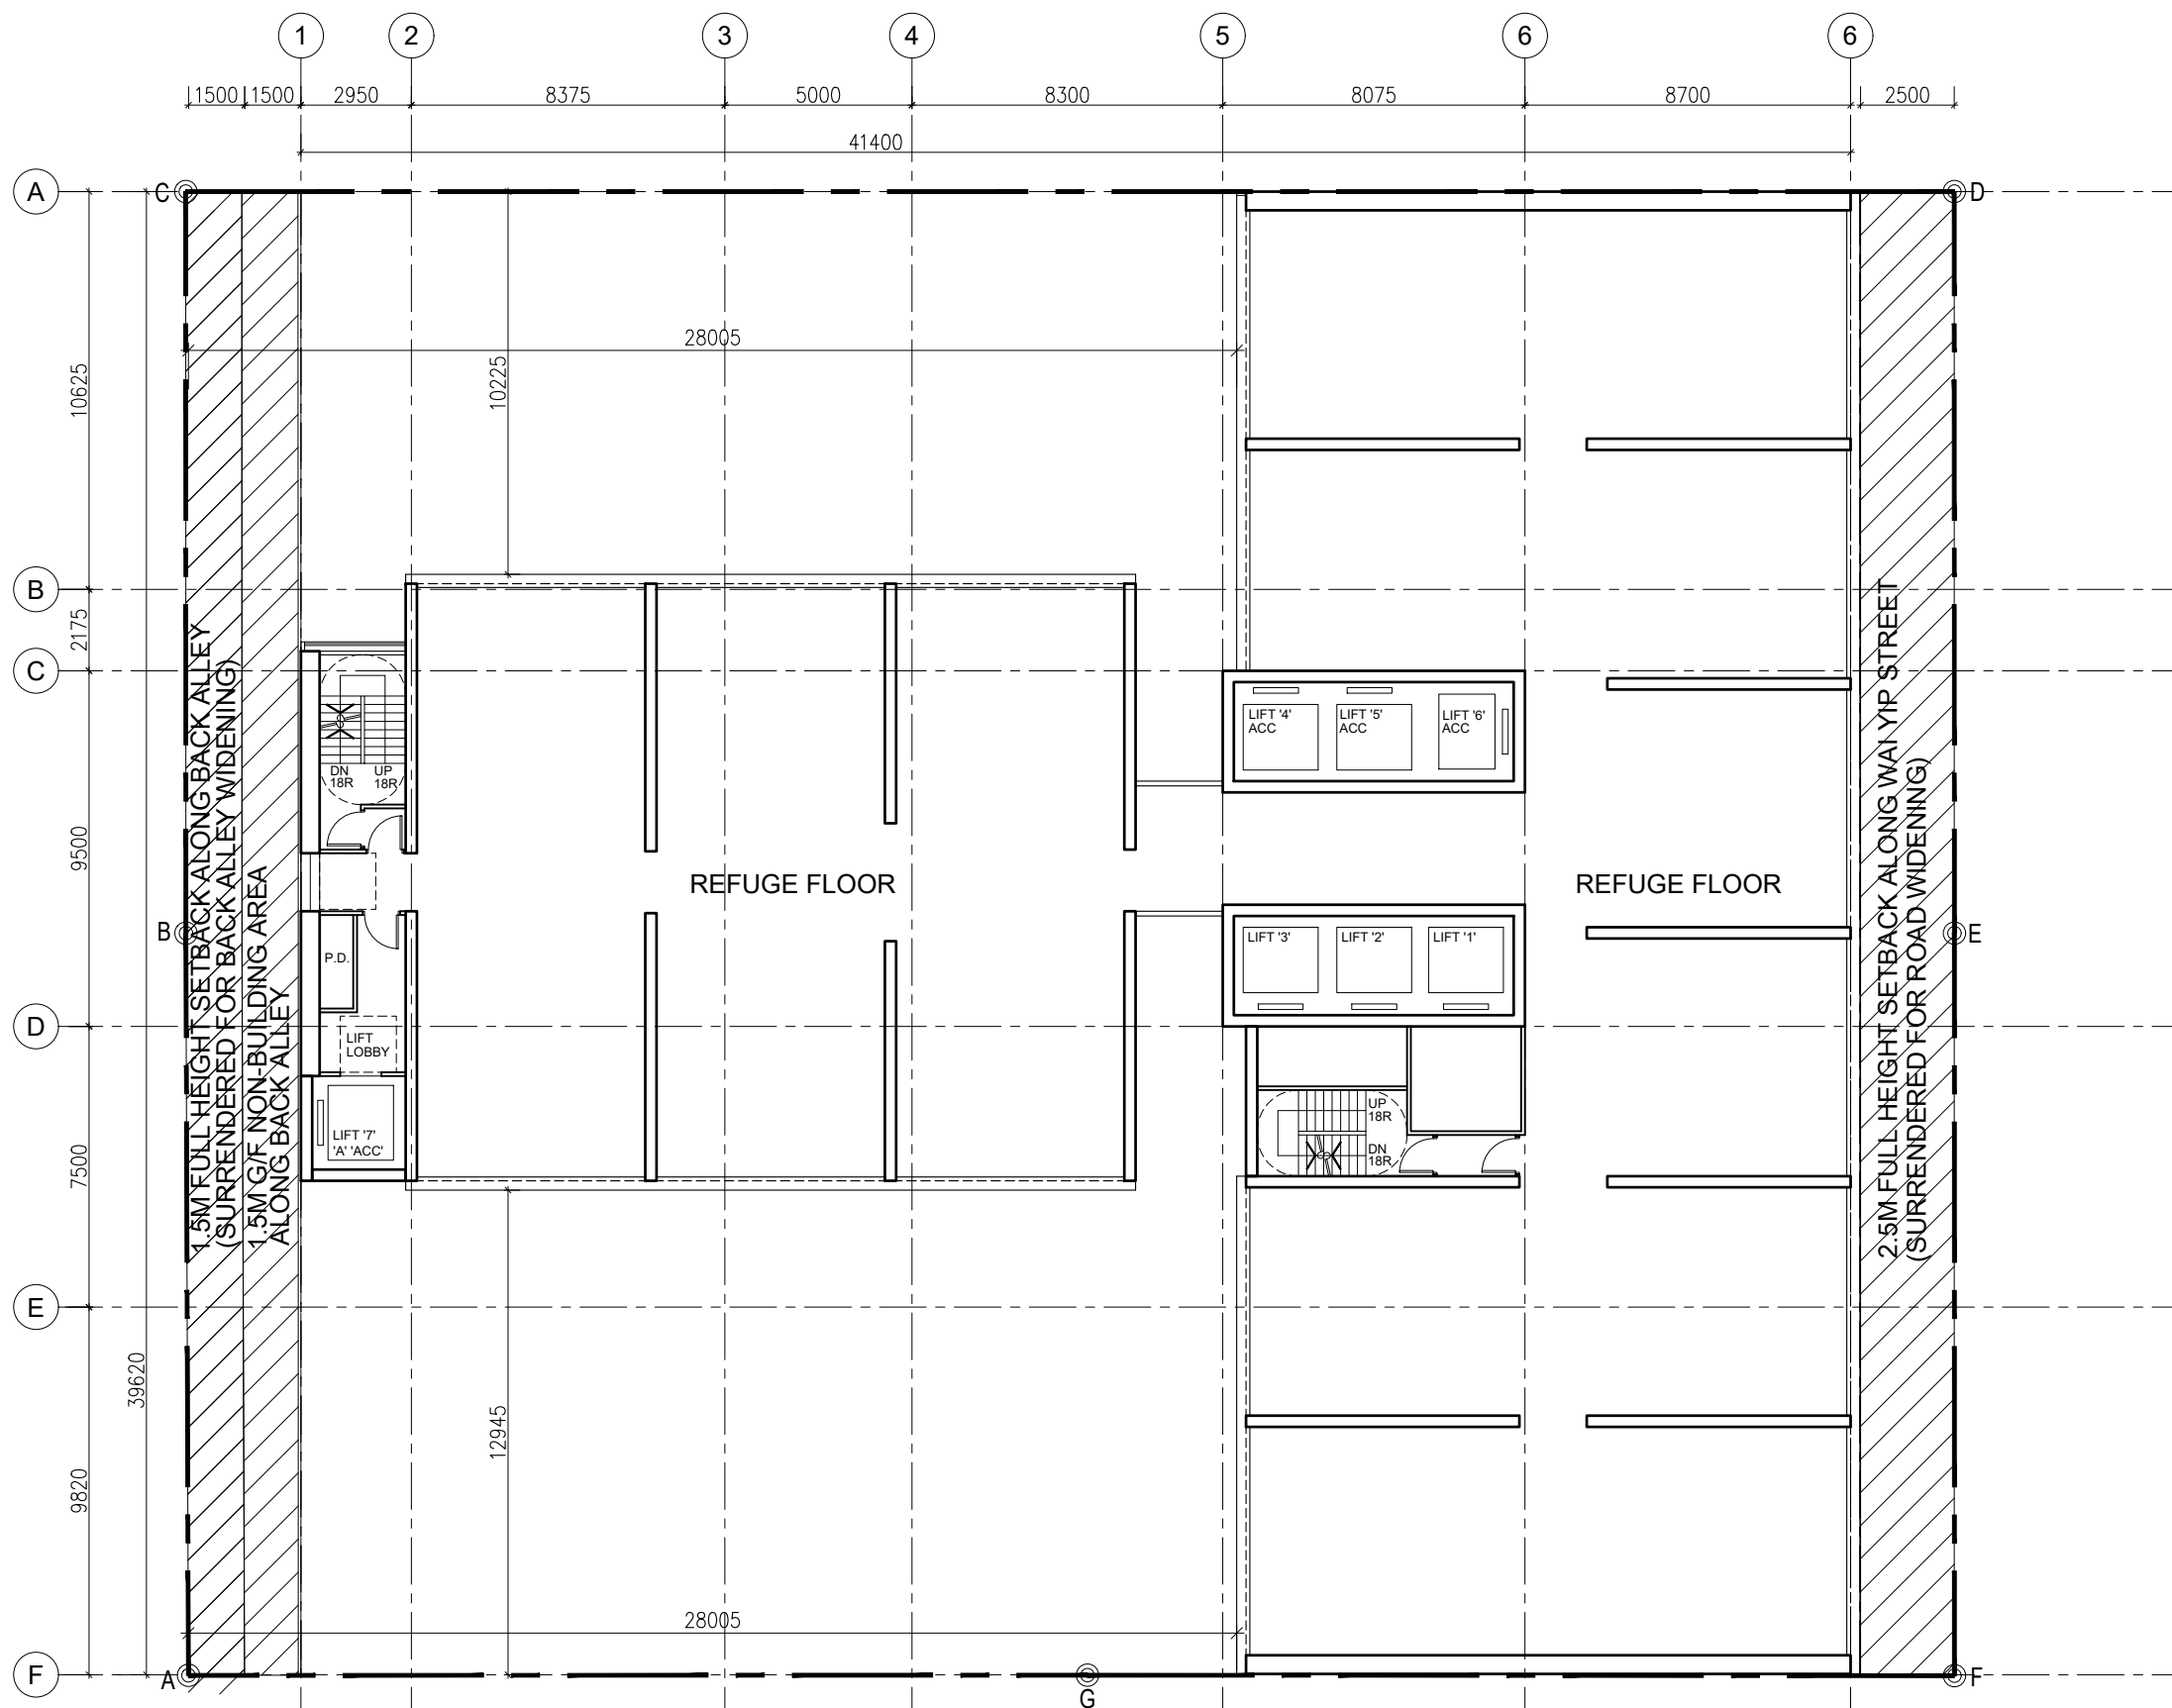

SCALE BAR



Drawing Title

17/F PLAN

Scale

1:200

Date

14/03/2025




Project

SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET, KWUN TONG, KOWLOON



Job No.

A-2302


**ALKF+**  
ANDREW LEE KING FUN &  
ASSOCIATES ARCHITECTS LTD

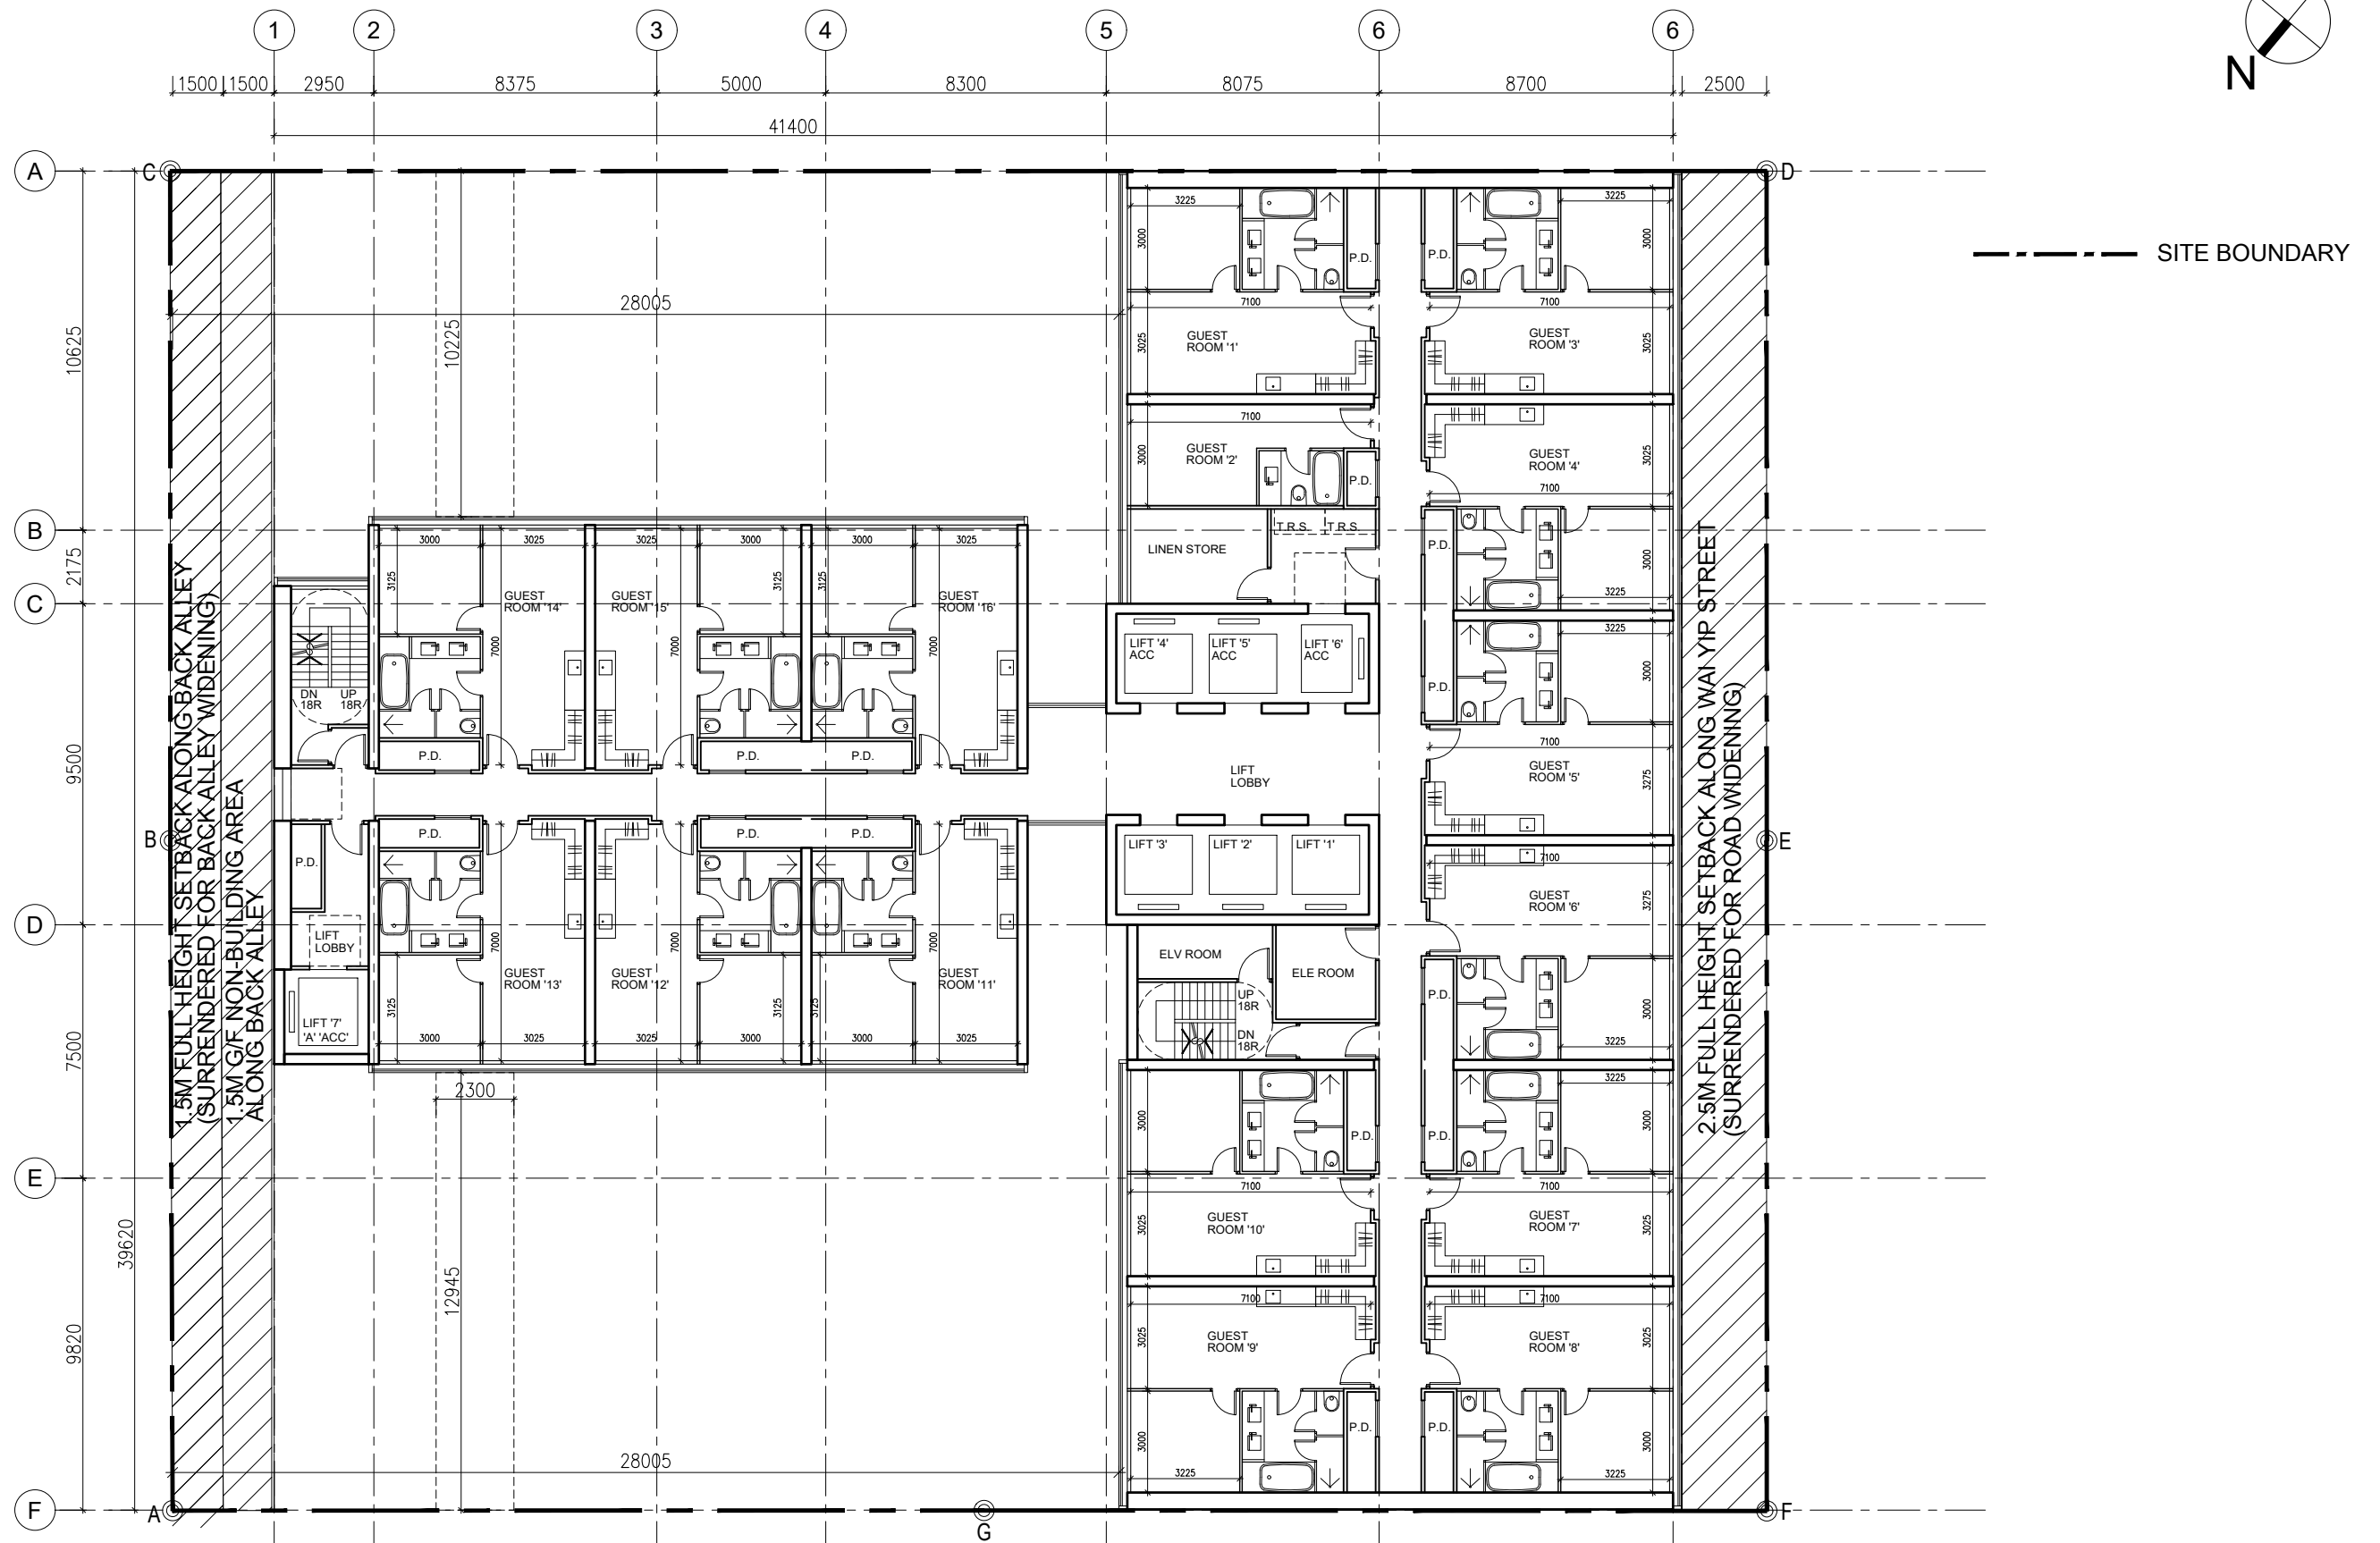

Drawing Title	Scale	Project	Job No.	
	Date			
	14/03/2025			


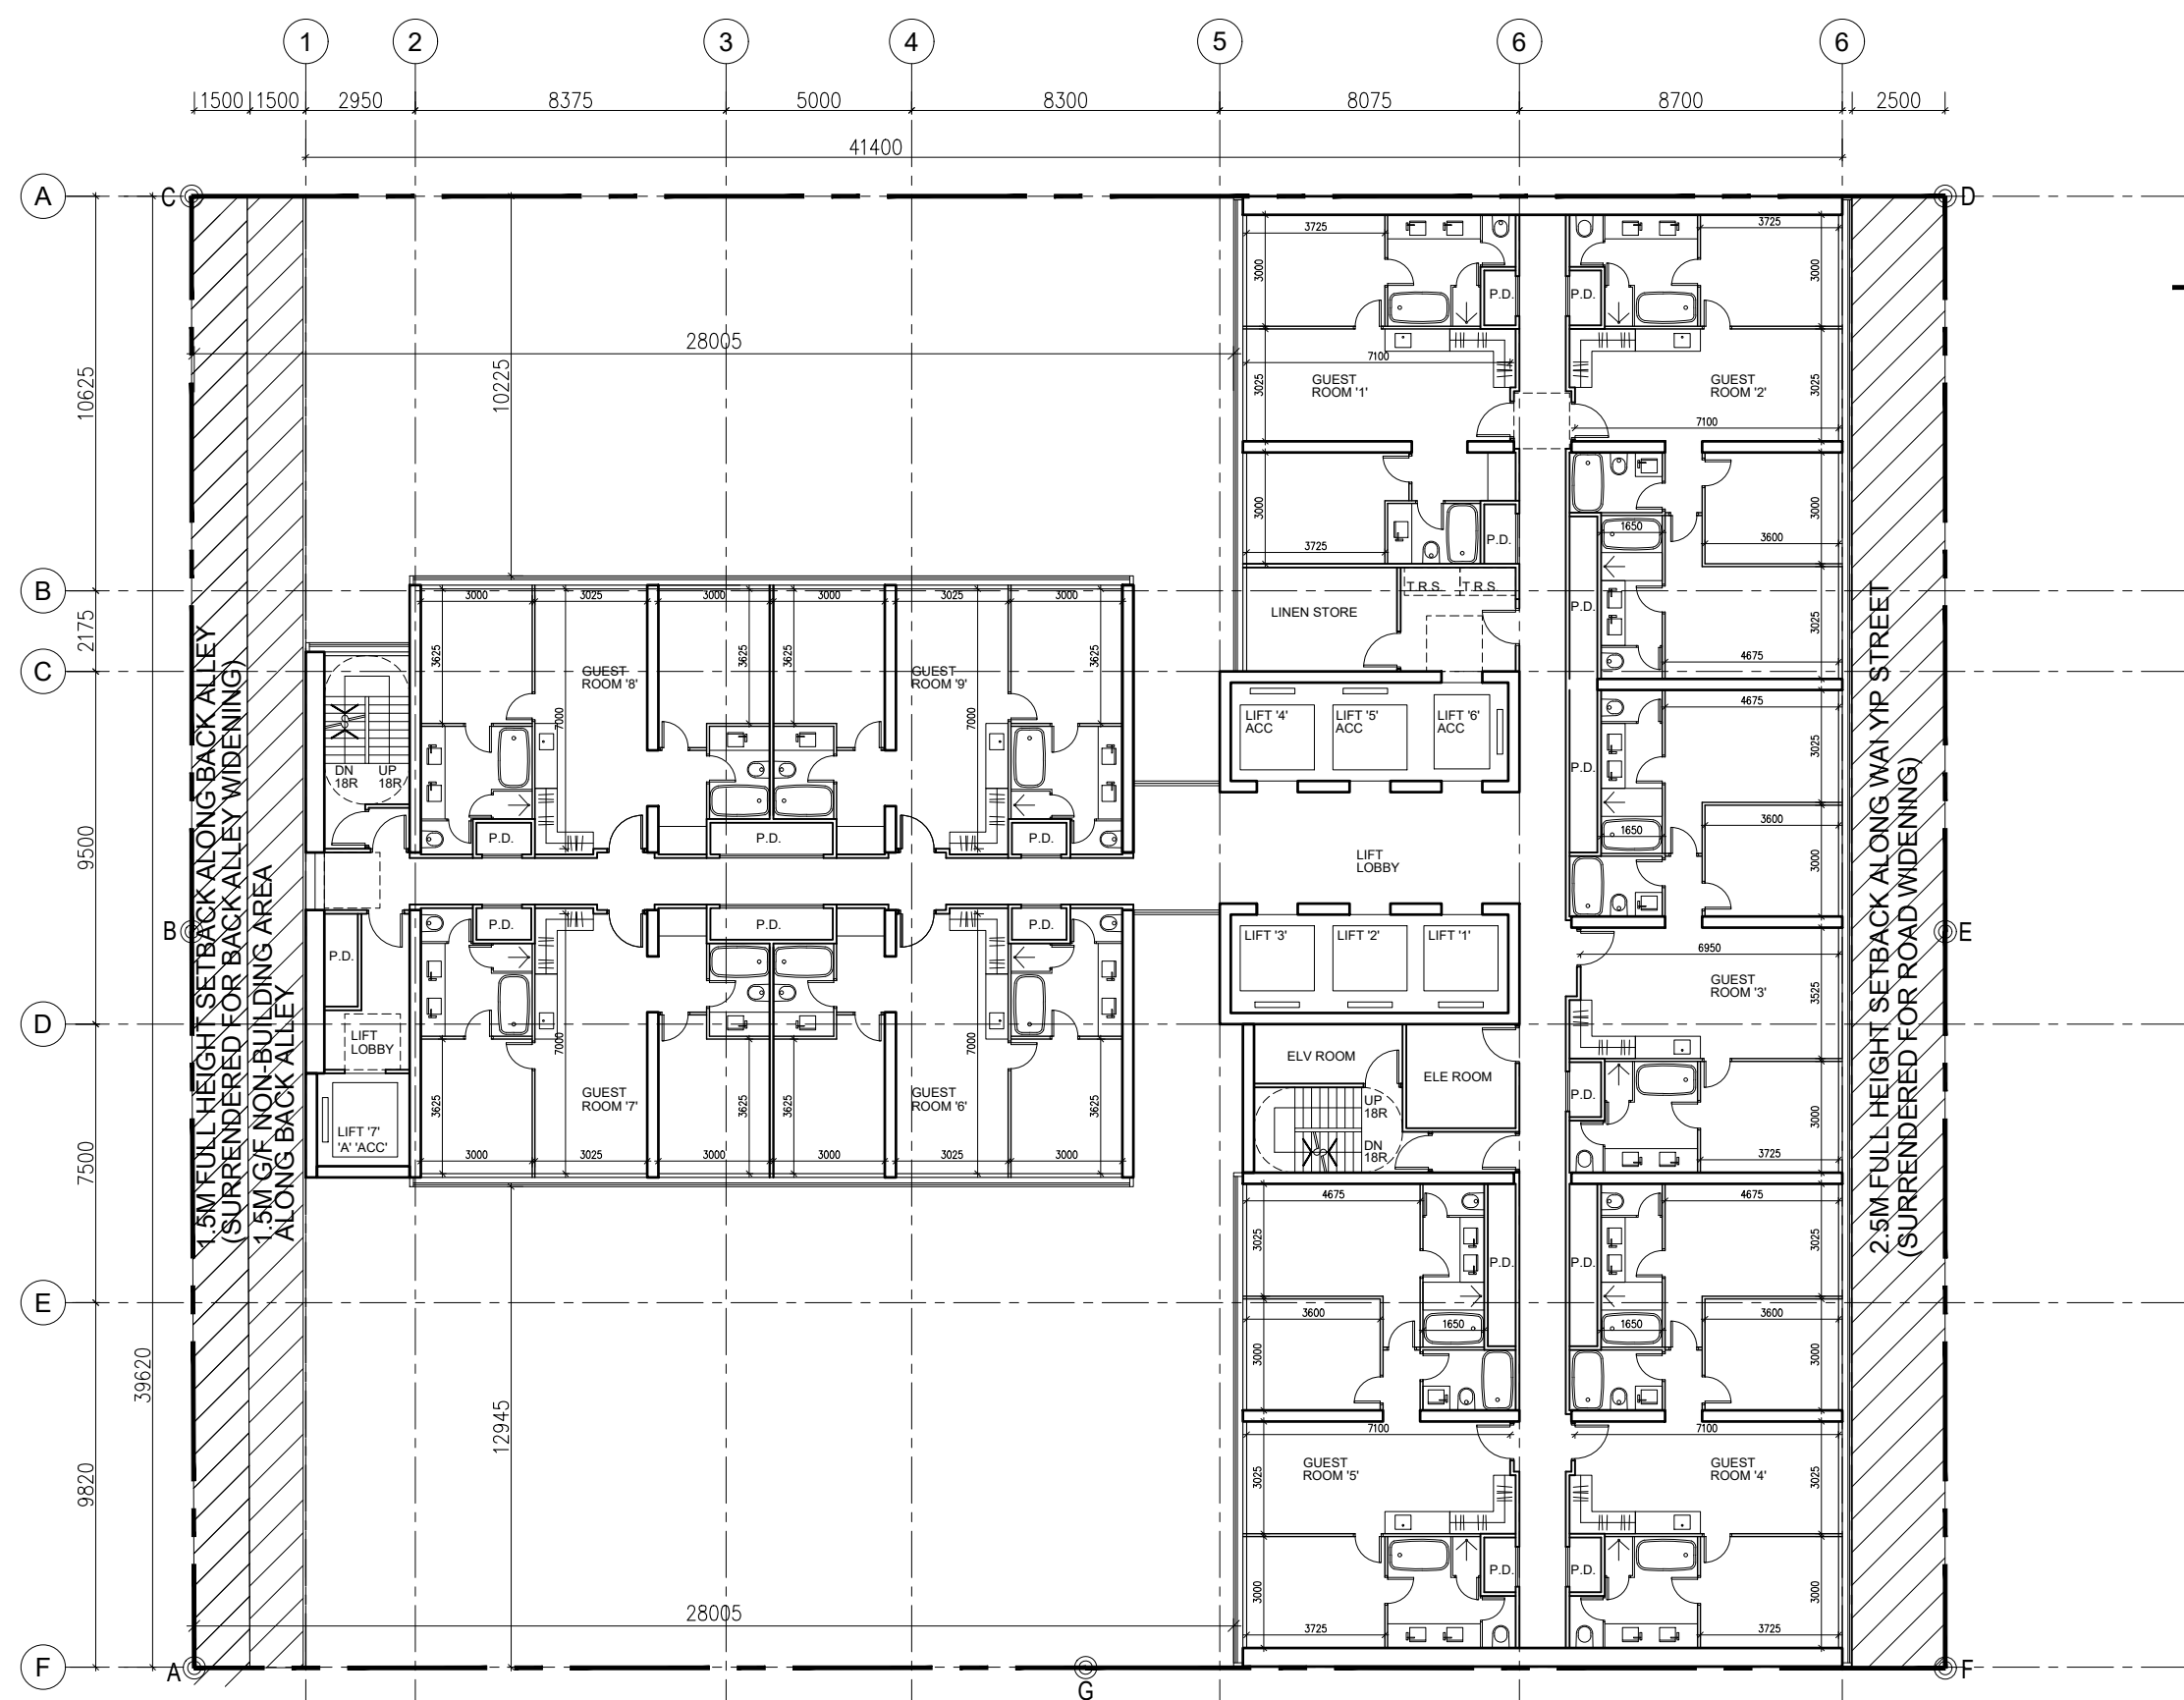



----- SITE BOUNDARY






Drawing Title	29/F - 30/F PLAN	Scale	1:200	Project	SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET, KWUN TONG, KOWLOON	Job No.	A-2302
		Date	14/03/2025				





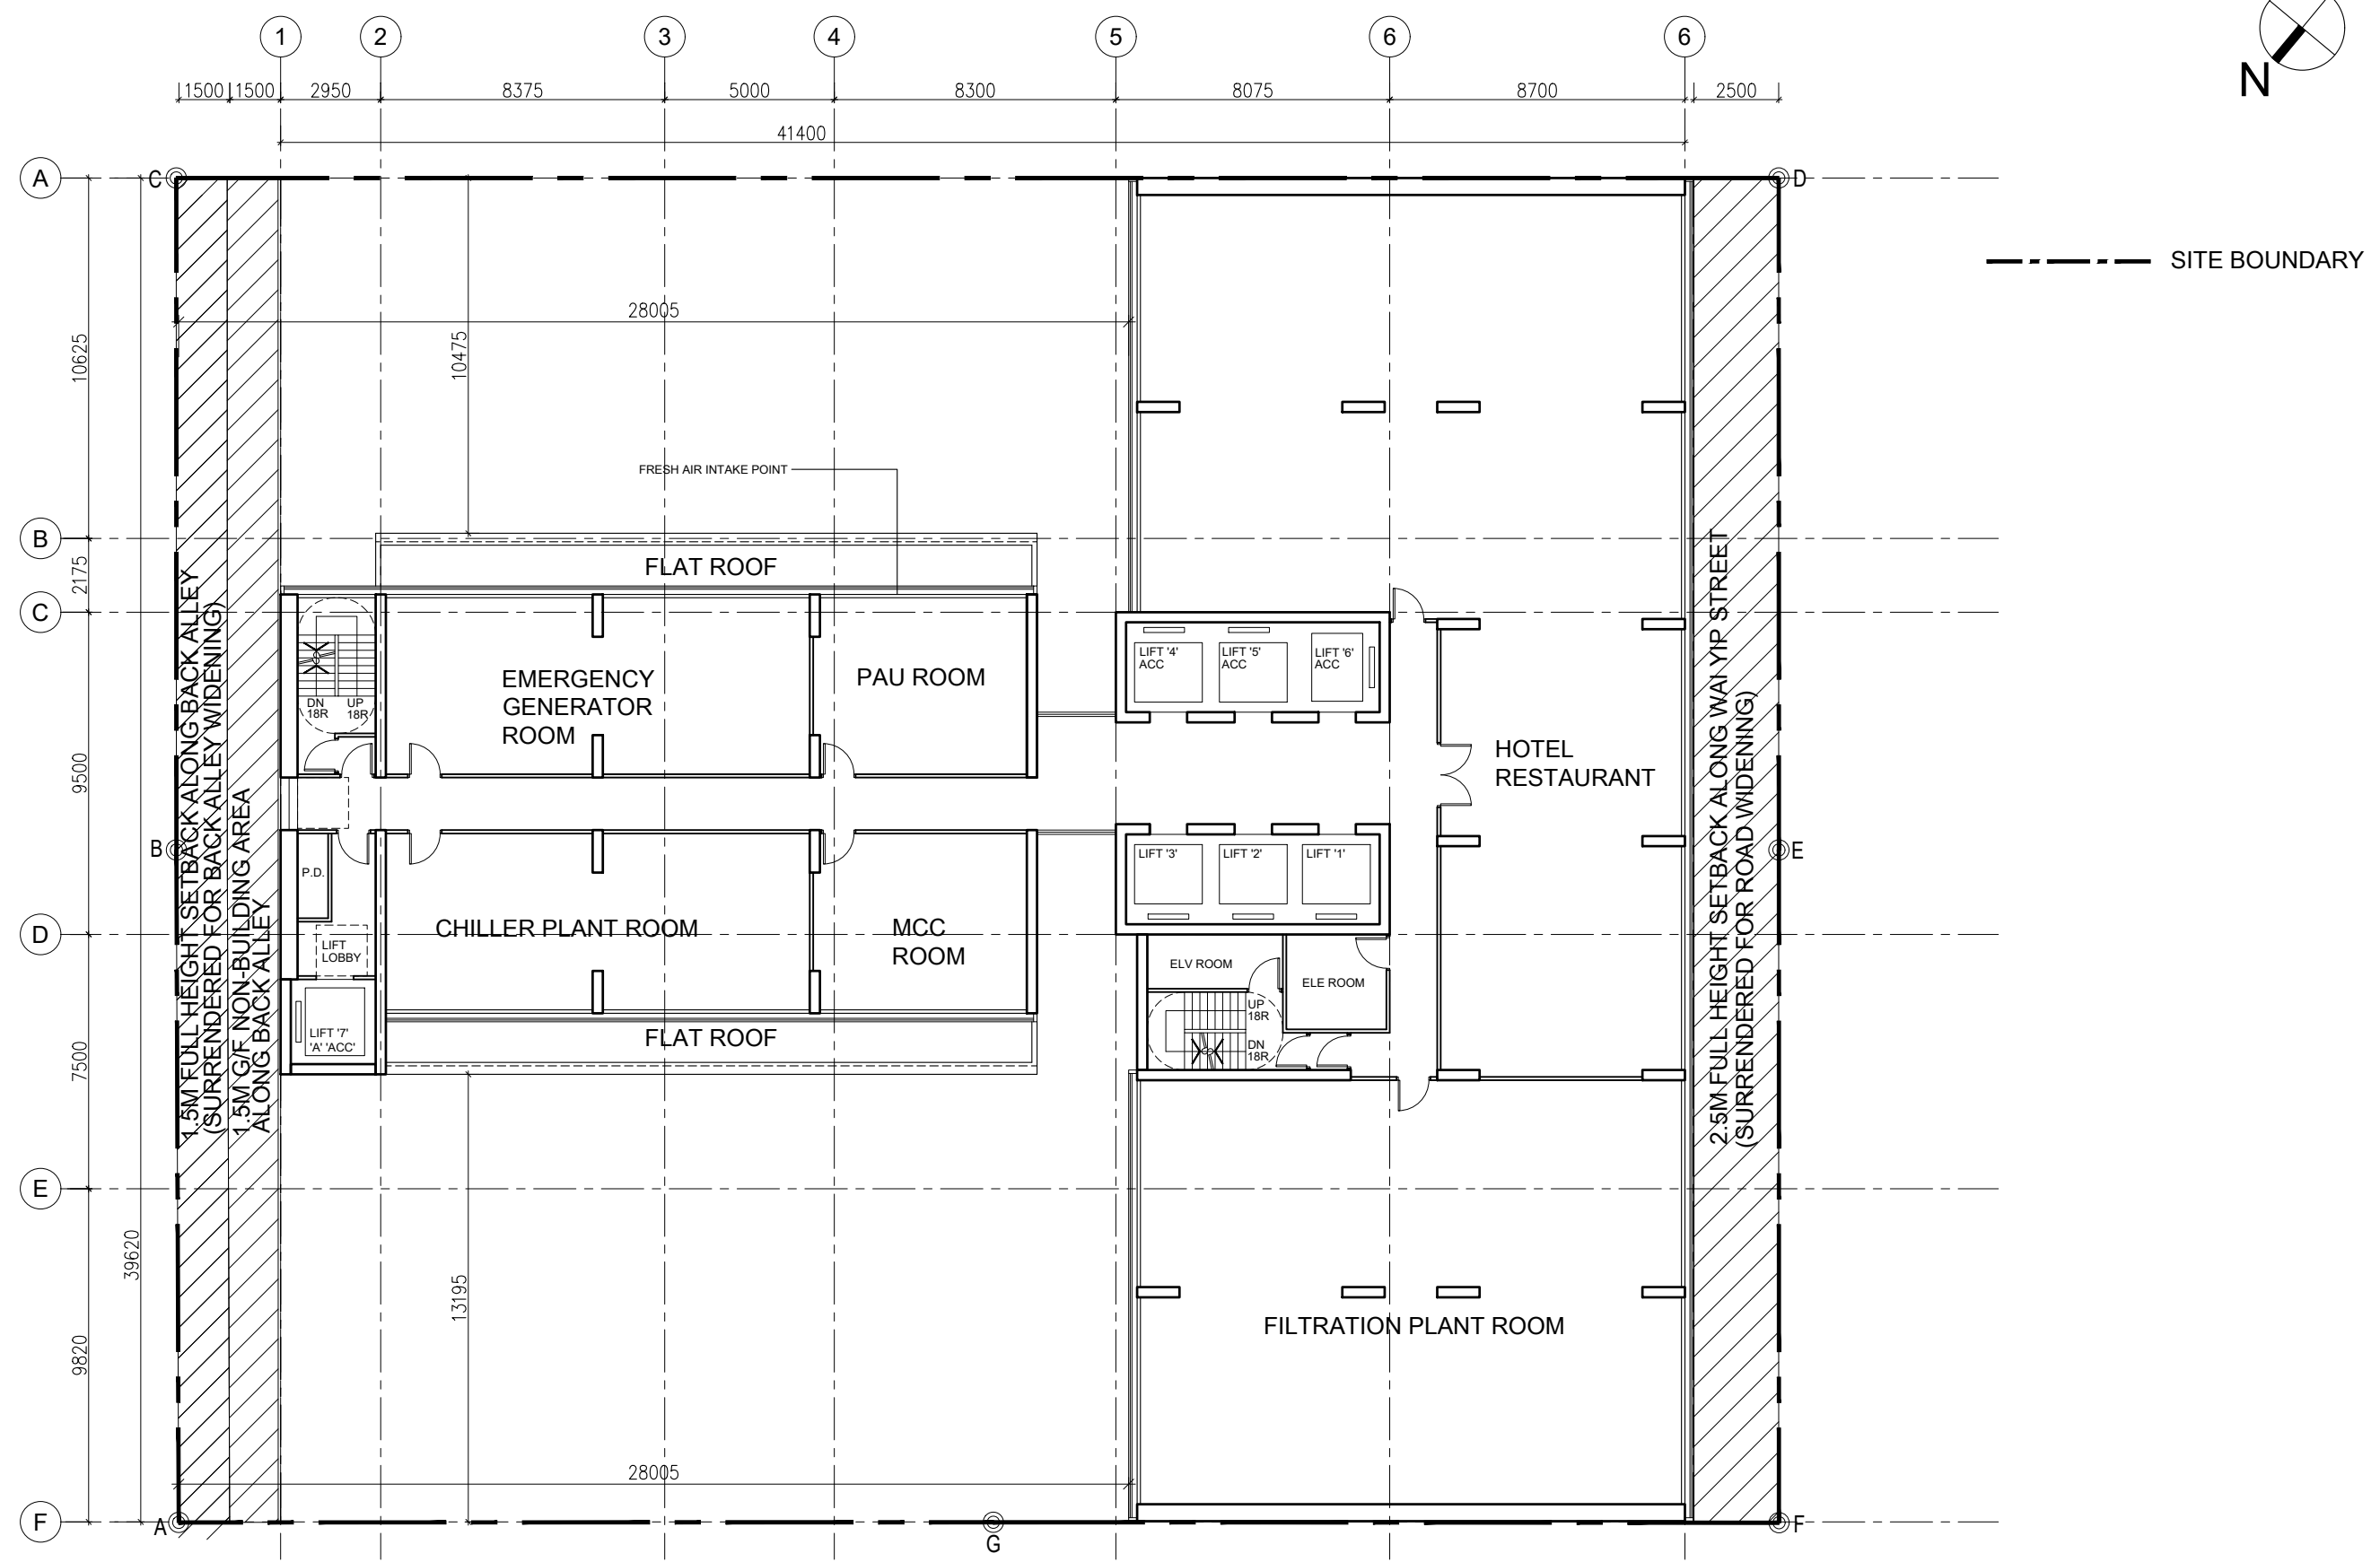



Drawing Title	Scale	Project	Job No.
	Date		
	14/03/2025		




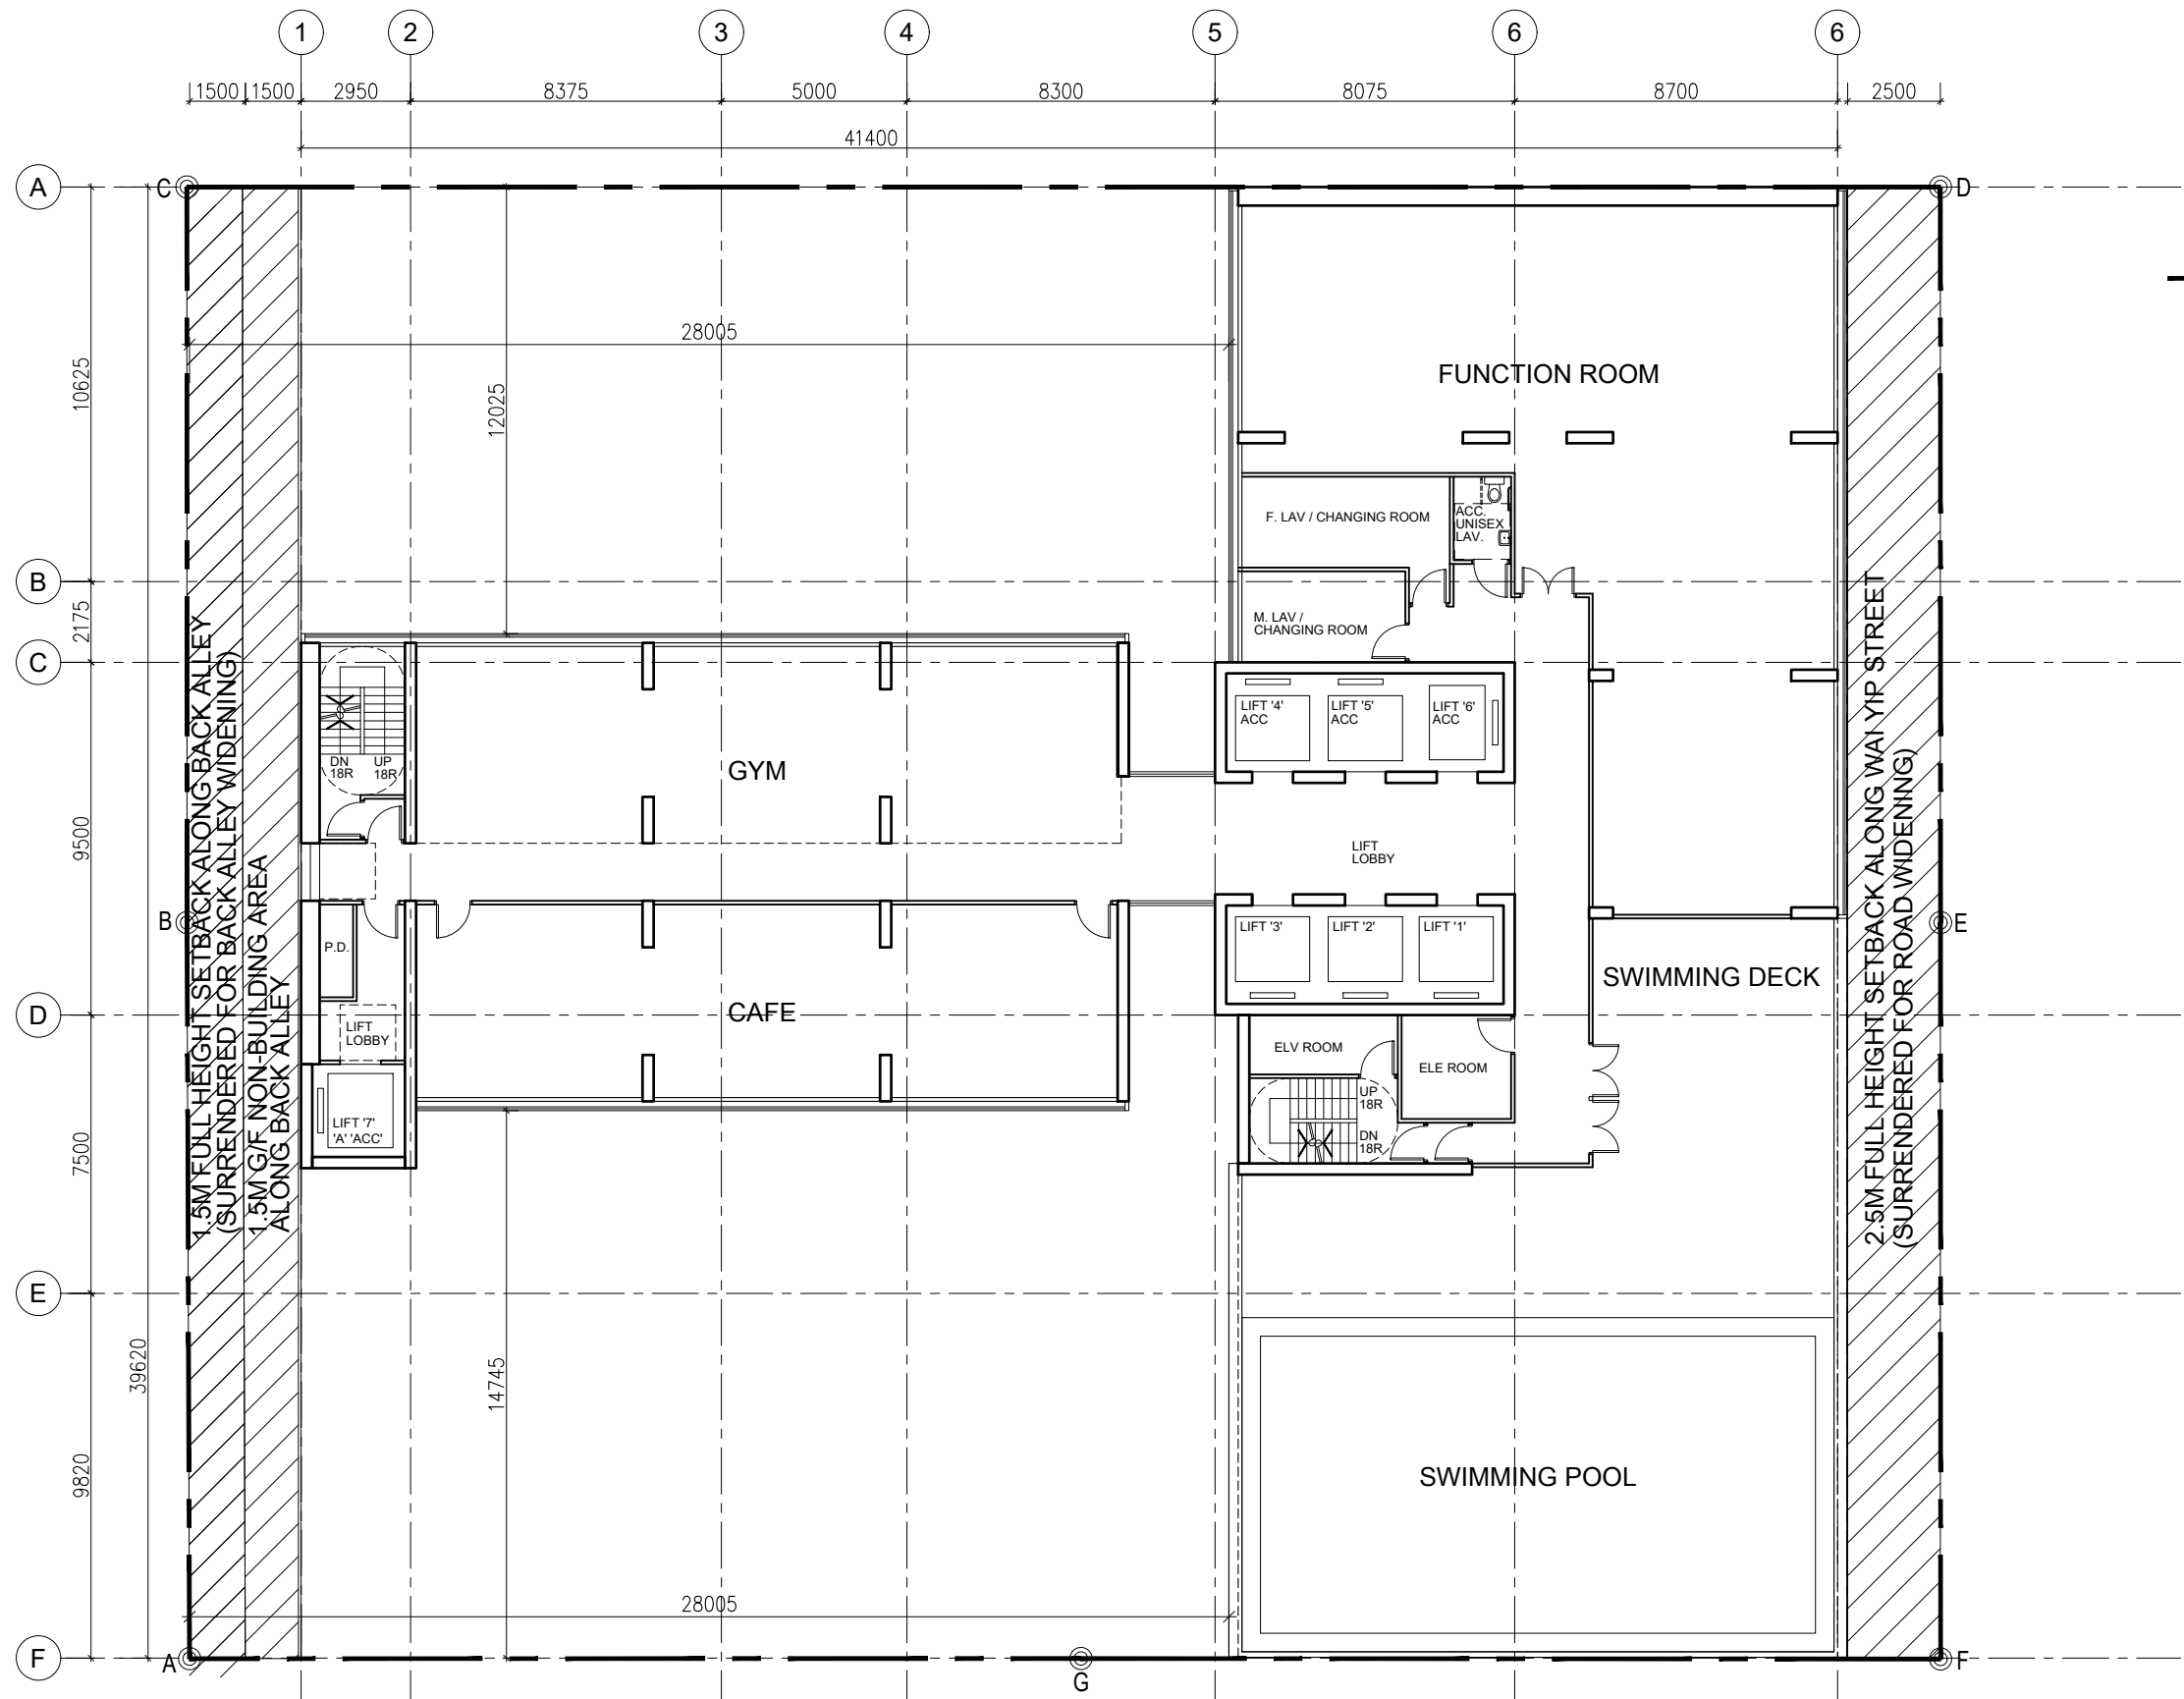


Drawing Title  <b>32/F PLAN</b>	Scale <b>1:200</b>	Project SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET, KWUN TONG, KOWLOON	Job No.  A-2302	
	Date <b>14/03/2025</b>			

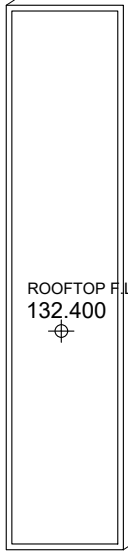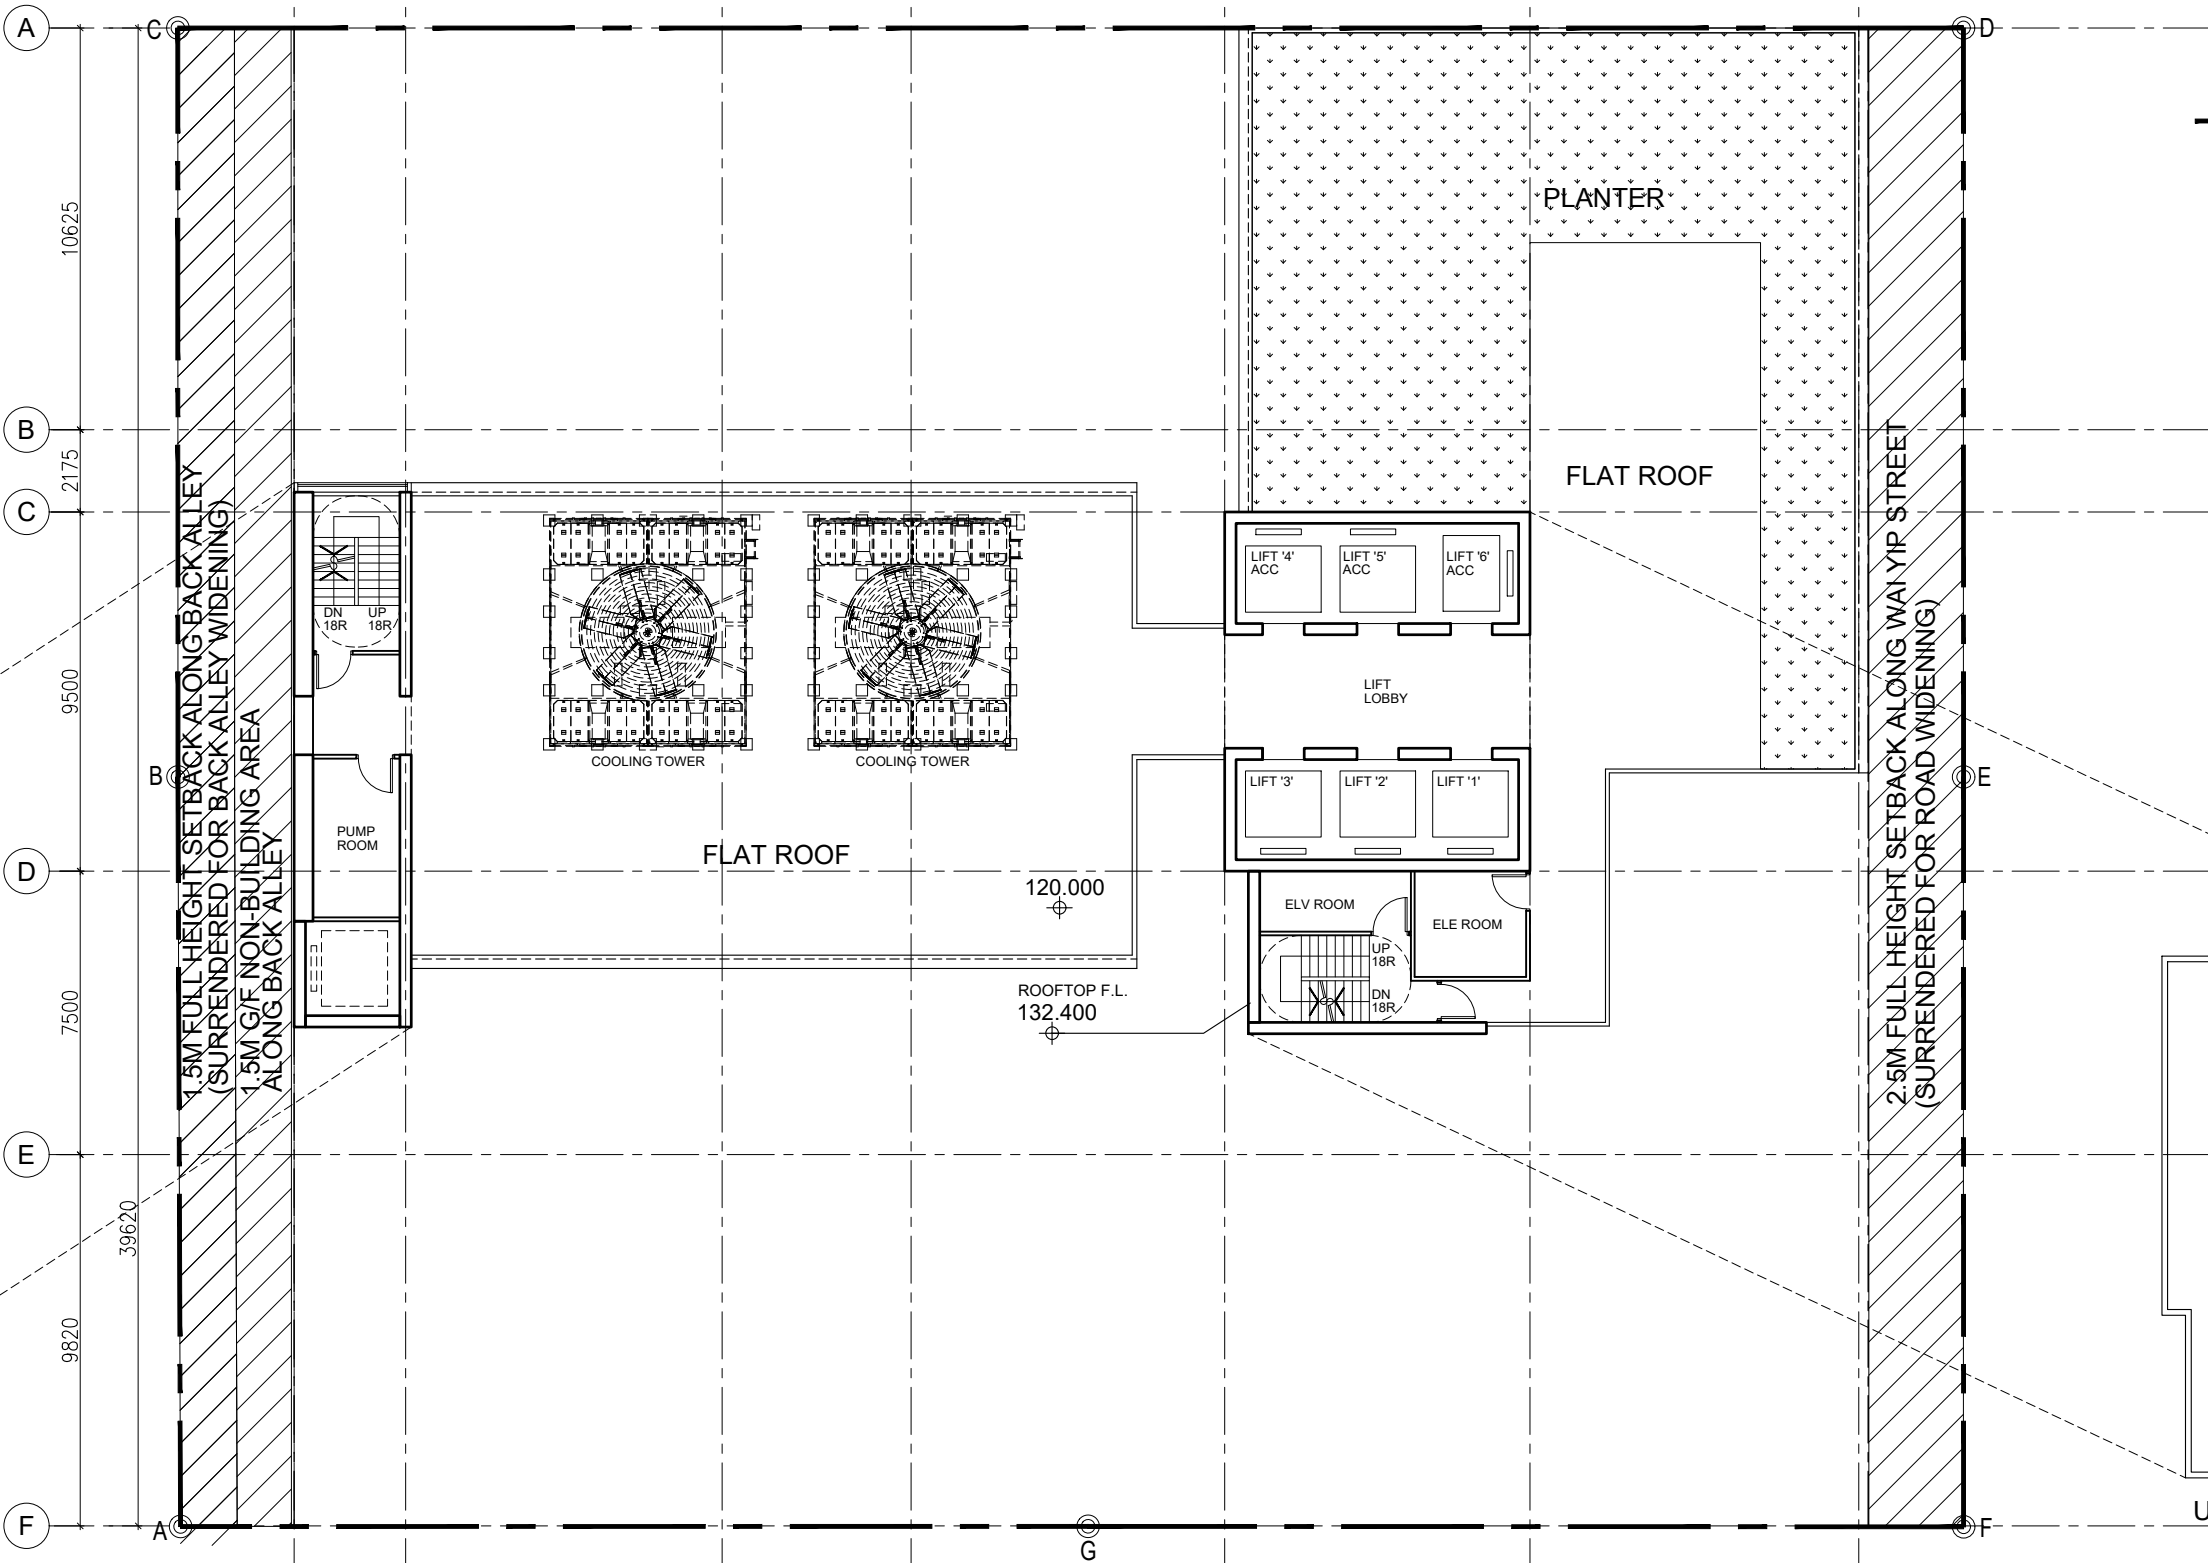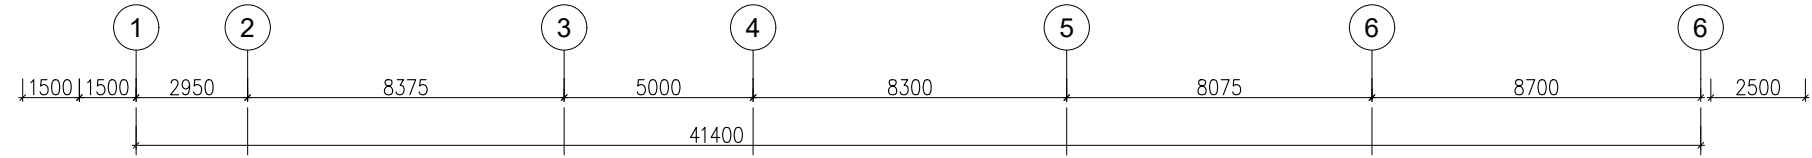

UPPER ROOF PLAN

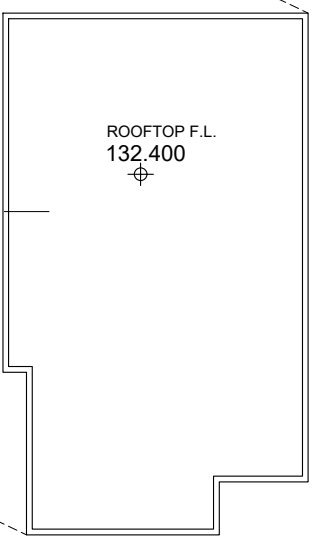

UPPER ROOF PLAN



Drawing Title <b>ROOF FLOOR PLAN</b>	Scale <b>1:200</b>	Project SECTION 16 PLANNING APPLICATION FOR PROPOSED HOTEL WITH MINOR RELAXATION OF PLOT RATIO AND BUILDING HEIGHT RESTRICTIONS AT 201 AND 203 WAI YIP STREET, KWUN TONG, KOWLOON	Job No. A-2302	
	Date 14/03/2025			



**Appendix 2.1 Detailed Sewerage Impact Assessment Calculations**

**Table 1. Calculation of Sewage Generation Rate of the Proposed Development (201 & 203 Wai Yip Street, Kwun Tong, Kowloon)**

<b>1. Hotel (3/F to 30/F)</b>	
Assumed area	= 25378 m <sup>2</sup>
Assumed floor area per employee	= 31.3 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Hotels and Boarding Houses)
Total number of employees	= 812 employees
Design flow for commercial employees	= 1.58 m <sup>3</sup> /employee/day -- (refer to Table T-2 of GESF - J10 Restaurant & Hotels)
Sewage generation rate	= <b>1283.1</b> m <sup>3</sup> /day
<b>2. Restaurant &amp; Café (2/F, 31/F &amp; 32/F)</b>	
Assumed Floor Area	= 861 m <sup>2</sup>
Assumed floor area per employee	= 19.6 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Restaurant)
Total number of employees	= 44 employees
Design flow for commercial employees	= 1.58 m <sup>3</sup> /employee/day -- (refer to Table T-2 of GESF - J10 Restaurant & Hotels)
Sewage generation rate	= <b>69.4</b> m <sup>3</sup> /day
<b>3. Shop (G/F)</b>	
Assumed Floor Area	= 107 m <sup>2</sup>
Assumed floor area per employee	= 28.6 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Retail Trade)
Total number of employees	= 4 employees
Design flow for commercial employees	= 0.28 m <sup>3</sup> /employee/day -- (refer to Table T-2 of GESF - J4 Wholesale & Retail)
Sewage generation rate	= <b>1.0</b> m <sup>3</sup> /day
<b>3. Indoor Swimming Pool</b>	
Assumed area	= 120 m <sup>2</sup>
Assumed depth of water	= 1.5 m
Volume of water	= 180.0 m <sup>3</sup>
Turnover Rate	= 4.0 hr (CAP132, Section 42 Swimming Pools Regulation (covered))
Surface loading rate of filter	= 50.0 m <sup>3</sup> /m <sup>2</sup> /hr
Filter areas required	= 0.9 m <sup>2</sup>
Backwashing flow rate	= 30.0 m <sup>3</sup> /m <sup>2</sup> /hr
Design flow for backwashing	= 27.0 m <sup>3</sup> /hr
Backwash duration	= 7.0 min/day
Backwash generation rate	= 3.15 m <sup>3</sup> /day
Backwash generation rate	= <b>7.5</b> litre/sec
<b>Total Flow from Proposed Development</b>	
Flow Rate	= 1353.6 m <sup>3</sup> /day
Catchment Inflow Factor	= 1.1 Refer to Table T-4, Catchment Inflow Factor: East Kowloon
Flow Rate with catchment inflow factor	= 1488.9 m <sup>3</sup> /day
Contributing Population	= 5515 people
Peaking factor	= 5 Refer to Table T-5 of GESF for population 5,000-10,000 incl. stormwater allowance
Peak Flow (without swimming pool)	= 86.2 litre/sec
Peak Flow (with swimming pool)	= <b><u>93.7</u></b> litre/sec

Table 2. Calculation for Sewage Generation Rate of the Existing Surrounding Building (Catchment A)

Catchment A

**1. Career and Kenson Industrial Mansion 金龍工業大廈 (58 Hung To Road, Kwun Tong)**

1a. Assumed Area	=	10714 m <sup>2</sup>
1b. Assumed floor area per employee	=	26.3 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Transport)
1c. Total number of employees	=	407 employees
1d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
1e. Design flow for commercial activities	=	100 litre/employee/day -- (refer to Table T-2 of GESF Job Type J3 - Transport, Storage & Communication)
Sewage generation rate	=	73.3 m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**2. HKI Building 香江國際大廈 (56 Hung To Road, Kwun Tong)**

2a. Assumed Area	=	8500 m <sup>2</sup>
2b. Assumed floor area per employee	=	18.2 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Financial, Insurance, Real Estate & Business Services)
2c. Total number of employees	=	468 employees
2d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
2e. Design flow for commercial activities	=	0 litre/employee/day -- (refer to Table T-2 of GESF Job Type J6 - Finance, Insurance, Real Estate & Business Services)
Sewage generation rate	=	37.4 m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**3. King Wan Industrial Building 景雲工廠大廈 (54 Hung To Road, Kwun Tong)**

3a. Assumed Area	=	6097 m <sup>2</sup>
3b. Assumed floor area per employee	=	26.3 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Transport)
3c. Total number of employees	=	232 employees
3d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
3e. Design flow for commercial activities	=	100 litre/employee/day -- (refer to Table T-2 of GESF Job Type J3 - Transport, Storage & Communication)
Sewage generation rate	=	41.8 m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**4. Bamboos Centre 百本中心 (52 Hung To Road, Kwun Tong)**

4a. Assumed Area	=	12090 m <sup>2</sup>
4b. Assumed floor area per employee	=	18.2 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Financial, Insurance, Real Estate & Business Services)
4c. Total number of employees	=	665 employees
4d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
4e. Design flow for commercial activities	=	0 litre/employee/day -- (refer to Table T-2 of GESF Job Type J6 - Finance, Insurance, Real Estate & Business Services)
Sewage generation rate	=	53.2 m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**5. House of Corona 寶冠大廈 (50 Hung To Road, Kwun Tong)**

5a. Assumed Area	=	7287 m <sup>2</sup>
5b. Assumed floor area per employee	=	18.2 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Financial, Insurance, Real Estate & Business Services)
5c. Total number of employees	=	401 employees
5d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
5e. Design flow for commercial activities	=	0 litre/employee/day -- (refer to Table T-2 of GESF Job Type J6 - Finance, Insurance, Real Estate & Business Services)
Sewage generation rate	=	32.1 m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**6. Mow Hing Factory Building 茂興工業大廈 (205 Wai Yip Street, Kwun Tong)**

6a. Assumed Area	=	7658 m <sup>2</sup>
6b. Assumed floor area per employee	=	26.3 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Transport)
6c. Total number of employees	=	291 employees
6d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
6e. Design flow for commercial activities	=	100 litre/employee/day -- (refer to Table T-2 of GESF Job Type J6 - Finance, Insurance, Real Estate & Business Services)
Sewage generation rate	=	52.4 m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**7. The MOD (207 Wai Yip Street, Kwun Tong)**

7a. Assumed Area	=	16938 m <sup>2</sup>
7b. Assumed floor area per employee	=	18.2 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Transport)
7c. Total number of employees	=	932 employees
7d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
7e. Design flow for commercial activities	=	0 litre/employee/day -- (refer to Table T-2 of GESF Job Type J6 - Finance, Insurance, Real Estate & Business Services)
Sewage generation rate	=	74.6 m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**Sub-total Catchment A**

Flow Rate	=	364.7 m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)
Flow Rate with Catchment Inflow Factor	=	401.1 m <sup>3</sup> /day (refer to Table T-4 of GESF - East Kowloon)
Contributing Population	=	1486 people
Peaking factor	=	6 Refer to Table T-5 of GESF for population 1,000 - 5,000 incl. stormwater allowance
Peak Flow	=	2406.9 m <sup>3</sup> /day

**Total Flow including Proposed Development and Catchment A**

Flow Rate	=	1718.2 m <sup>3</sup> /day
Flow Rate with Catchment Inflow Factor	=	1890.1 m <sup>3</sup> /day (refer to Table T-4 of GESF - East Kowloon)
Contributing Population	=	7000 people
Peaking factor	=	5 Refer to Table T-5 of GESF for population 5,000 - 10,000 incl. stormwater allowance
Peak Flow (without swimming pool)	=	109.4 litre/sec
Peak Flow (with swimming pool)	=	<u>116.9</u> litre/sec

**Table 3. Calculation for Sewage Generation Rate of the Existing Surrounding Building (Catchment B)**

**Catchment B**

**1. GR8 Inno Tech Centre 廣域創科中心 (46 Tsun Yip Street, Kwun Tong)**

1a. Assumed Area	=	7716 m <sup>2</sup>
1b. Assumed floor area per employee	=	18.2 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Financial, Insurance, Real Estate and Business Services)
1c. Total number of employees	=	424 employees
1d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
1e. Design flow for commercial activities	=	0 litre/employee/day -- (refer to Table T-2 of GESF Job Type J6 - Finance, Insurance, Real Estate and Business Services)
1f. Sewage generation rate	=	<b>33.9</b> m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**2. CFC - CATIC Building 航空科技大廈 (44 Tsun Yip Street, Kwun Tong)**

2a. Assumed Area	=	5222 m <sup>2</sup>
2b. Assumed floor area per employee	=	18.2 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Financial, Insurance, Real Estate and Business Services)
2c. Total number of employees	=	287 employees
2d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
2e. Design flow for commercial activities	=	0 litre/employee/day -- (refer to Table T-2 of GESF Job Type J6 - Finance, Insurance, Real Estate and Business Services)
2f. Sewage generation rate	=	<b>23.0</b> m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**Sub-total Catchment B**

Flow Rate	=	56.9 m <sup>3</sup> /day
Flow Rate with Catchment Inflow Factor	=	62.6 m <sup>3</sup> /day (refer to Table T-4 of GESF - East Kowloon)
Contributing Population	=	232 people
Peaking factor	=	8 Refer to Table T-5 of GESF for population <1,000 incl. stormwater allowance
Peak Flow	=	<b>500.5</b> m <sup>3</sup> /day

**Total Flow including Proposed Development and Catchment A+B**

Flow Rate	=	1775.1 m <sup>3</sup> /day
Flow Rate with Catchment Inflow Factor	=	1952.6 m <sup>3</sup> /day (refer to Table T-4 of GESF - East Kowloon)
Contributing Population	=	7232 people
Peaking factor	=	5 Refer to Table T-5 of GESF for population 5,000 - 10,000 incl. stormwater allowance
Peak Flow (without swimming pool)	=	113.0 litre/sec
Peak Flow (with swimming pool)	=	<b><u>120.5</u></b> litre/sec

**Table 4. Calculation for Sewage Generation Rate of the Existing Surrounding Building (Catchment C)**

**Catchment C**

**1. Full Pipe Capacity for all the buildings discharged to FMH4042873**

Manhole Reference	Manhole Reference	Pipe Diameter	Area	Wetted Perimeter	Pipe Length	Invert Level 1	Invert Level 2	$k_s$	R	s	V	Q
		m	m <sup>2</sup>	m	m	mPD	mPD	mm	m		m/s	L/s
FMH4042873	FMH4042874	1.050	0.866	3.299	60.7	-1.08	-1.17	0.3	0.263	0.0015	1.4061	1217.5

**Total Flow including Proposed Development and Catchment A, B and C**

Flow Rate [1]	=	1775.1 m <sup>3</sup> /day
Flow Rate with Catchment Inflow Factor	=	1952.6 m <sup>3</sup> /day (refer to Table T-4 of GESF - East Kowloon)
Contributing Population	=	7232 people
Peaking factor	=	5 Refer to Table T-5 of GESF for population 5,000 - 10,000 incl. stormwater allowance
Peak Flow (without swimming pool) [1]	=	1330.5 litre/sec
Peak Flow (with swimming pool) [1]	=	1338.0 litre/sec

[1] As full pipe capacity is assumed for Catchment C, peaking factor shall not be considered in the calculation. Instead, it shall be added in the Peak Flow directly.

**Table 5. Calculation for Sewage Generation Rate of the Existing Surrounding Building (Catchment D)**

**Catchment D**

**1. Wai Yip Street Substation 偉業街變電站 (199 Wai Yip Street, Kwun Tong)**

1a. Assumed Area	=	1041 m <sup>2</sup>
1b. Total number of employees	=	3 employees (Assumed)
1c. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
1d. Design flow for commercial activities	=	250 litre/employee/day -- (refer to Table T-2 of GESF Job Type J2 - Electricity Gas & Water)
1e. Sewage generation rate	=	<b>0.99</b> m <sup>3</sup> /day

**Sub-total CatchmentD**

Flow Rate	=	1.0 m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)
Flow Rate with Catchment Inflow Factor	=	1.1 m <sup>3</sup> /day (refer to Table T-4 of GESF - East Kowloon)
Contributing Population	=	4 people
Peaking factor	=	8 Refer to Table T-5 of GESF for population <1,000 incl. stormwater allowance
Peak Flow	=	<b>8.7</b> m <sup>3</sup> /day

**Total Flow including Proposed Development and Catchment A+B+C+D**

Flow Rate	=	1776.1 m <sup>3</sup> /day
Flow Rate with Catchment Inflow Factor	=	1953.7 m <sup>3</sup> /day (refer to Table T-4 of GESF - East Kowloon)
Contributing Population	=	7236 people
Peaking factor	=	5 Refer to Table T-5 of GESF for population 5,000 - 10,000 incl. stormwater allowance
Peak Flow (without swimming pool) [1]	=	1330.6 litre/sec
Peak Flow (with swimming pool) [1]	=	<b><u>1338.1</u></b> litre/sec

[1] As full pipe capacity is assumed for Catchment C, peaking factor shall not be considered in the calculation. Instead, it shall be added in the Peak Flow directly.

**Table 6. Calculation for Sewage Generation Rate of the Existing Surrounding Building (Catchment E)**

**Catchment E**

**1. Full Pipe Capacity for all the buildings discharged to FMH4042830**

Manhole Reference	Manhole Reference	Pipe Diameter	Area	Wetted Perimeter	Pipe Length	Invert Level 1	Invert Level 2	$k_s$	R	s	V	Q
		m	m <sup>2</sup>	m	m	mPD	mPD	mm	m		m/s	L/s
FMH4042830	FMH4042876	0.225	0.040	0.707	5.1	1.83	1.52	0.6	0.056	0.0605	3.2314	128.5

**Total Flow including Proposed Development and Catchment A+B+C+D+E**

Flow Rate	=	1776.1 m <sup>3</sup> /day
Flow Rate with Catchment Inflow Factor	=	1953.7 m <sup>3</sup> /day (refer to Table T-4 of GESF - East Kowloon)
Contributing Population	=	7236 people
Peaking factor	=	5 Refer to Table T-5 of GESF for population 5,000 - 10,000 incl. stormwater allowance
Peak Flow (without swimming pool) [1]	=	1459.1 litre/sec
Peak Flow (with swimming pool) [1]	=	<u><b>1466.6</b></u> litre/sec

[1] As full pipe capacity is assumed for Catchment C and E, peaking factor shall not be considered in the calculation. Instead, it shall be added in the Peak Flow directly.

**Table 10. Calculation for Sewage Generation Rate of the Existing Surrounding Building (Catchment F)**

**Catchment F**

**1. Two Harbour Square (180 Wai Yip Street, Kwun Tong)**

1a. Assumed Area	=	53010 m <sup>2</sup>
1b. Assumed floor area per employee	=	18.2 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Financial, Insurance, Real Estate and Business Services)
1c. Total number of employees	=	2916 employees
1d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
1e. Design flow for commercial activities	=	0 litre/employee/day -- (refer to Table T-2 of GESF Job Type J6 - Finance, Insurance, Real Estate and Business Services)
Sewage generation rate	=	<b>233.3</b> m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**2. One Harbour Square (181 Hoi Bun Road, Kwun Tong)**

2a. Assumed Area	=	35855 m <sup>2</sup>
2b. Assumed floor area per employee	=	18.2 m <sup>2</sup> per employee -- (refer to Table 8 of CIFSUS - Financial, Insurance, Real Estate and Business Services)
2c. Total number of employees	=	1972 employees
2d. Design flow for commercial employees	=	80 litre/employee/day -- (refer to Table T-2 of GESF - Commercial Employee)
2e. Design flow for commercial activities	=	0 litre/employee/day -- (refer to Table T-2 of GESF Job Type J6 - Finance, Insurance, Real Estate and Business Services)
Sewage generation rate	=	<b>157.8</b> m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)

**Sub-total Catchment F**

Flow Rate	=	391.0 m <sup>3</sup> /day (With reference to the Approved SIA in the Planning Application A/K14/808)
Flow Rate with Catchment Inflow Factor	=	430.1 m <sup>3</sup> /day (refer to Table T-4 of GESF - East Kowloon)
Contributing Population	=	1593 people
Peaking factor	=	6 Refer to Table T-5 of GESF for population 1,000 - 5,000 incl. stormwater allowance
Peak Flow	=	<b>2580.9</b> m <sup>3</sup> /day

**Total Flow including Proposed Development and Catchment A+B+C+D+E+F**

Flow Rate	=	2167.2 m <sup>3</sup> /day
Flow Rate with Catchment Inflow Factor	=	2383.9 m <sup>3</sup> /day (refer to Table T-4 of GESF - East Kowloon)
Contributing Population	=	8829 people
Peaking factor	=	5 Refer to Table T-5 of GESF for population 5,000 - 10,000 incl. stormwater allowance
Peak Flow (without swimming pool) [1]	=	1484.0 litre/sec
Peak Flow (with swimming pool) [1]	=	<b><u>1491.5</u></b> litre/sec

[1] As full pipe capacity is assumed for Catchment C and E, peaking factor shall not be considered in the calculation. Instead, it shall be added in the Peak Flow directly.



Table 8. Comparison of the Hydraulic Capacity of Existing and Proposed Sewers for Sewerage generated from the Proposed Development and Surrounding Catchment Areas

Manhole Reference	Manhole Reference	Pipe Diameter	Area	Wetted Perimeter	Pipe Length	Invert Level 1	Invert Level 2	k <sub>s</sub>	R	s	V	Q	Estimated Cumulative Peak Flow	Percentage of Pipe Capacity	Status	Remarks
		m	m <sup>2</sup>	m	m	mPD	mPD	mm	m		m/s	L/s	L/s	%		
Terminal Manhole	FMH4043092	0.300	0.071	0.942	3.0	1.57	1.53	0.3	0.075	0.0133	1.97	139.0	93.7	67%	OK	Proposed Sewer: Subject Site
	FMH4043092	0.225	0.040	0.707	4.9	1.53	1.48	6.0	0.056	0.0102	0.91	36.1	116.9	323%	Spill	Subject Site + Catchment A
	FMH4043093	0.225	0.040	0.707	9.0	1.46	1.43	6.0	0.056	0.0033	0.52	20.6	120.5	584%	Spill	Subject Site + Catchment A + Catchment B
	FMH4043094	0.225	0.040	0.707	7.6	1.43	1.37	6.0	0.056	0.0079	0.80	31.7	120.5	380%	Spill	Subject Site + Catchment A + Catchment B
	FMH4043095	0.375	0.110	1.178	5.3	1.28	0.50	0.3	0.094	0.1460	7.56	835.1	120.5	14%	OK	Proposed Sewer: Subject Site + Catchment A + Catchment B
	FMH4042874	1.050	0.866	3.299	23.6	-1.17	-1.21	3.0	0.263	0.0017	1.16	1004.8	1338.0	133%	Spill	Subject Site + Catchment A + Catchment B + Catchment C
	FMH4042875	1.050	0.866	3.299	101.3	-1.21	-1.36	6.0	0.263	0.0015	0.98	848.7	1338.1	158%	Spill	Subject Site + Catchment A + Catchment B + Catchment C + Catchment D
	FMH4042876	1.050	0.866	3.299	37.0	-1.36	-1.41	6.0	0.263	0.0014	0.94	810.5	1491.5	184%	Spill	Subject Site + Catchment A + Catchment B + Catchment C + Catchment D + Catchment E + Catchment F
	FMH4042877	1.050	0.866	3.299	24.0	-1.41	/	6.0	0.263	0.0014	0.94	810.5	1491.5	184%	Spill	Subject Site + Catchment A + Catchment B + Catchment C + Catchment D + Catchment E + Catchment F
	FGJ4003400	1.050	0.866	3.299	2.5	-1.41	/	6.0	0.263	0.0014	0.95	825.2	1491.5	181%	Spill	Subject Site + Catchment A + Catchment B + Catchment C + Catchment D + Catchment E + Catchment F

Remarks: (1) g=gravitational acceleration; k<sub>s</sub>=equivalent sand roughness; s=gradient; v=kinematic viscosity of water; V=mean velocity

(2) Table 2:

For existing pipe, The value of k<sub>s</sub> = 3.0mm is used for the calculation of slimed concrete sewer, poor condition, with velocity flowing half full to be approximately 1.2m/s (based on Table 5: Recommended roughness values in Sewerage Manual); The value of k<sub>s</sub> = 6.0mm is used for the calculation of slimed concrete sewer, poor condition, with velocity flowing half full to be approximately 0.75m/s (based on Table 5: Recommended roughness values in Sewerage Manual)

For proposed pipe, The value of k<sub>s</sub> = 0.3mm is used for the calculation of slimed uPVC sewer, poor condition, with velocity flowing half full to be approximately 1.2m/s (based on Table 5: Recommended roughness values in Sewerage Manual);

(3) The value of velocity (V) is referred to the Tables for the hydraulic design of pipes, sewers and channels (8th edition)

(4) Equation used:

$$V = -2(2gDS)^{0.5} \log \left( \frac{k}{3.7D} + \frac{2.5v}{D(2gDS)^{0.5}} \right)$$

(5) As there is no downstream invert level for the sewers connecting FMH402877 to FGJ4003380, the slopes for the sewers are assumed to follow the sewer FWD4048556. Site surveys shall be conducted in the detail design stage.

Table 9. Comparison of the Hydraulic Capacity of Existing and Proposed Sewers for Sewerage generated from the Proposed Development and Surrounding Catchment Areas

Manhole Reference	Manhole Reference	Pipe Diameter	Area	Wetted Perimeter	Pipe Length	Invert Level 1	Invert Level 2	k <sub>s</sub>	R	s	V	Q	Estimated Cumulative Peak Flow	Percentage of Pipe Capacity	Status	Remarks
		m	m <sup>2</sup>	m	m	mPD	mPD	mm	m		m/s	L/s	L/s	%		
Terminal Manhole	FMH4043092	0.300	0.071	0.942	3.0	1.57	1.53	0.3	0.075	0.0133	1.97	139.0	93.7	67%	OK	Proposed Sewer: Subject Site
	FMH4043092	0.375	0.110	1.178	4.9	1.53	1.48	0.3	0.094	0.0102	1.98	218.6	116.9	53%	OK	Subject Site + Catchment A
	FMH4043093	0.375	0.110	1.178	9.0	1.48	1.37	0.3	0.094	0.0123	2.17	239.5	120.5	50%	OK	Subject Site + Catchment A + Catchment B
	FMH4043094	0.375	0.110	1.178	7.6	1.37	1.28	0.3	0.094	0.0119	2.13	235.5	120.5	51%	OK	Subject Site + Catchment A + Catchment B
	FMH4043095	0.375	0.110	1.178	5.3	1.28	0.50	0.3	0.094	0.1460	7.56	835.1	120.5	14%	OK	Proposed Sewer: Subject Site + Catchment A + Catchment B
	FMH4042874	1.250	1.227	3.927	23.6	-1.17	-1.21	0.3	0.313	0.0017	1.68	2057.8	1338.0	65%	OK	Subject Site + Catchment A + Catchment B + Catchment C
	FMH4042875	1.800	2.545	5.655	101.3	-1.21	-1.36	0.3	0.450	0.0015	1.96	4975.7	1338.1	27%	OK	Subject Site + Catchment A + Catchment B + Catchment C + Catchment D
	FMH4042876	1.800	2.545	5.655	37.0	-1.36	-1.41	0.3	0.450	0.0014	1.87	4748.6	1491.5	31%	OK	Subject Site + Catchment A + Catchment B + Catchment C + Catchment D + Catchment E + Catchment F
	FMH4042877	1.800	2.545	5.655	24.0	-1.41	/	0.3	0.450	0.0014	1.90	4836.0	1491.5	31%	OK	Subject Site + Catchment A + Catchment B + Catchment C + Catchment D + Catchment E + Catchment F
	FGJ4003400	1.800	2.545	5.655	2.5	-1.41	/	0.3	0.450	0.0014	1.90	4836.0	1491.5	31%	OK	Subject Site + Catchment A + Catchment B + Catchment C + Catchment D + Catchment E + Catchment F

- Remarks:
- (1) g=gravitational acceleration; k<sub>s</sub>=equivalent sand roughness; s=gradient; v=kinematic viscosity of water; V=mean velocity
  - (2) Table 2:  
For proposed pipe, The value of ks = 0.3mm is used for the calculation of slimed uPVC sewer, poor condition, with velocity flowing half full to be approximately 1.2m/s (based on Table 5: Recommended roughness values in Sewerage Manual);
  - (3) The value of velocity (V) is referred to the Tables for the hydraulic design of pipes, sewers and channels (8th edition)
  - (4) Equation used: 
$$v = \frac{1.49 R^{2/3}}{k_s} \left( \frac{2.51 v}{D \sqrt{(2gDs)}} \right)^{-0.149}$$
  - (5) As there is no downstream invert level for the sewers connecting FMH402877 to FGJ4003380, the slopes for the sewers are assumed to follow the sewer FWD4048556. Site surveys shall be conducted in the detail design stage.
  - (6) The proposed information for upgrading sewers are in light blue colour.