
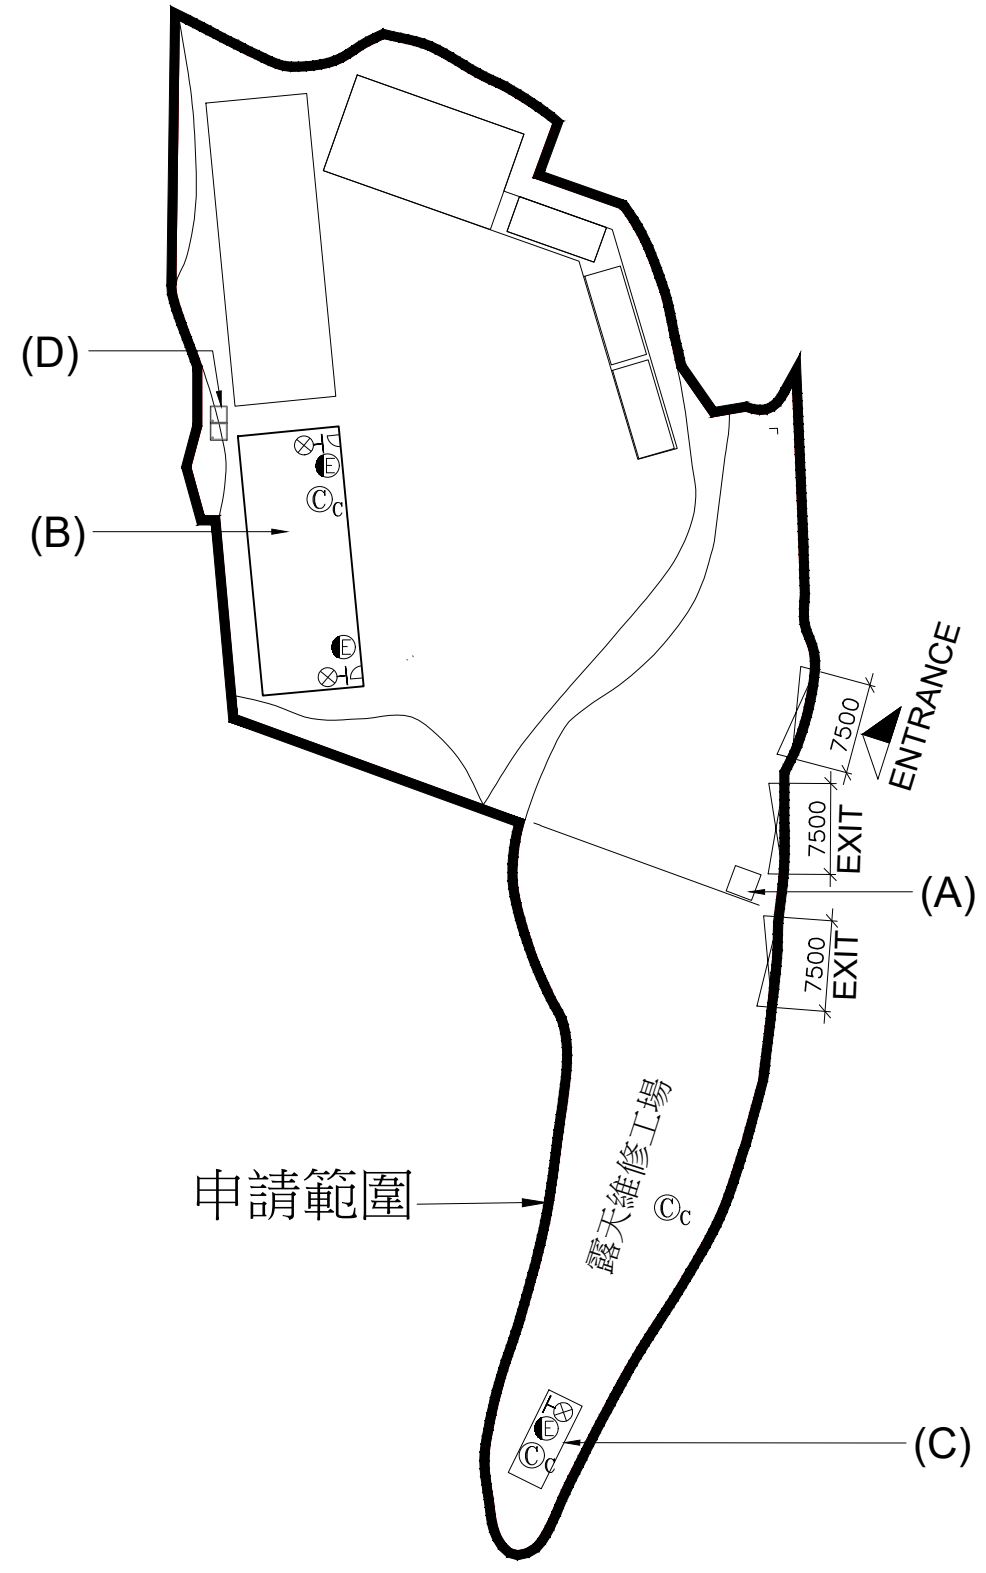


圖示:

	緊急照明燈
	4.5公斤二氧化碳滅火器
	緊急出路指示牌
	申請範圍

A	交通督導員室 (1.8m x1.8m x2.6m高)
B	寫字樓 和 維修工場(6.7x17x5m高)
C	零件貯存倉 (2.44x6.1x2.6m高)
D	流動廁所x2



FIRE SERVICES NOTES

1. PORTABLE FIRE EXTINGUISHERS SHALL BE PROVIDED AS INDICATED ON THE BUILDING PLANS.
2. ALL LININGS FOR ACOUSTIC, THERMAL INSULATION PURPOSES IN DUCTINGS AND CONCEALED LOCATIONS SHALL BE OF CLASS 1 OR CLASS 2 RATE OF SURFACE SPREAD OF FLAME AS PER BRITISH STANDARD 476: PART 7 OR ITS INTERNATIONAL EQUIVALENT, OR BE BROUGHT UP TO THAT STANDARD BY USE OF AN APPROVED FIRE RETARDANT PRODUCT.
3. ALL LINING FOR ACOUSTIC, THERMAL INSULATION PURPOSES WITHIN THE PROTECTED MEANS OF ESCAPE SHALL BE OF CLASS 1 OR CLASS 2 RATE OF SURFACE SPREAD OF FLAME AS PER BRITISH STANDARD 476: PART 7 OR ITS INTERNATIONAL EQUIVALENT, OR BE BROUGHT UP TO THAT STANDARD BY USE OF AN APPROVED RETARDANT PRODUCT.
4. ANY INTENDED STORAGE OR USE OF DANGEROUS GOODS AS DEFINED IN CHAPTER 295 OF THE LAWS OF HONG KONG SHOULD BE NOTIFIED TO THE DIRECTOR OF FIRE SERVICES.
5. EMERGENCY LIGHTING SHALL BE PROVIDED THROUGHOUT THE ENTIRE BUILDING AND ALL EXIT ROUTES LEADING TO GROUND LEVEL AND COMPLIED WITH BS 5266 PART 1:2011 AND BS EN 1838:2013.
6. SECONDARY POWER SUPPLY TO BE CONNECTED BEFORE BUILDING'S MAIN SWITCH.
7. EXIT SIGN SHALL BE PROVIDED AND COMPLIED WITH BS5266 PART 1:2011 & FSD C.L 5/08

M&D
Planning and Construction
Consultant Ltd.
 Tel: 2191 4088 Fax: 3105 0810
 Email: sales@moderneng.com.hk

Project Application
 LOT D.D. 140 PART, 142 PART AND ADJOINING GOVERNMENT LAND IN D.D. 52, FU TEI AU, SHEUNG SHUI, NEW TERRITORIES

TEMPORARY STORAGE CONTAINER /REPAIR YARD WITH ANCILLARY OFFICE FOR A PERIOD OF 3 YEARS

Drawing Title PROPOSED FIRE SERVICE INSTALLATION AND EQUIPMENT PLAN		Notes	
Scale 1:500 (A3)	Revisions -	Copyright Reserved nothing may be reprinted or utilized in any form or by any means without written permission from the M&D.	
Drawn by Arthur	Designed by LW		
Checked by AY	Date 24-SEPT-2024		
Job No. -	Drawing No. P-04	Revisions	Description

Revisions	Description	Date
-----------	-------------	------