



Sectional Plan_HV

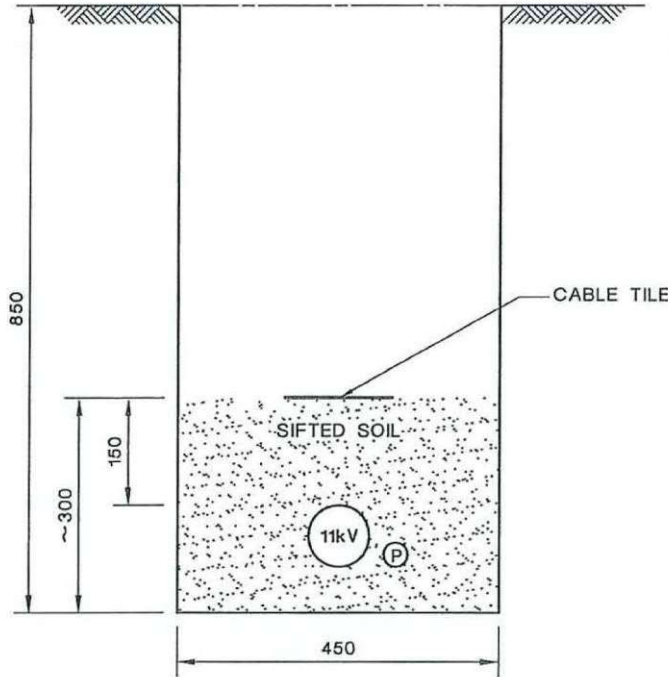

NOTES:

1. ALL SOIL BACKFILLING BENEATH CABLE TILES TO BE SIFTED THROUGH 12mm WIRE MESH.
2. ALL DIMENSIONS ARE IN mm

EXISTING ARRANGEMENT OF 11kV CABLE TRENCH

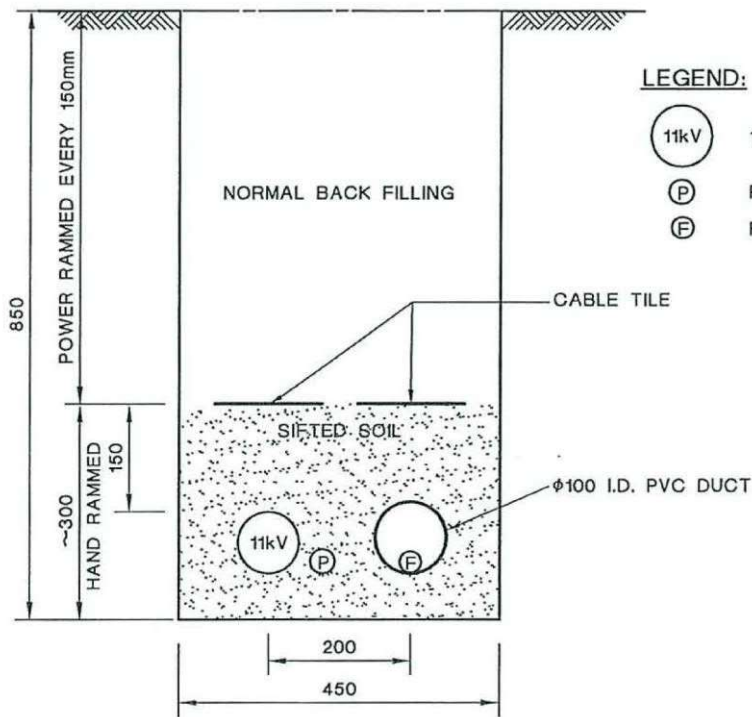

LEGEND:

- 11kV 3/C XLPE POWER CABLE
- PILOT CABLE
- FIBRE OPTIC CABLE

11kV CABLE TRENCH WITH FIBRE OPTIC CABLE IN PVC DUCT

D	GENERAL REVISION	C	NOTE ADDED	A	NO AMENDMENT AFTER REVIEW										
---	------------------	---	------------	---	---------------------------	--	--	--	--	--	--	--	--	--	--



REVS.	15.8.03	4.4.07	18.6.07	28.6.11											
	A	B	C	D	E	F	G	H	J	K	L				
INITIAL	CF.YAM	Y.K.MAN	W.B.LEE	Y.K.MAN											

TITLE :
TYPICAL 11kV CABLE TRENCH WITH PILOT AND FIBRE OPTIC CABLES - TYPE II

DRAWN: K. F. CHEUNG	DATE: 11-4-2000
CHECKED: C. Y. IP	APPROVED: W. B. LEE
SCALE:	SHEET(S) IN SET: 1

PROJECT NO.	CONTRACT NO.
-------------	--------------

ASSET MANAGEMENT	DRG. NO. T	G E N	1 0 5 2 0	D	E 3 3	0 0 0 6	0 1	D	A
-------------------------	------------	-------	-----------	---	-------	---------	-----	---	---