


Proposed Fire Service Installation



Legend :

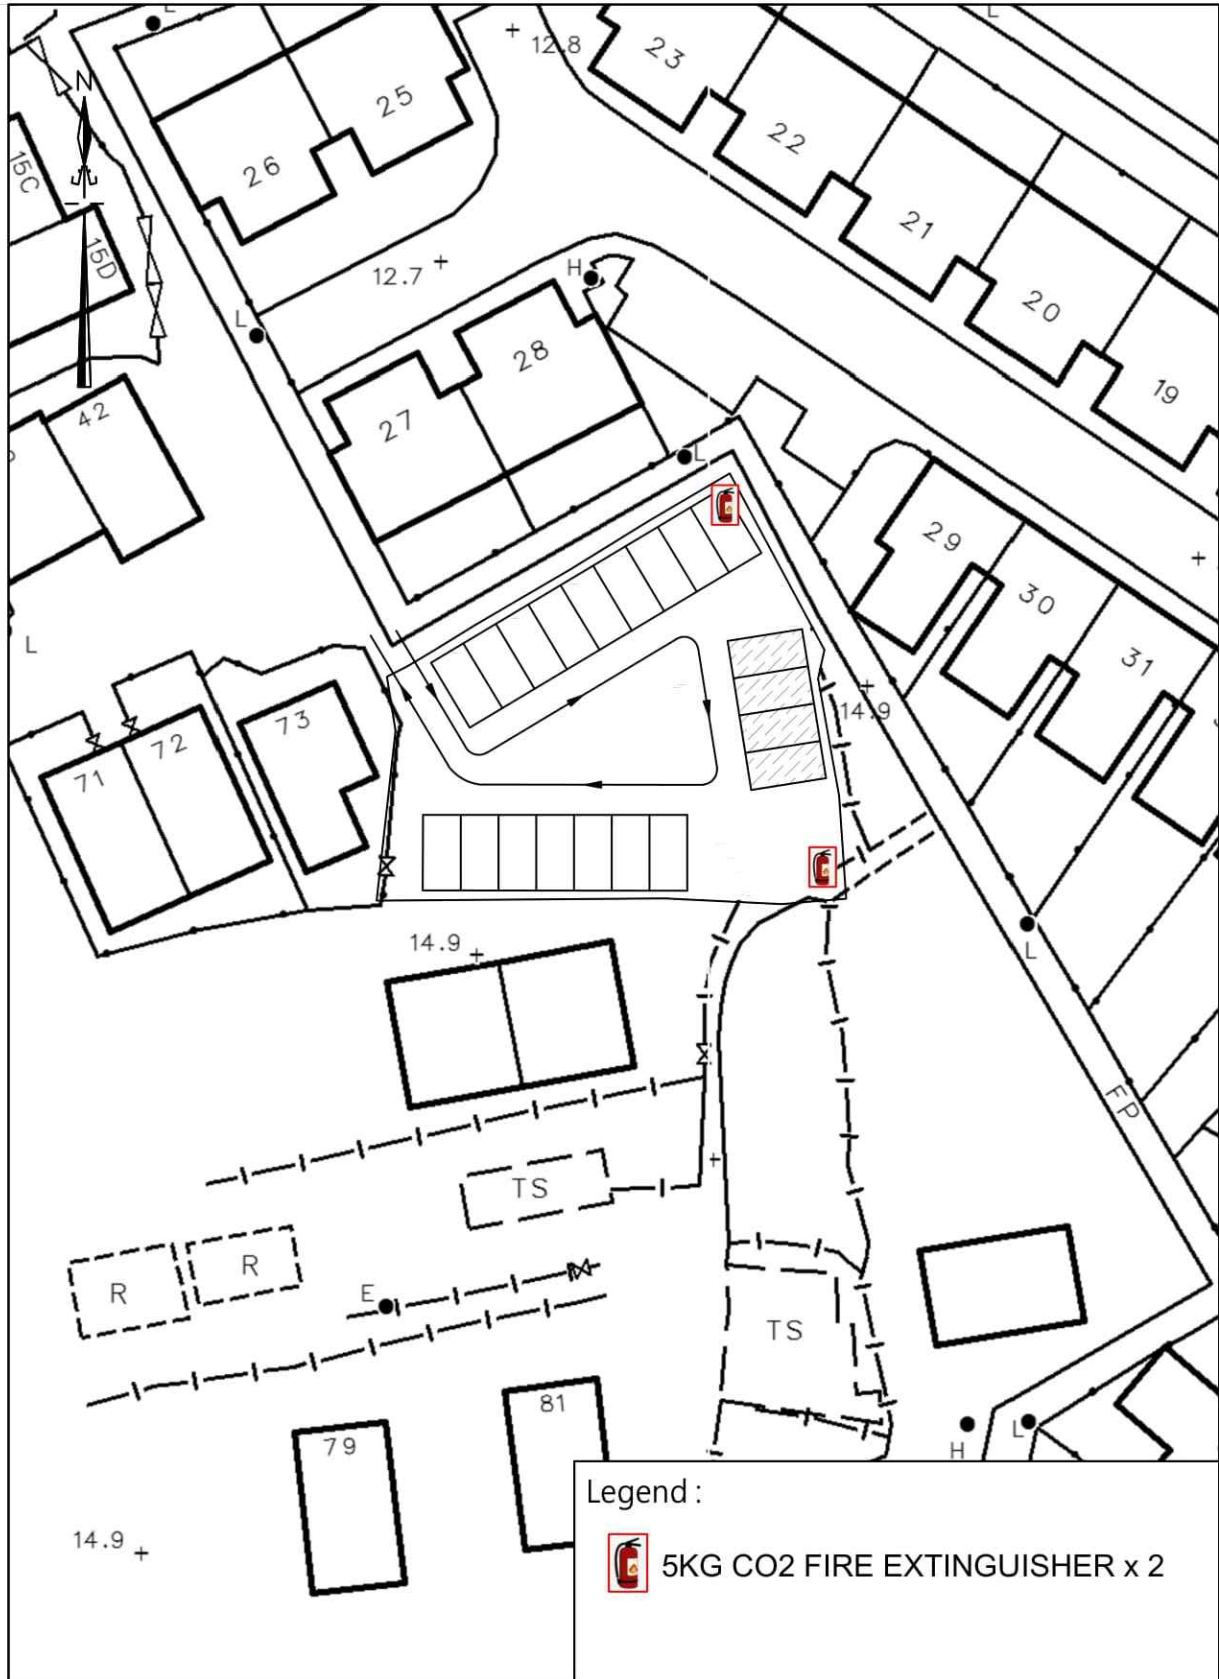

5KG CO2 FIRE EXTINGUISHER x 2

Scale : 1 : 500

Survey Sheet No. : 3-SW-11B
3-SW-12A

Date : January 2025