


AREA NOT WITHIN APPLICATION,
IT IS SHOWN HERE FOR COMPLETENESS

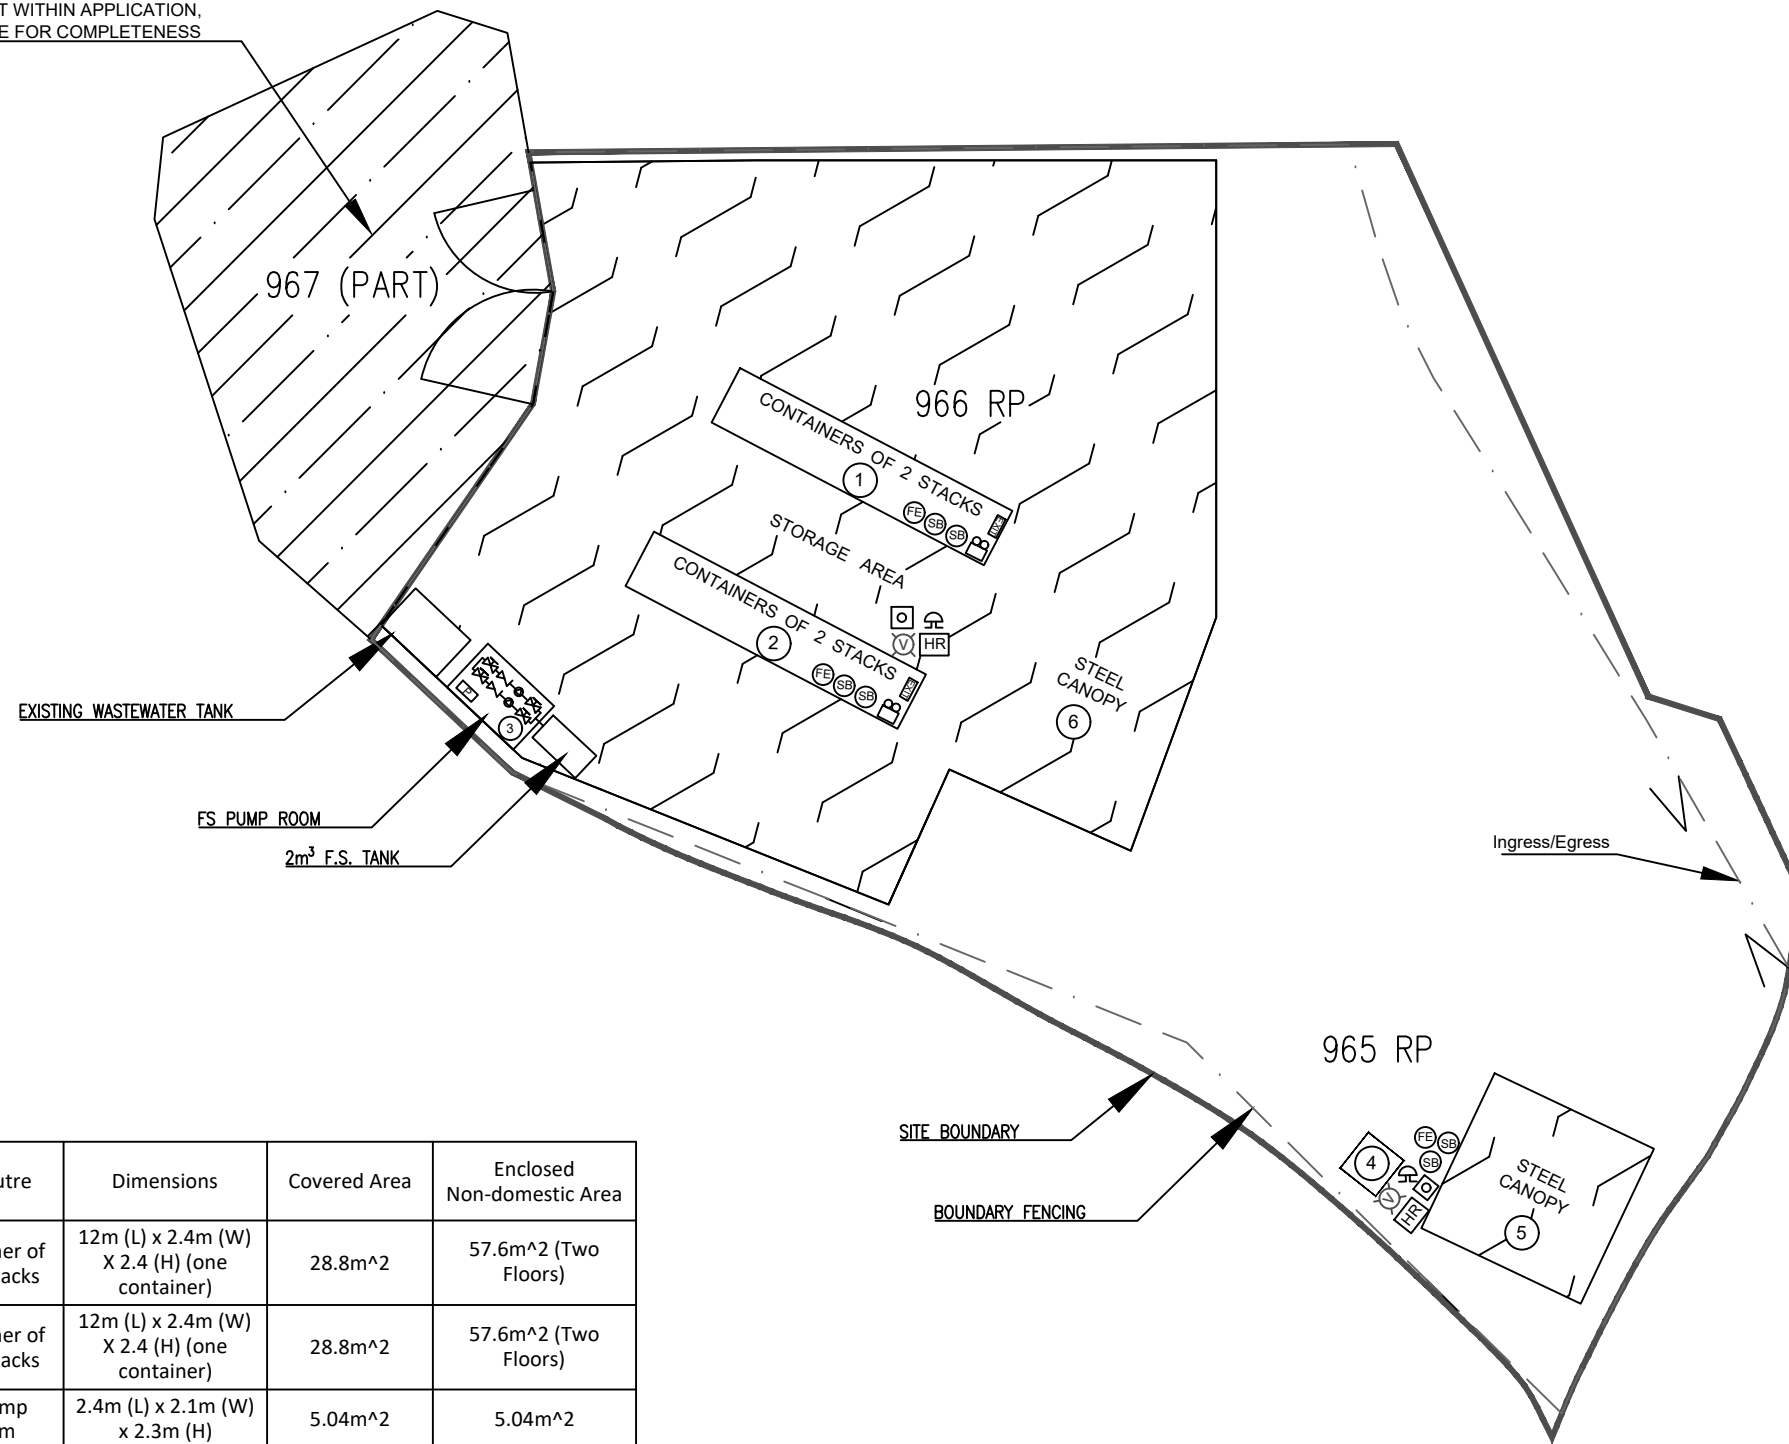

Item	Structure	Dimensions	Covered Area	Enclosed Non-domestic Area
1	Container of Two Stacks	12m (L) x 2.4m (W) X 2.4 (H) (one container)	28.8m ²	57.6m ² (Two Floors)
2	Container of Two Stacks	12m (L) x 2.4m (W) X 2.4 (H) (one container)	28.8m ²	57.6m ² (Two Floors)
3	FS Pump Room	2.4m (L) x 2.1m (W) x 2.3m (H)	5.04m ²	5.04m ²
4	Switch Room	1.8 (L) x 1.8(W) x 2.6m (H)	3.24m ²	3.24m ²
5	Unused Open Space with Canopy	6.8 (L) X 7m (W) (Headroom Around 4.4m)	47.6m ²	47.6m ²
6	Open Storage Area with Canopy	Headroom Around 5m	516m ² (measured programatically)	744-(28.8*2+5.04) = 681m ²

F.S. Note

(a) Sufficient Emergency lighting shall be provided throughout the entire buildings in accordance with BS5266: Part 1 and BS EN 1838.

(b) Sufficient directional and Exit sign shall be provided in accordance with BS 5266: Part 1 and FSD Circular Letter 5/2008.

(c) Fire alarm system shall be provided throughout the entire building in accordance with BS 5839: Part 1 : 1988 and FSD Circular Letter 1 / 2002. One actuation point and one audio warning device to be located at each hose reel point. This actuation point should include facilities for fire pump start and audio/ visual warning device initiation.

(d) A modified hose reel system supplied by a 2 cubic meter FS water tank shall be provided. There shall be sufficient hose reels to ensure that every part of each building can be reached by a length of not more than 30m of hose reel tubing. The FS water tank, pump room and hose reel shall be clearly marked on plans.

(e) Portable hand-operated approved appliances shall be provided as required by occupancy and shall be clearly indicated on plans.

LEGEND

HR	HOSE REEL SET
□	BREAK GLASS
⊞	ALARM BELL
⊘	FLASH LIGHT
⊞	EMERGENCY LIGHT
EXIT	EXIT SIGN
⊙	F.S. PUMP
⊞	GATE VALVE
⊞	CHECK VALVE
P	CONTROL PANEL
⊙	5KG CO ₂ F.E.
⊙	Sand Bucket

B.D. Ref.No.	
F.S.D.Ref.No.	
U.S.D.Ref.No.	

A	10SEP2018	Added Extinguisher Amended FS Tank Capacity
---	-----------	---

Rev.	Date	Description
CLIENT		

ALL MEASUREMENT MUST BE CHECKED AT THE SITE - DO NOT SCALE DRAWING - ALL DRAWING SPECIFICATIONS AND THEIR COPYRIGHT ARE THE PROPERTY OF ENGINEERS, ARCHITECTS, DESIGNERS, AND SHALL BE RETURNED AT THE COMPLETION OF THE WORK - THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS EXPRESSEDLY CERTIFIED.

SIGNATURE FOR SUBMISSION

POTTON ILA ARCHITECTS LTD.
李兆民建築師有限公司

PROJECT NO.	
SCALE	1:300

2018 Sept 4

Project Title
Temporary Open Storage of Waste Paper, Waste Plastics and Waste Metal Cans for Recycling and Workshop for Recycling for a Period of 3 Years in "Agriculture" Zone in Lots 965 RP (Part) and 966 RP in D.D. 82, Ping Che Road, Ping Che, New Territories
Ref.: TPB/A/NE-TKL/564

Drawing Title
F.S. Layout Plan

Drawing No.	Rev.
-------------	------

FS-01 A