


AREA NOT WITHIN APPLICATION,
IT IS SHOWN HERE FOR COMPLETENESS

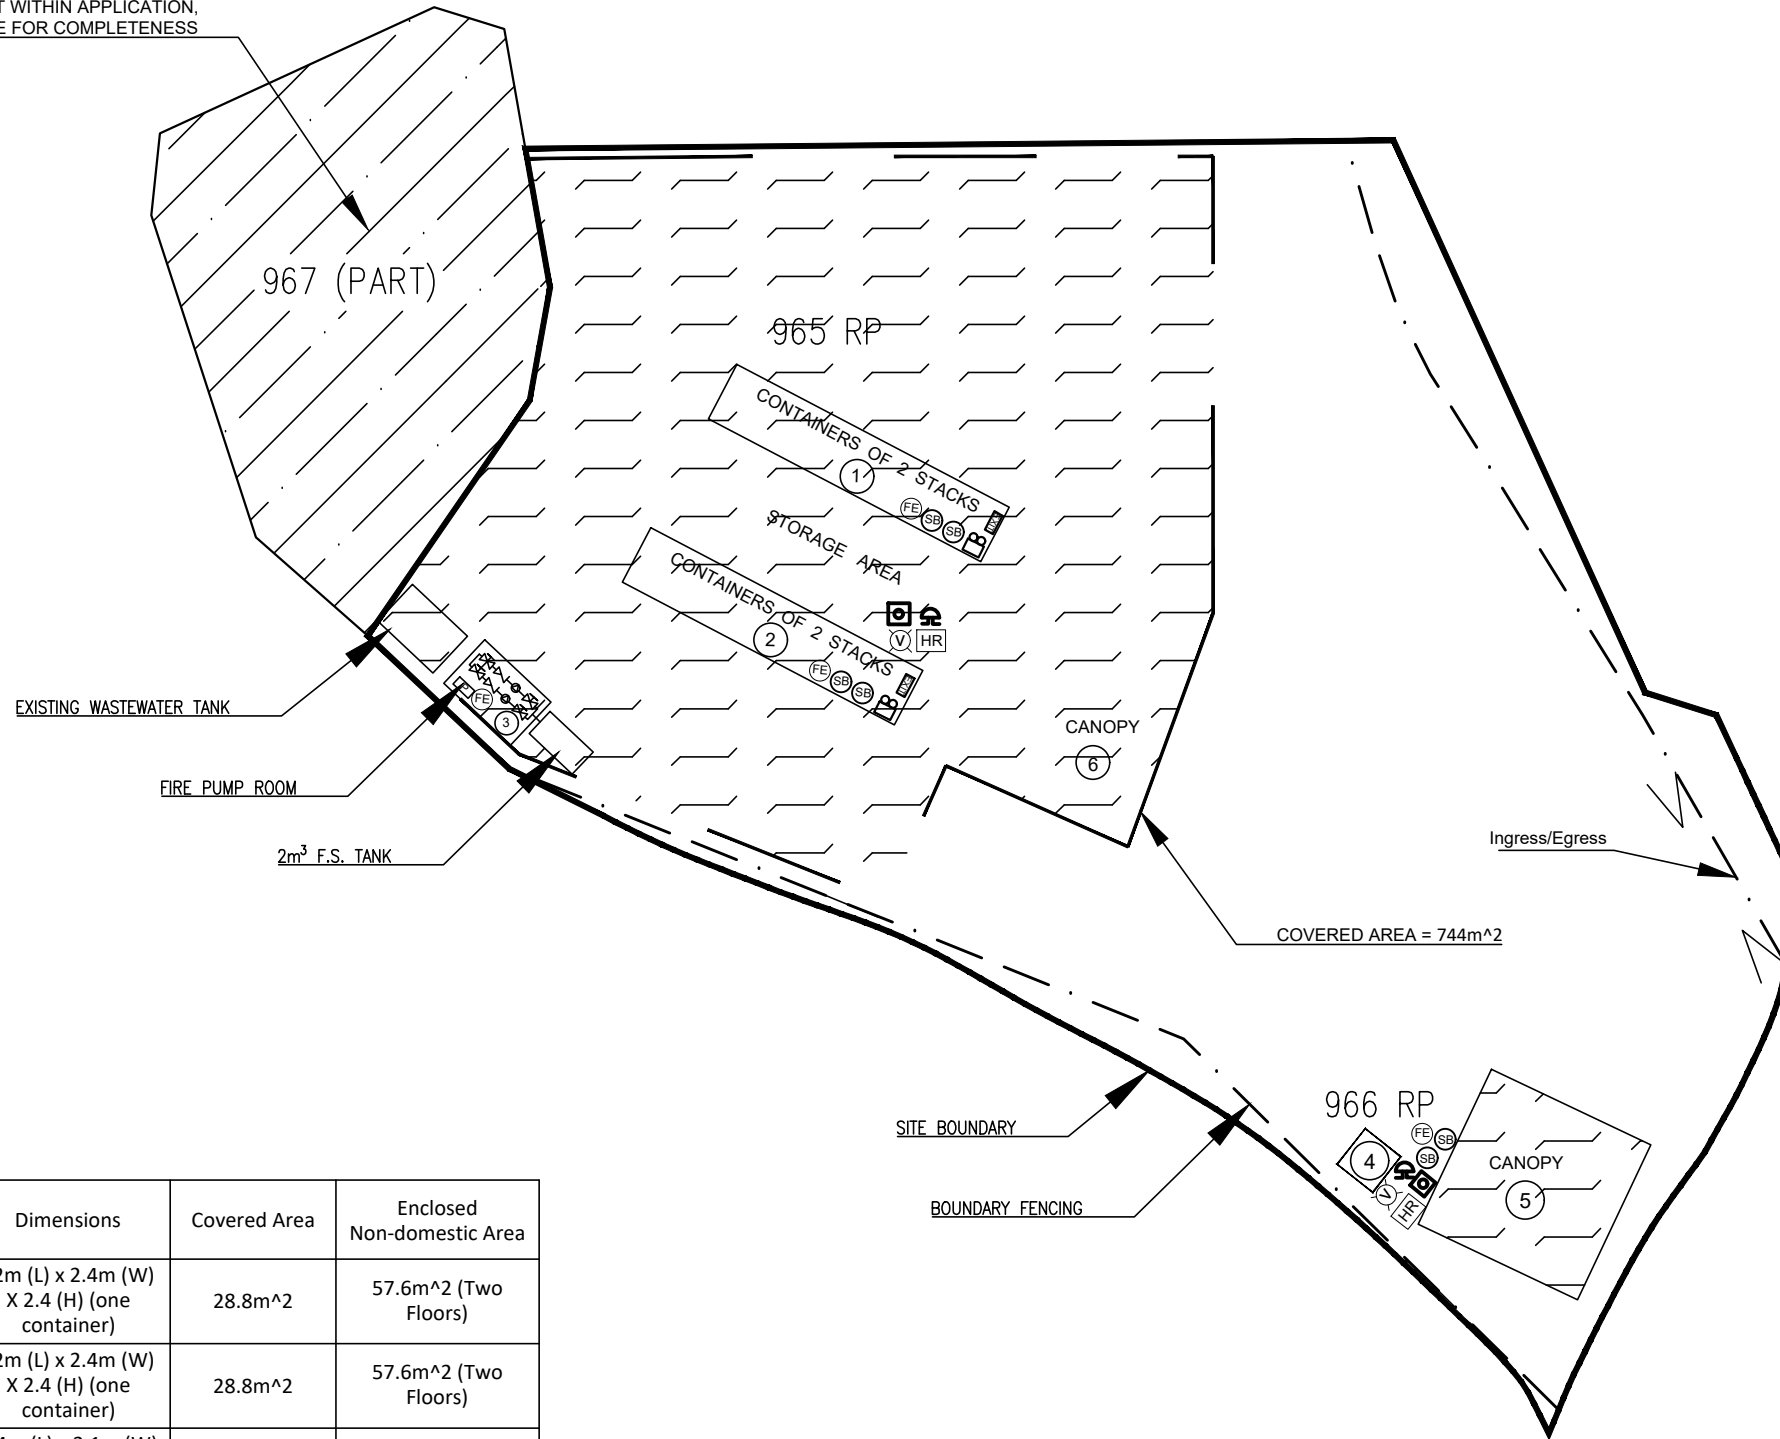

F.S. Note

- (a) Sufficient Emergency lighting shall be provided throughout the entire buildings in accordance with BS5266: Part 1 and BS EN 1838.
- (b) Sufficient directional and Exit sign shall be provided in accordance with BS 5266: Part 1 and FSD Circular Letter 5/2008.
- (c) Fire alarm system shall be provided throughout the entire building in accordance with BS 5839: Part 1: 2002 + A2: 2008 and FSD Circular Letter No. 1/2009. One actuation point and one audio warning device to be located at each hose reel point. This actuation point should include facilities for fire pump start and audio/visual warning device initiation.
- (d) A modified hose reel system supplied by a 2 cubic meter FS water tank shall be provided. There shall be sufficient hose reels to ensure that every part of each building can be reached by a length of not more than 30m of hose reel tubing. The FS water tank, pump room and hose reel shall be clearly marked on plans.
- (e) Portable hand-operated approved appliances shall be provided as required by occupancy and shall be clearly indicated on plans.
- (f) Secondary power supply for FSI will be provided (with the pump system fed before the main switch and the fire alarm fed by a 5A battery from charger panel).

LEGEND

| | |
|-----------|--------------------------|
| HR | HOSE REEL SET |
| BG | BREAK GLASS |
| AB | ALARM BELL |
| FL | FLASH LIGHT |
| EL | EMERGENCY LIGHT |
| EXIT | EXIT SIGN |
| F.S. PUMP | F.S. PUMP |
| GV | GATE VALVE |
| CV | CHECK VALVE |
| CP | CONTROL PANEL |
| FE | 5KG CO ₂ F.E. |
| SB | Sand Bucket |

| Item | Structure | Dimensions | Covered Area | Enclosed Non-domestic Area |
|------|--------------------------------------|--|--|--|
| 1 | Container of Two Stacks | 12m (L) x 2.4m (W) X 2.4 (H) (one container) | 28.8m ² | 57.6m ² (Two Floors) |
| 2 | Container of Two Stacks | 12m (L) x 2.4m (W) X 2.4 (H) (one container) | 28.8m ² | 57.6m ² (Two Floors) |
| 3 | Fire Pump Room | 2.4m (L) x 2.1m (W) x 2.3m (H) | 5.04m ² | 5.04m ² |
| 4 | Electricity Meter Room | 1.8 (L) x 1.8(W) x 2.6m (H) | 3.24m ² | 3.24m ² |
| 5 | Unused space with Canopy | 6.8 (L) X 7m (W) (Headroom Around 4.4m) | 47.6m ² | 47.6m ² |
| 6 | 4-side Open Storage Area with Canopy | Headroom Around 5m | 744m ² (measured programatically) | 744-(28.8*2+5.04) = 681.36m ² |

| | |
|---------------|--|
| B.D. Ref.No. | |
| F.S.D.Ref.No. | |
| U.S.D.Ref.No. | |

| | | |
|---|-----------|---|
| A | 10SEP2018 | Added Extinguisher Amended FS Tank Capacity |
| B | 24MAY2021 | Table and FS Notes Updated |
| C | 25JUN2021 | FS Notes Updated |
| D | 28Dec2021 | Added Extinguisher |

| Rev. | Date | Description |
|--------|------|-------------|
| CLIENT | | |

ALL MEASUREMENT MUST BE CHECKED AT THE SITE - DO NOT SCALE DRAWING - ALL DRAWING SPECIFICATIONS AND THEIR COPYRIGHT ARE THE PROPERTY OF ENGINEERS, ARCHITECTS, DESIGNERS, AND SHALL BE RETURNED AT THE COMPLETION OF THE WORK - THIS DRAWING IS NOT VALID FOR CONSTRUCTION PURPOSES UNLESS EXPRESSEDLY CERTIFIED.

SIGNATURE FOR SUBMISSION

FOTTON ELA ARCHITECTS LTD.
李兆民建築師有限公司

| | |
|-------------|-------|
| PROJECT NO. | |
| SCALE | 1:300 |

Project Title
Temporary Open Storage of Waste Paper, Waste Plastics and Waste Metal Cans for Recycling and Workshop for Recycling for a Period of 3 Years in "Agriculture" Zone in Lots 965 RP (Part) and 966 RP in D.D. 82, Ping Che Road, Ping Che, New Territories
Ref: TPB/A/NE-TKU/564

Drawing Title
F.S. Layout Plan

| | |
|-------------|------|
| Drawing No. | Rev. |
|-------------|------|

FS-01 D