




Appendix 3

Fire Service Installations Proposal

F.S. NOTES :

- 1 SUFFICIENT EMERGENCY LIGHTING SHALL BE PROVIDED THROUGHOUT THE ENTIRE BUILDING IN ACCORDANCE WITH BS 5266 - 1 : 2016, BS EN 1838 : 2013 AND THE FSD CIRCULAR LETTER NO. 4/2021.
- 2 SUFFICIENT ALL EXIT SIGNS/DIRECTIONAL EXIT SIGNS SHALL BE PROVIDED IN ACCORDANCE WITH BS 5266 : PART 1 AND FSD CIRCULAR LETTER NO. 5/2008,
- 3 PORTABLE FIRE FIGHTING APPLIANCES SHALL BE PROVIDED AT POSITIONS AS INDICATED ON LAYOUT PLAN. IN ACCORDING TO CODES OF PRACTICE FOR MINIMUM FIRE SERVICES INSTALLATIONS AND EQUIPMENT.
- 4 BETWEEN THE WAREHOUSE WITH 2.4M METER WIDE UNCOVERED AISLE

LEGEND

-  5KG CO2 FIRE EXTINGUISHER
-  EMERGENCY LIGHT
-  EXIT SIGN

Area for Open Storage of Construction Materials


Pedestrian Access (1m)

Warehouse for Storage of Construction Materials (225m², 1-storey, Height: 12m)

INGRESS / EGRESS 8 m (ABOUT)(W)

Mobile Toilet (2m², 1-storey, Height: 2.5m)

Warehouse for Storage of Construction Materials (225m², 1-storey, Height: 12m)

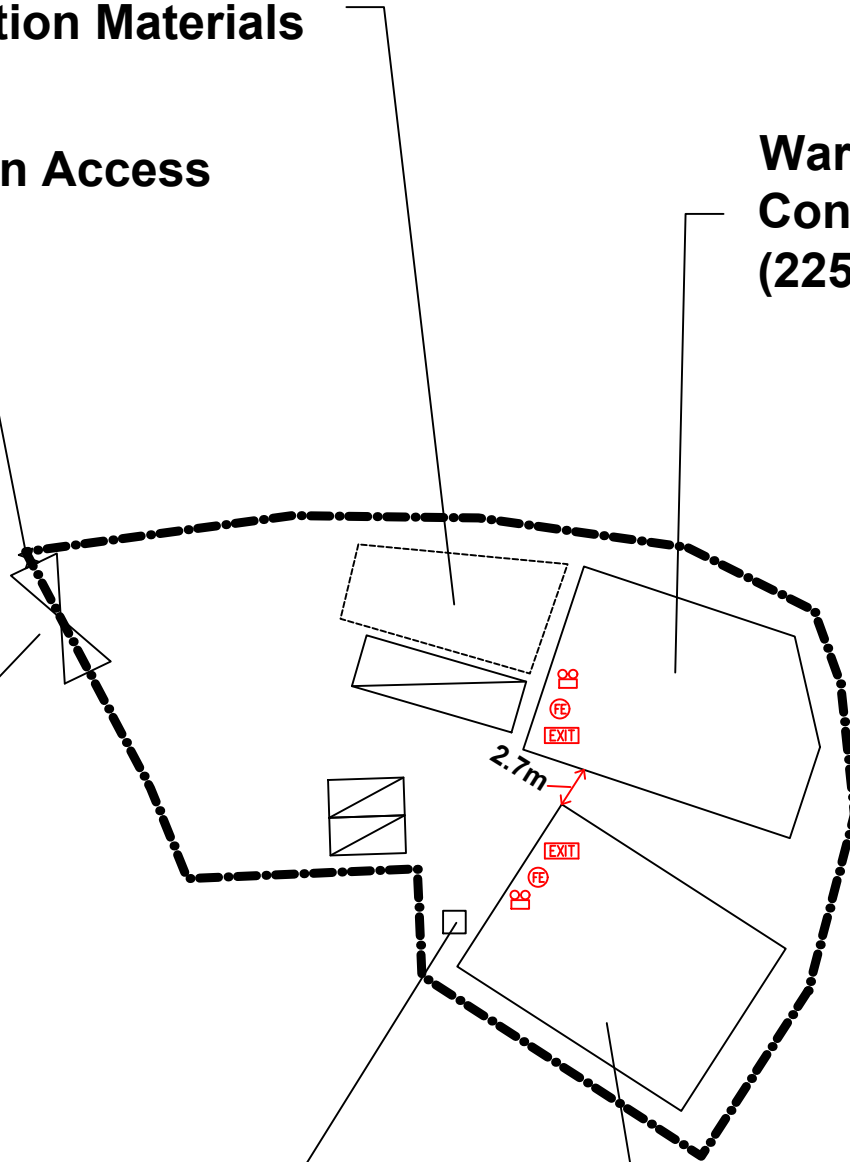

PROJECT : Proposed Temporary Warehouse and Open Storage for Storage of Construction Materials, Vehicle Parts and Mobile Toilets for a Period of 3 Years at Lots 128 SA & 128 SBRP in DD 84	DRAWING TITLE :		ARCHITECT :	CONSULTANT :	FIRE SERVICE CONTRACTOR :	NAME	DATE	DRAWING NO :	REV.
	F.S. Notes, Legend, Fire Service Installation Layout Plan				Century Fire Service Engineering Co., Ltd.	C.K.NG	21 Oct 2024	FS-01	0
	REV	DESCRIPTION	DATE			CHECKED BY		SCALE : 1:500 @ A3	
						APPROVED BY		SOURCE : B.O.O. Ref. BD F.S.D. Ref. FP	