

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

消防 (裝置及設備) 規例

(Regulation 9(1))

(第九條(1)款)

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

FSD Ref.: FP/NT/E 6/85605  
消防處檔號

Serial Number

30536 301376

Name of Client 顧客姓名

MATCHESHOUSE

Address 地址

Ground Floor, and The Outside Seating Accommodation at Shop Front, No. 47F, Tai Mei Tuk Village, Tai Po, NT



Type of Building 樓宇類型:  Industrial 工業  Commercial 商業  Domestic 住宅  Composite 綜合  Licensed premises 持牌處所  Institutional 社團

Part 1 Annual Maintenance ONLY  
第一部 只適用於年檢事項

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
24	1 x 5kg CO <sup>2</sup> Gas type extinguisher	Ground Floor,	Conforms with FSD Requirements	05/02/2024	04/02/2025
24	1 x 9lt CO <sup>2</sup> / Water type extinguisher	Ground Floor,	Conforms with FSD Requirements	05/02/2024	04/02/2025

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗, 證明性能良好, 符合消防處處長不時公佈的最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或處所當眼處以供消防處人員查核

This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

Authorized Signature: 受權人簽署

Name: 姓名

Wong Wai Shan, Anita

FSD/RC No.: 消防處註冊號碼

RC3 / 0536 RC /

Company Name: 公司名稱

Wong Wai Shan, Anita

Telephone: 聯絡電話

Date: 日期

05/02/2024

For FSD use only

Inspected

Key-in

Verified



Serial Number

30536301376






Name of Client 顧客姓名

MATCHESHOUSE

**Part 1 Annual Maintenance ONLY**  
**第一部 只適用於年檢事項**

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
24	1 x 9lt CO <sup>2</sup> / Water type extinguisher	OSA, Ground Floor,	Conforms with FSD Requirements	05/02/2024	04/02/2025
25	1 x Fire Blanket	Ground Floor,	Conforms with FSD Requirements	05/02/2024	04/02/2025

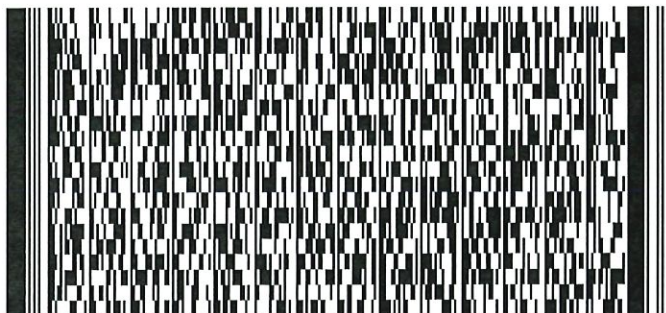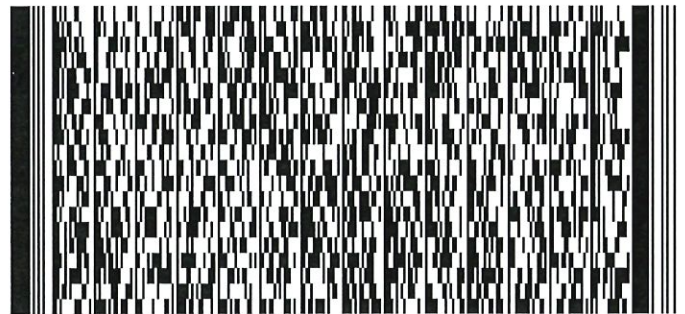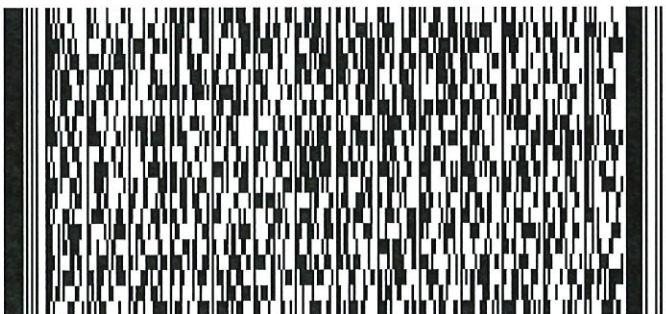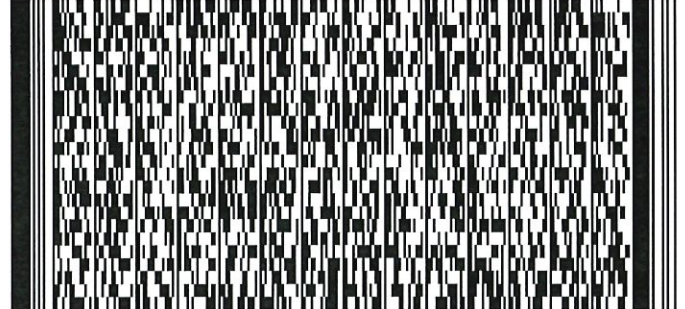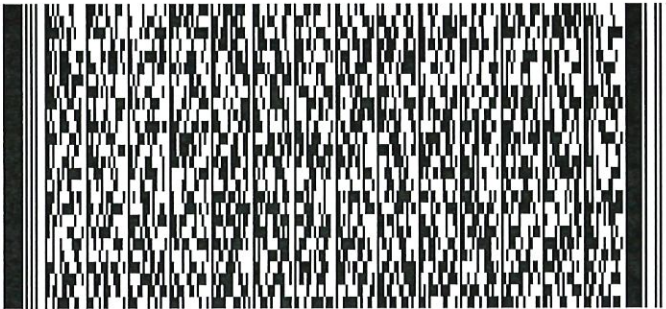

FIRE SERVICE (INSTALLATIONS AND EQUIPMENT) REGULATIONS

消防 (裝置及設備) 規例

(Regulation 9(1))

(第九條(1)款)

CERTIFICATE OF FIRE SERVICE INSTALLATION AND EQUIPMENT

消防裝置及設備證書

FSD Ref.: FP/NT/E 6/85605  
消防處檔號

Serial Number  
20287 302029

Name of Client 顧客姓名

MATCHESHOUSE

Address 地址

Ground Floor, and The Outside Seating Accommodation at Shop Front, No. 47F, Tai Mei Tuk Village, Tai Po, NT



Type of Building 樓宇類型:  Industrial 工業  Commercial 商業  Domestic 住宅  Composite 綜合  Licensed premises 持牌處所  Institutional 社團

**Part 1 Annual Maintenance ONLY**  
第一部 只適用於年檢事項

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
11	4 x Emergency Lighting	Ground Floor,	Conforms with FSD Requirements	05/02/2024	04/02/2025
12	2 x Exit Signs	Ground Floor,	Conforms with FSD Requirements	05/02/2024	04/02/2025

Part 2 第二部 Installation / Modification / Repair / Inspection works 裝置/改裝/修理/檢查工作

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Nature of Work Carried out 完成之工作內容	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)

Part 3 第三部 Defects 損壞事項

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Outstanding Defects 未修缺點	Comment on Defects 缺點評述

Remark 備註

I/We hereby certify that the above installations/equipment have been tested and found to be in efficient working order in accordance with the Codes of Practice for Minimum Fire Service Installations and Equipment and Inspection, Testing and Maintenance of Installations and Equipment published from time to time by the Director of Fire Services. Defects are listed in Part 3.

本人藉此證明以上之消防裝置及設備經試驗, 證明性能良好, 符合消防處處長不時公佈之最低限度之消防裝置及設備守則與裝置及設備之檢查測試及保養守則的規格, 損壞事項列於第三部。

如證書涉及年檢事項, 應張貼於大廈或處所當眼處以供消防處人員查核  
This certificate should be displayed at prominent location of the building or premises for FSD's inspection if any annual maintenance work is involved.

Authorized Signature:

受權人簽署

*Wong Wai Cheuk*

Name:

姓名

WONG Wai Cheuk

FSD/RC No.:

消防處註冊號碼

RC2 / 0287 RC /

Company Name:

公司名稱

Hip Cheung Engineering Co.

Telephone:

聯絡電話

[Redacted]

Date:

日期

05/02/2024



Inspected

Key-in

Verified



Serial Number

20287 302029






Name of Client 顧客姓名

MATCHESHOUSE

**Part 1 Annual Maintenance ONLY**  
**第一部 只適用於年檢事項**

In accordance with Regulation 8(b) of the Fire Service (Installations and Equipment) Regulations, the owner of any fire service installation or equipment which is installed in any premises shall have such fire service installation or equipment inspected by a registered contractor at least once in every 12 months. 根據消防(裝置及設備)規例第八條(b)款, 擁有裝置在任何處所內的任何消防裝置或設備的人, 須每12個月由一名註冊承辦商檢查該等消防裝置或設備至少一次。

Code 編碼 (1-35)	Type of FSI 裝置類型	Location(s)位置	Comment on Condition 狀況評述	Completion Date 完成日期 (DD/MM/YYYY)	Next Due Date 下次到期日 (DD/MM/YYYY)
13	Manual Fire Alarm System	Ground Floor,	Conforms with FSD Requirements	05/02/2024	04/02/2025

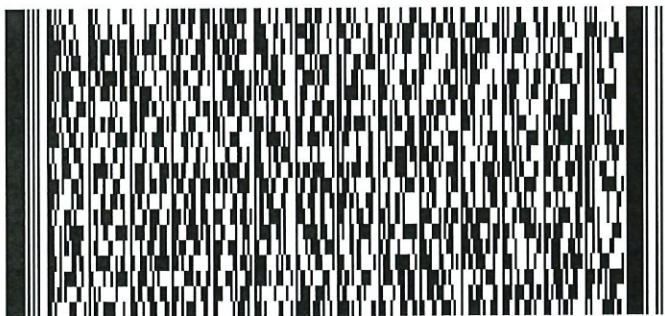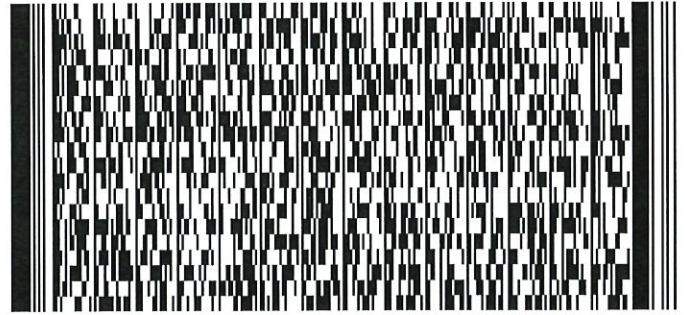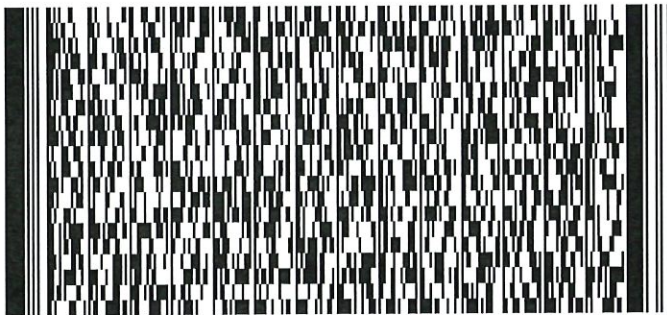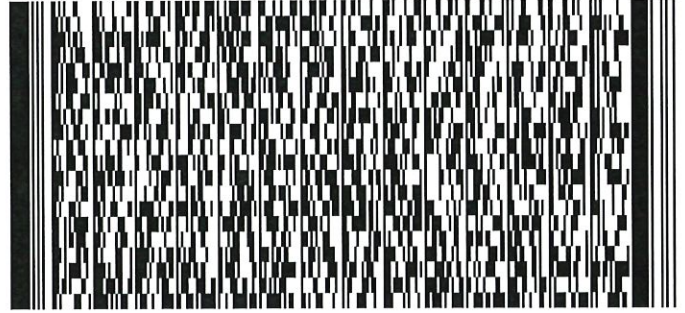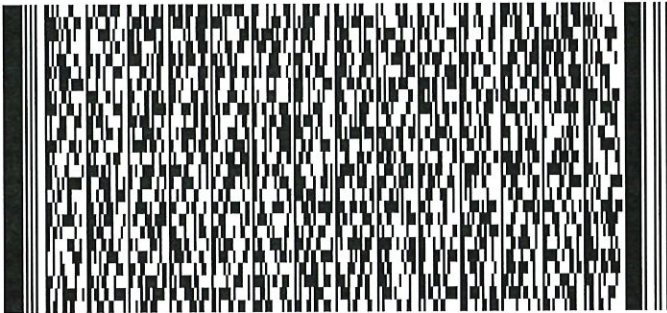

Serial Number

20287 302029

Name of Client 顧客姓名

MATCHESHOUSE

