


寄件者: Tommy Wong [REDACTED]
寄件日期: 2024年04月09日星期二 17:26
收件者: tpbpd/PLAND
副本: [REDACTED]
主旨: Submission of S16-1 form's supplementary for WELT2022-0170-03H
附件: supplementary for No. S.16-I_9 Apr 2024.pdf
類別: Application, Internet Email

Dear Town Planning Board,

We would like to submit the supplementary document including the updated land excavation detail (page 6) and related drawing for your approval. The scope of the work is power supply to the landowner of DD328 Lot 889A for agricultural purpose and the overall height of the poles is around 9.3m each. Please remind that all of area of excavation work will be backfilled after the completion of work.

Best Regards,
Tommy Wong

Tommy Wong
Assistant Engineer
[REDACTED]

F: +852 2325 2500 W: <https://hargreaves.asia/>
Hargreaves Power Services (HK) Ltd | Suites 1307-1309, One Citygate | 20 Tat Tung Road | Tung Chung, Lantau | Hong Kong | 




WARNING!

This email, including any attachments, is confidential and may be legally privileged. If it is received by mistake please notify the sender and delete from your system - do not read or copy it or disclose its contents to anyone. Any liability (in negligence or otherwise) arising from any third party relying on this email is excluded. Emails are not secure and cannot be guaranteed to be free of errors or viruses. It is your responsibility to scan emails and attachments for viruses before opening them. Hargreaves Services plc (and its group companies) accepts no liability for any damage caused by any virus transmitted by this email. No responsibility is accepted by Hargreaves Services plc (or any member of its group) for emails unconnected with our business. Messages may be monitored for compliance purposes and to protect our business. Any views or opinions expressed in emails are solely those of the author and do not necessarily represent those of our business.

Registered office: West Terrace, Esh Winning, Durham, DH7 9PT

(ii) For Type (ii) application 供第(ii)類申請	
(a) Operation involved 涉及工程	<input type="checkbox"/> Diversion of stream 河道改道 <input type="checkbox"/> Filling of pond 填塘 Area of filling 填塘面積 sq.m 平方米 <input type="checkbox"/> About 約 Depth of filling 填塘深度 m 米 <input type="checkbox"/> About 約 <input type="checkbox"/> Filling of land 填土 Area of filling 填土面積 sq.m 平方米 <input type="checkbox"/> About 約 Depth of filling 填土厚度 m 米 <input type="checkbox"/> About 約 <input checked="" type="checkbox"/> Excavation of land 挖土 Pole:1m(L)x1m(W)x5 Area of excavation 挖土面積 sq.m 平方米 <input type="checkbox"/> About 約 Stay:1m(L)x1m(W)x10 Depth of excavation 挖土深度 Pole:1.8m(D)x5 <input type="checkbox"/> About 約 Stay:1.5m(D)x10 (Please indicate on site plan the boundary of concerned land/pond(s), and particulars of stream diversion, the extent of filling of land/pond(s) and/or excavation of land) (請用圖則顯示有關土地/池塘界線，以及河道改道、填塘、填土及/或挖土的細節及/或範圍))
(b) Intended use/development 有意進行的用途/發展	Public Utility installation (Pole,stay and overhead line erection & land excavation and refilling work)

(iii) For Type (iii) application 供第(iii)類申請													
(a) Nature and scale 性質及規模	<input checked="" type="checkbox"/> Public utility installation 公用事業設施裝置 <input type="checkbox"/> Utility installation for private project 私人發展計劃的公用設施裝置 Please specify the type and number of utility to be provided as well as the dimensions of each building/structure, where appropriate 請註明有關裝置的性質及數量，包括每座建築物/構築物(倘有)的長度、高度和闊度												
	<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th style="width: 30%;">Name/type of installation 裝置名稱/種類</th> <th style="width: 20%;">Number of provision 數量</th> <th style="width: 50%;">Dimension of each installation /building/structure (m) (LxWxH) 每個裝置/建築物/構築物的尺寸(米)(長x闊x高)</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">Stay Erection</td> <td style="text-align: center;">10</td> <td style="text-align: center;">size of excavation: 1m x 1m x 1.5m</td> </tr> <tr> <td style="text-align: center;">Pole of Erection</td> <td style="text-align: center;">5</td> <td style="text-align: center;">size of excavation: 1m x 1m x 1.8m</td> </tr> <tr> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>	Name/type of installation 裝置名稱/種類	Number of provision 數量	Dimension of each installation /building/structure (m) (LxWxH) 每個裝置/建築物/構築物的尺寸(米)(長x闊x高)	Stay Erection	10	size of excavation: 1m x 1m x 1.5m	Pole of Erection	5	size of excavation: 1m x 1m x 1.8m			
Name/type of installation 裝置名稱/種類	Number of provision 數量	Dimension of each installation /building/structure (m) (LxWxH) 每個裝置/建築物/構築物的尺寸(米)(長x闊x高)											
Stay Erection	10	size of excavation: 1m x 1m x 1.5m											
Pole of Erection	5	size of excavation: 1m x 1m x 1.8m											
	(Please illustrate on plan the layout of the installation 請用圖則顯示裝置的布局)												

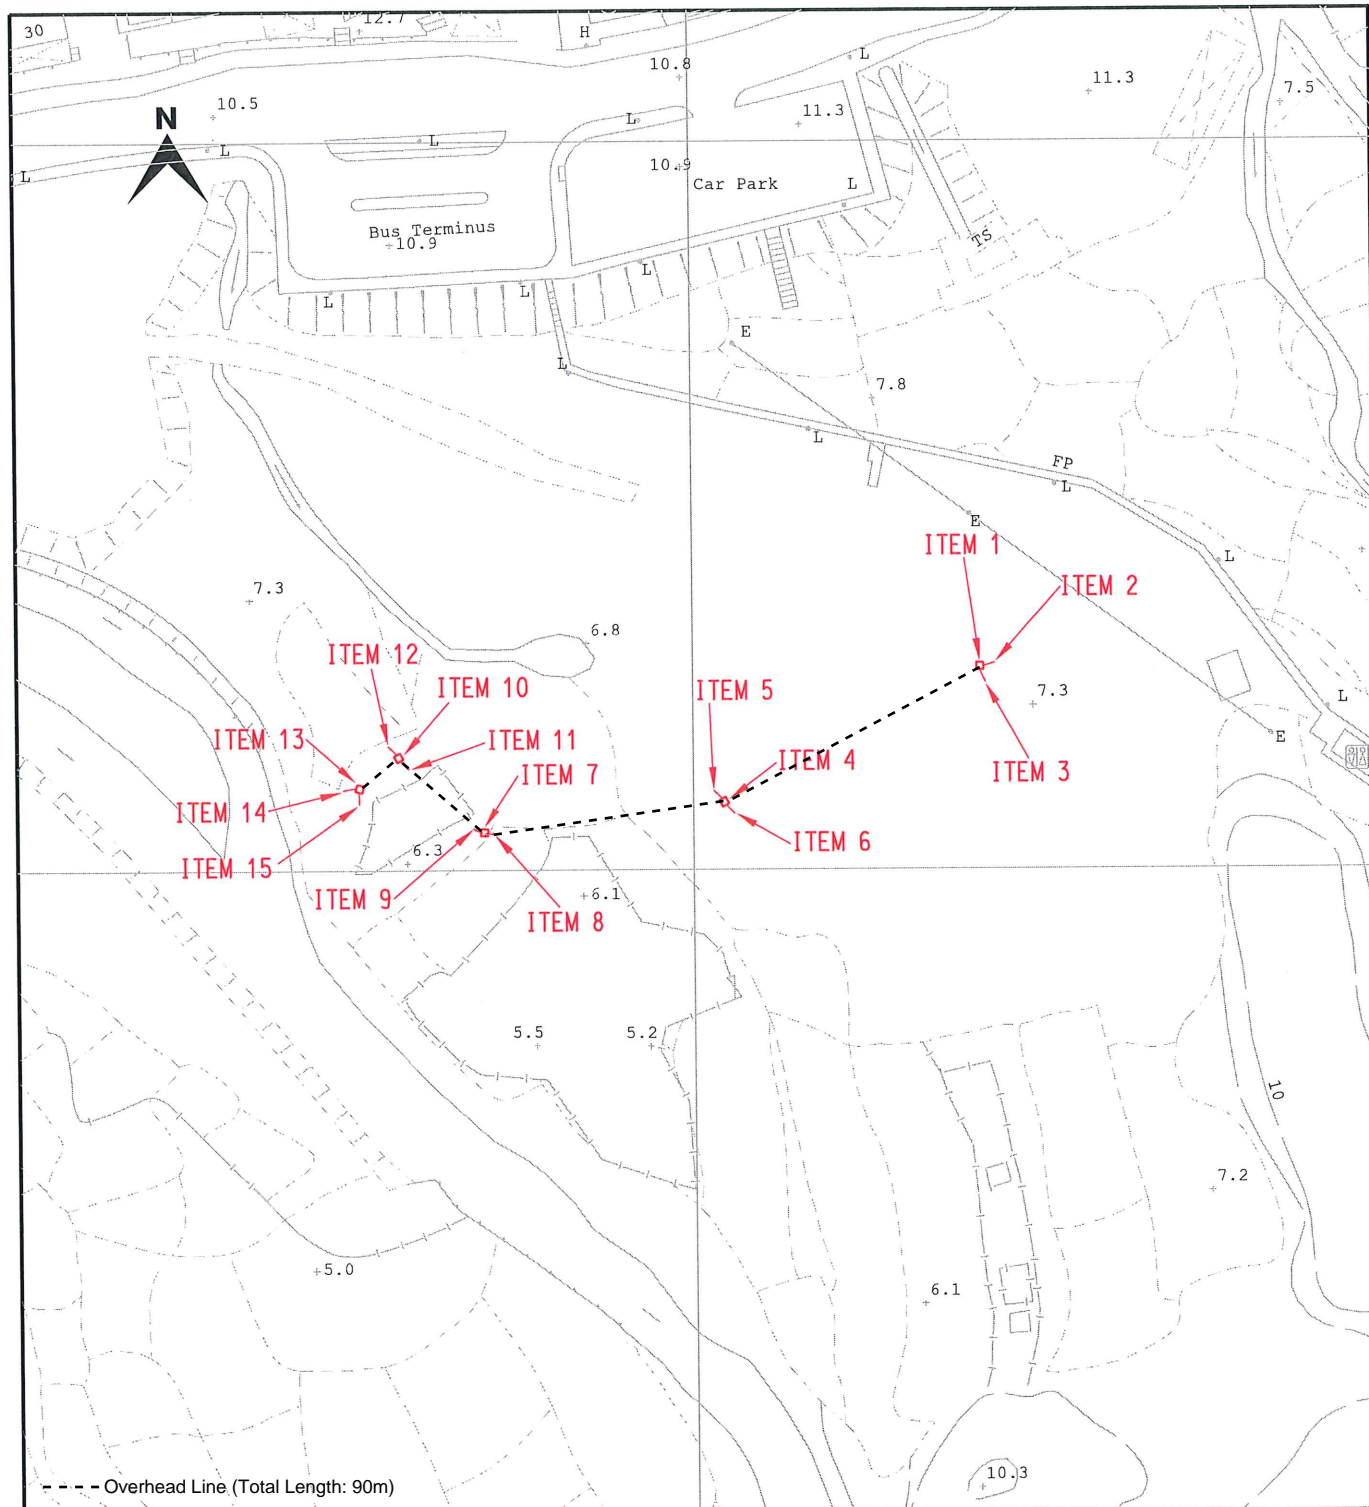

--- Overhead Line (Total Length: 90m)



TITLE : Pole & Stay Erection
Near South Lantau Road,
Tong Fuk Village

LEGEND

- PROPOSED TRENCH FOR LAYING / RECOVERING CABLE
- PROPOSED TRENCH FOR LAYING DUCTS
- PROPOSED CABLE THROUGH EXISTING DUCTS
- EXISTING PILLAR
- PROPOSED PILLAR 1.6M x 0.6M x 0.75M / CUTOFF BOX
- EXCAVATION FOR JOINTING / REPAIRING / INSPECTION CABLE
- EXISTING OVERHEAD LINE & POLE
- PROPOSED 11kV, LV, OHL, OF STEEL / WOODEN POLE
- OVERHEAD LINE & POLE TO BE REMOVED
- PROPOSED TREE TRIMMING / CUTTING
- EXISTING POLE MOUNTED TRANSFORMER
- PROPOSED POLE MOUNTED TRANSFORMER
- PROPOSED STAY / STAY POLE
- PROPOSED 3.6M(L) x 3.32M(W) x 2.7M(H) HV PILLAR

MAP NO : 13NE08C

DRAWN : BENSON

E/O NO :

CHECKED : S.M.KWONG

REGION : WE

O.C. : LT

DATE : 27-09-2023

PROJECT REF. : LT2022-0170

SCALE : 1:1000

PLAN REF. : WELT2022-0170-03H