

From: Lam, Siu Cheong
Sent: Friday, February 7, 2025 5:27 PM
To: Dates Yat Ching YEUNG/PLAND <dycyeung@pland.gov.hk>

Cc: Kwong, Sai Man [REDACTED]; Cheng, Chauvin Hei Muk [REDACTED]
Subject: FW: Clarification of Request of Comments on Cable Trench Work at Pui O Beach, Pui O (WELT2023-0189-02)

Dear Ms Yeung,

As per phone conversation today, the following information is provided for your information:


- (1) Information on the land use / development that the electricity is provide for.
The agricultural land requires the use of electric pumps for irrigation to ensure water supply, and farming machinery depends on electricity to operate efficiently.
- (2) Justifications on site / alignment selection as the best suitable option to minimize impact on the conservation zones.
Our alignment selection is reviewed that is the best suitable option to minimize impact on the conservation zones.

The proposed work is excavation for extension of our existing electricity network to provide new electricity to our client located at Lo UK Village DD316 Lot2447, Pui O.

It is required to **lay new LV underground cable (Red Line)** and **erect three new overhead line poles (Green Item)** and lay three new overhead lines (Black Line) at the captioned location and make connections to our **existing electricity network (Blue Line)**.

However, since the proposed works shall involve laying of underground cables and overhead lines with poles erection, where excavation would be required. Excavation permit would be required from Lands department and need to seek your Planning Department's comment.

The existing distribution network at Pui O Beach is illustrated below:-

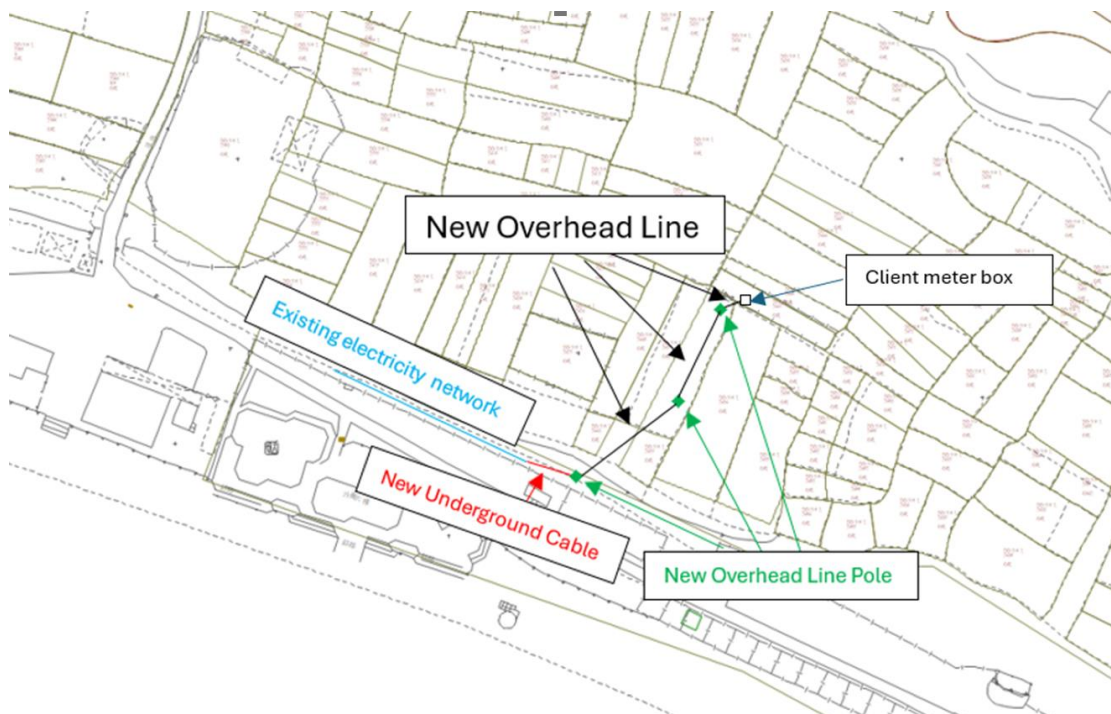

This is the shortest length cable would be laid to the customer's meter box from the existing underground cable network.

We are writing to seek your approval on above excavation work. Thank you.

Best regards,

SC Lam

TEL: [REDACTED]

CLPeS / CB / PE / Distribution Cable

Information classification: Proprietary