


- 3. All dimensions are in millimeters.
- Foundation of all manholes varies with site condition and should be determined on site by the engineer.
- 5. Concrete grade to be 30D/20 design mix and comply with CS1.
- 6. Blinding layer to be 15P mix.

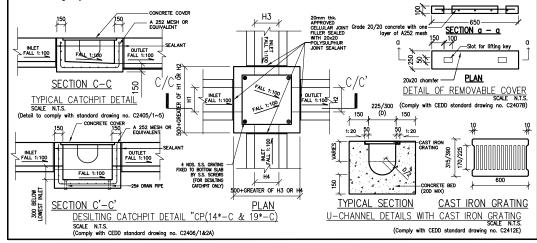

Date	Scale	
AUG 9 2024	AS SHOWN	
Drawn	KS	
Designed	KS	
Checked	KS	
Approved		
CAD Ref		
Job Number		
TP/2284	-2	
Drawing Number		Rev.
SD - 01		/

MANSFIELD ENGINEERING CONSULTANT Co.