


LGV L/UL Space
 Dimension: 7m x 3.5m
 Unit(s): 2

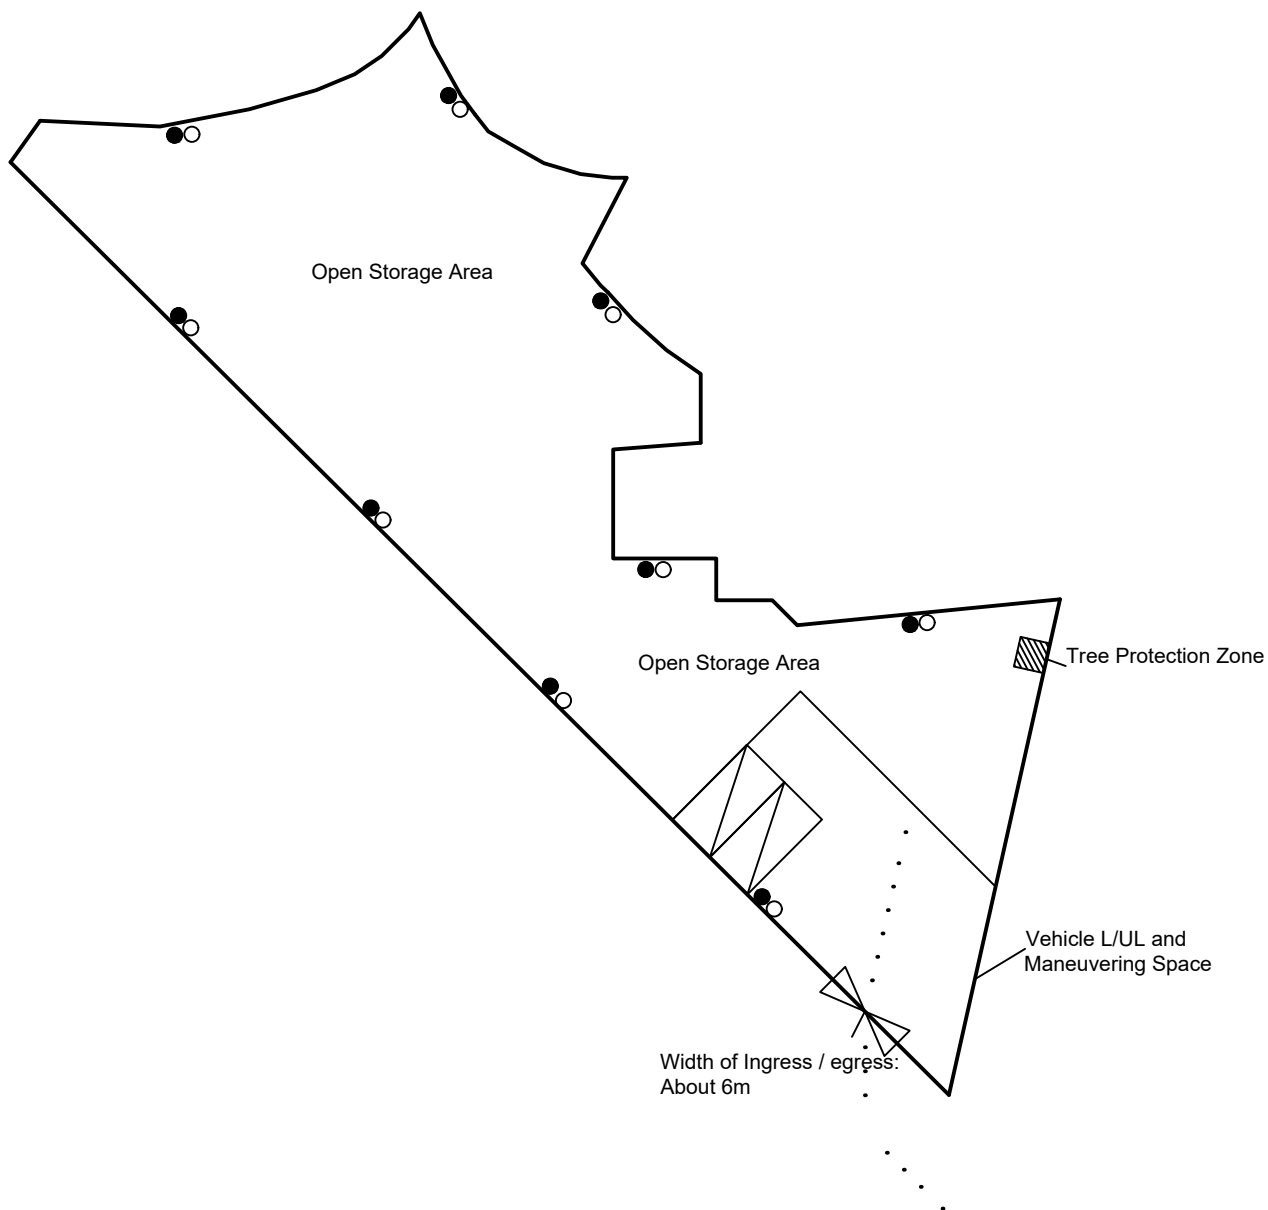

- *All FSI (includes installation/maintenance/modification/repair work) will be completed by RFSIC.
- For Emergency Vehicular Access, Please see Appendix 6.1
- * All Internal Access for Fire Appliances are within 4.5m
- * There will be clear width with 2m between the storage and lot boundaries.

Legend:

- 5 kg Portable Carbon Dioxide Type Fire Extinguisher (9 in Total)
- 9 kg Portable Water Type Fire Extinguisher (9 in Total)
- Emergency Vehicular Access

Appendix 6

Location: DD 107 Lot 1247 (Part),
 1248 (Part), 1249 (Part), 1252 (Part)
 and 1253 (Part)
 App. No.: A/YL-KTN/1018

OZP: S/YL-KTN/11
 District: Kam Tin North
 Zoning: Agriculture
 Date: 11 September 2024

Proposed Fire Service Installation Plan

擬議消防設備安裝計劃圖

擬議臨時露天存放建築機械及物料
 (為期3年)及填土

Proposed Temporary Open Storage of
 Construction Machinery and Materials
 For a Period of 3 Years and Filling of Land

SCALE


1:500

@A4

For Identification Only

Drawing No.:

6-01

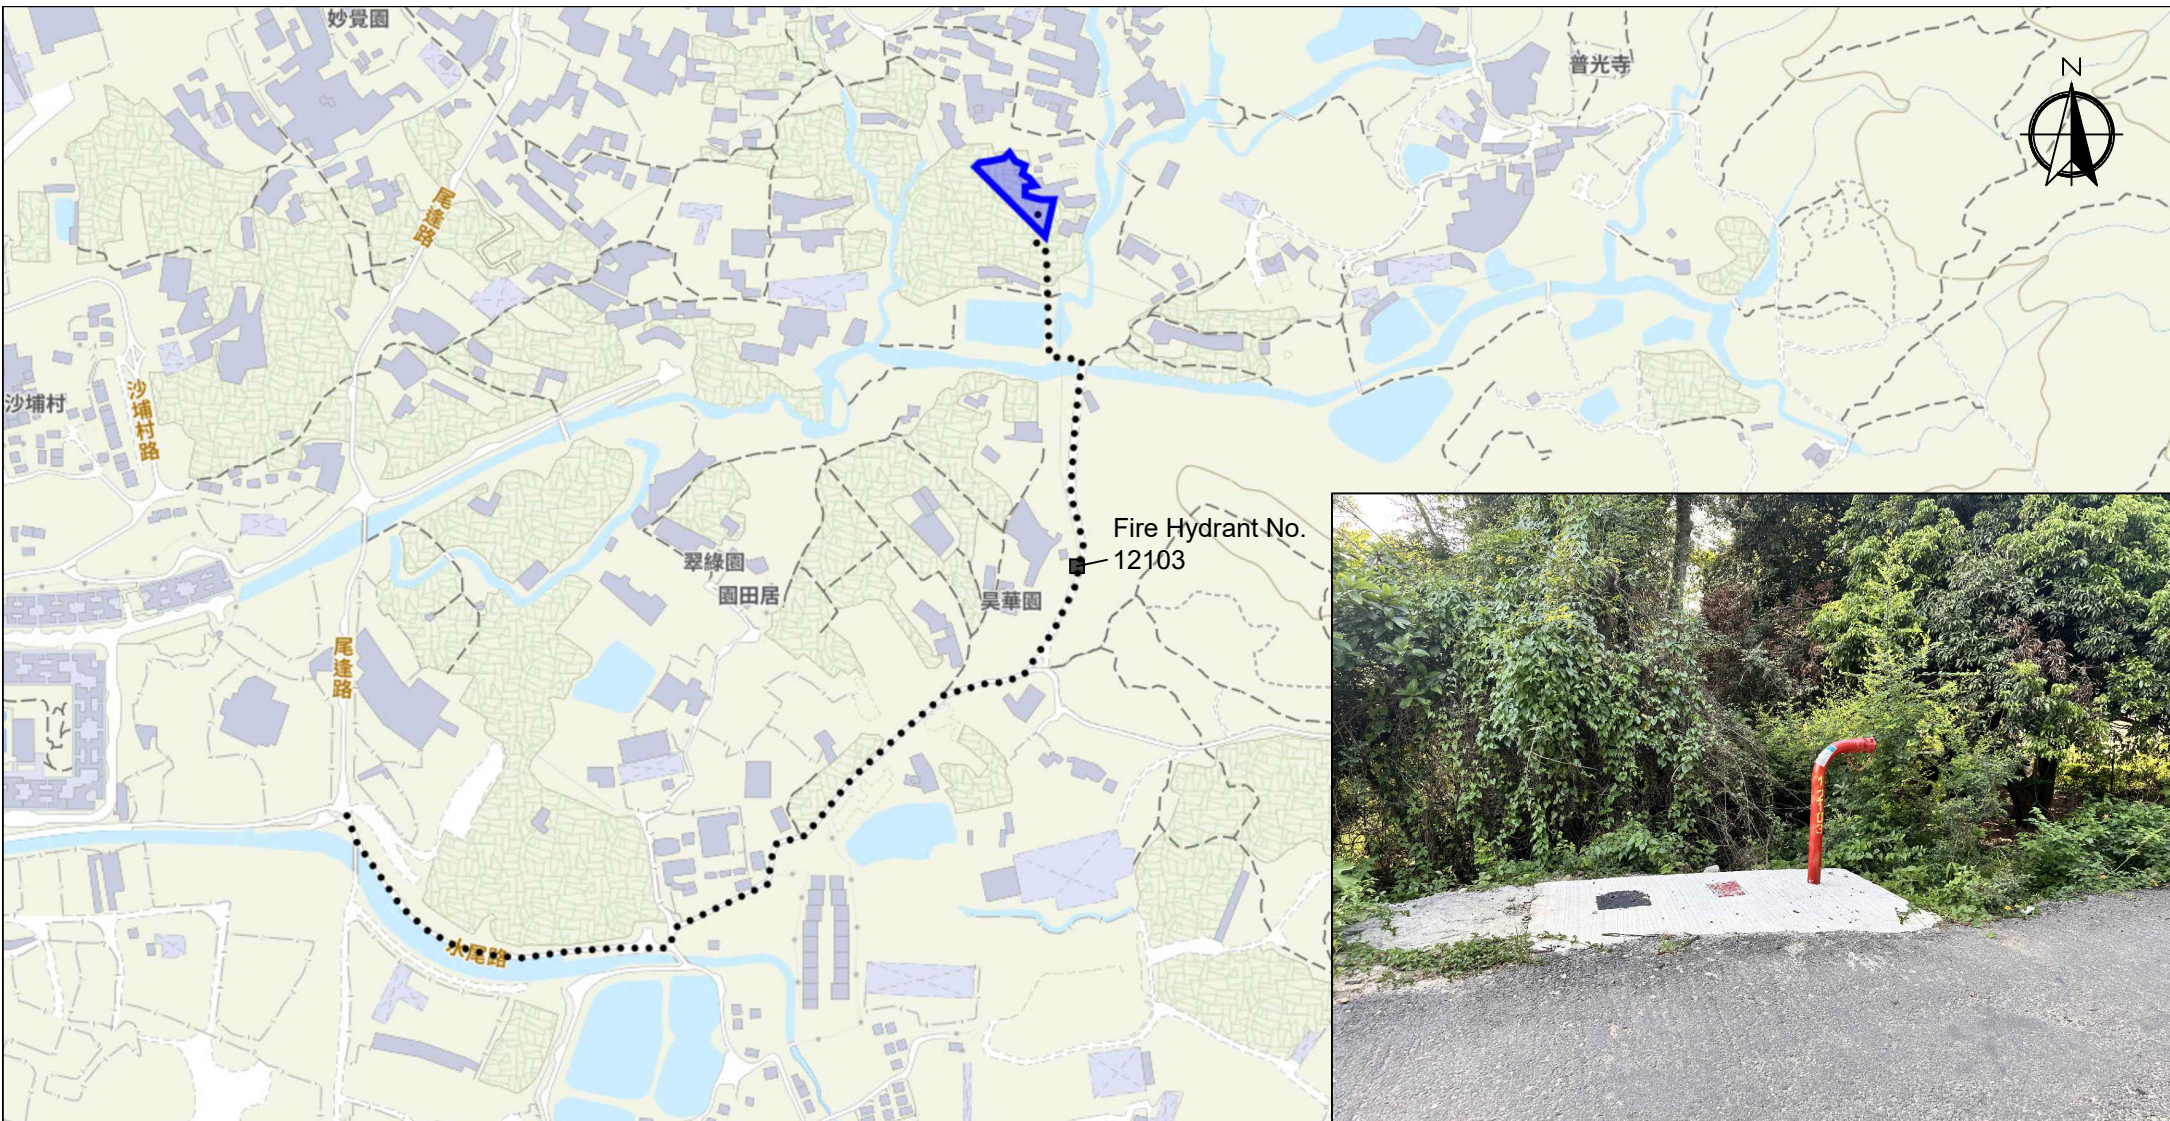

* The Fire Hydrant No. 12103 is within 500m of the application site.

Scale: Undefined @A4

Captured from map.gov.hk on 25th April 2024

<p>Appendix 6.1 Emergency Vehicular Access</p>	<p>Location: D.D. 107 Lot 1247 (Part), 1248 (Part), 1249 (Part), 1252 (Part) and 1253 (Part) OZP: S/YL-KTN/11 District: Kam Tin North Zoning: Agriculture</p>	<p>Proposed Temporary Open Storage of Construction Machinery and Materials For a Period of 3 Years and Filling of Land</p>	<p>Width of Shui Mei Road: 3-6m (About) Map Legend: ●●●●● Road Path — Site Boundary</p>	<p>Drawing No.: 6.1-1 For Identification Only Date: 11/09/2024</p>
---	---	--	---	--