








F.S. NOTES:

1. GENERAL

- 1 SUFFICIENT EMERGENCY LIGHTING SHALL BE PROVIDED THROUGHOUT THE ENTIRE BUILDING IN ACCORDANCE WITH 'BS 5266-PART 1 :2016 AND BS EN 1838 :2013', FSD CIRCULAR LETTER 4/2021.
- 2 SUFFICIENT ALL EXIT SIGNS/DIRECTIONAL EXIT SIGNS SHALL BE PROVIDED IN ACCORDANCE WITH 'BS 5266-PART 1 :2016 AND FSD CIRCULAR LETTER NO. 5/2008.
- 3 FIRE ALARM SYSTEM SHALL BE PROVIDED TO THE ENTIRE BUILDING IN ACCORDANCE WITH BS 5839 PART 1: 2017 AND FSD CIRCULAR LETTERS 6/2021, ONE ACTUATING POINT AND ONE AUDIO WARNING DEVICE TO BE LOCATED AT EACH HOSE REEL POINT. THIS ACTUATION POINT SHOULD INCLUDE FACILITIES FOR FIRE PUMP START AND AUDIO / VISUAL WARNING DEVICE INITIATION.
- 4 HOSE REEL SYSTEM WITH 2m³ F.S. WATER TANK SHALL BE PROVIDED. THERE SHALL BE TO SUFFICIENT HOSE REEL TO ENSURE THAT EVERY PARK OF EACH BUILDING CAN BE REACHED BY A LENGTH OF NOT MORE THAN 30M OF HOSE REEL TUBING FOR ENTIRE BUILDING.
- 5 SECONDARY ELECTRICITY SUPPLY DIRECTLY TEE OFF BEFORE CLP'S INCOMING MAIN SWITCH SHALL BE PROVIDED FOR THE FH/HR PUMPS.
- 6 PORTABLE FIRE FIGHTING APPLIANCES SHALL BE PROVIDED AT POSITIONS AS INDICATED ON LAYOUT PLAN. IN ACCORDING TO CODES OF PRACTICE FOR MINIMUM FIRE SERVICES INSTALLATIONS AND EQUIPMENT.
- 7 NO STORAGE OF DANGEROUS GOODS WITHOUT THE PERMISSION BY THE DIRECTOR OF FIRE SERVICES ANY INTENDED STORAGE OR USE DEFINED IN CHAPTER 295 OF THE LAWS OF HONG KONG SHOULD BE NOTIFIED TO THE DIRECTOR OF FIRE SERVICES.

LEGEND

- | | | | |
|---|---------------------------|---|-----------------|
|  | HOSE REEL |  | EMERGENCY LIGHT |
|  | BREAK GLASS UNIT |  | DIRECTION SIGN |
|  | FIRE ALARM BELL |  | PUMP SET |
|  | 5KG CO2 FIRE EXTINGUISHER | | |


One storey covered area (12.0mL x 5.5mW x 3.5mH) for 3 nos. private cars parking with metal scaffold display on top
一層高有蓋私家車停車位三個連金屬支架示範(12.0米(長) x 5.5米(闊) x 3.5米(高))

A 6.0m width entrance/exit has been provided for Site daily operation
申請地點安裝約6.0米闊的閘門給車輛日常出入運作之用

Two storey covered area (20.0mL x 7.0mW x 14.0mH) for worker resting area and metal structure storage
兩層高有蓋工人休息處連存放金屬支架(20.0米(長) x 7.0米(闊) x 14.0米(高))

3 nos. of loading/unloading spaces for heavy goods vehicle for metal structure delivery
三個上落重型貨車位給運送金屬支架之用

Two storey covered area (14.0mL x 6.3mW x 17.0mH) for ancillary office and metal structure storage
兩層高有蓋附屬寫字樓連存放金屬支架(14.0米(長) x 6.3米(闊) x 17.0米(高))

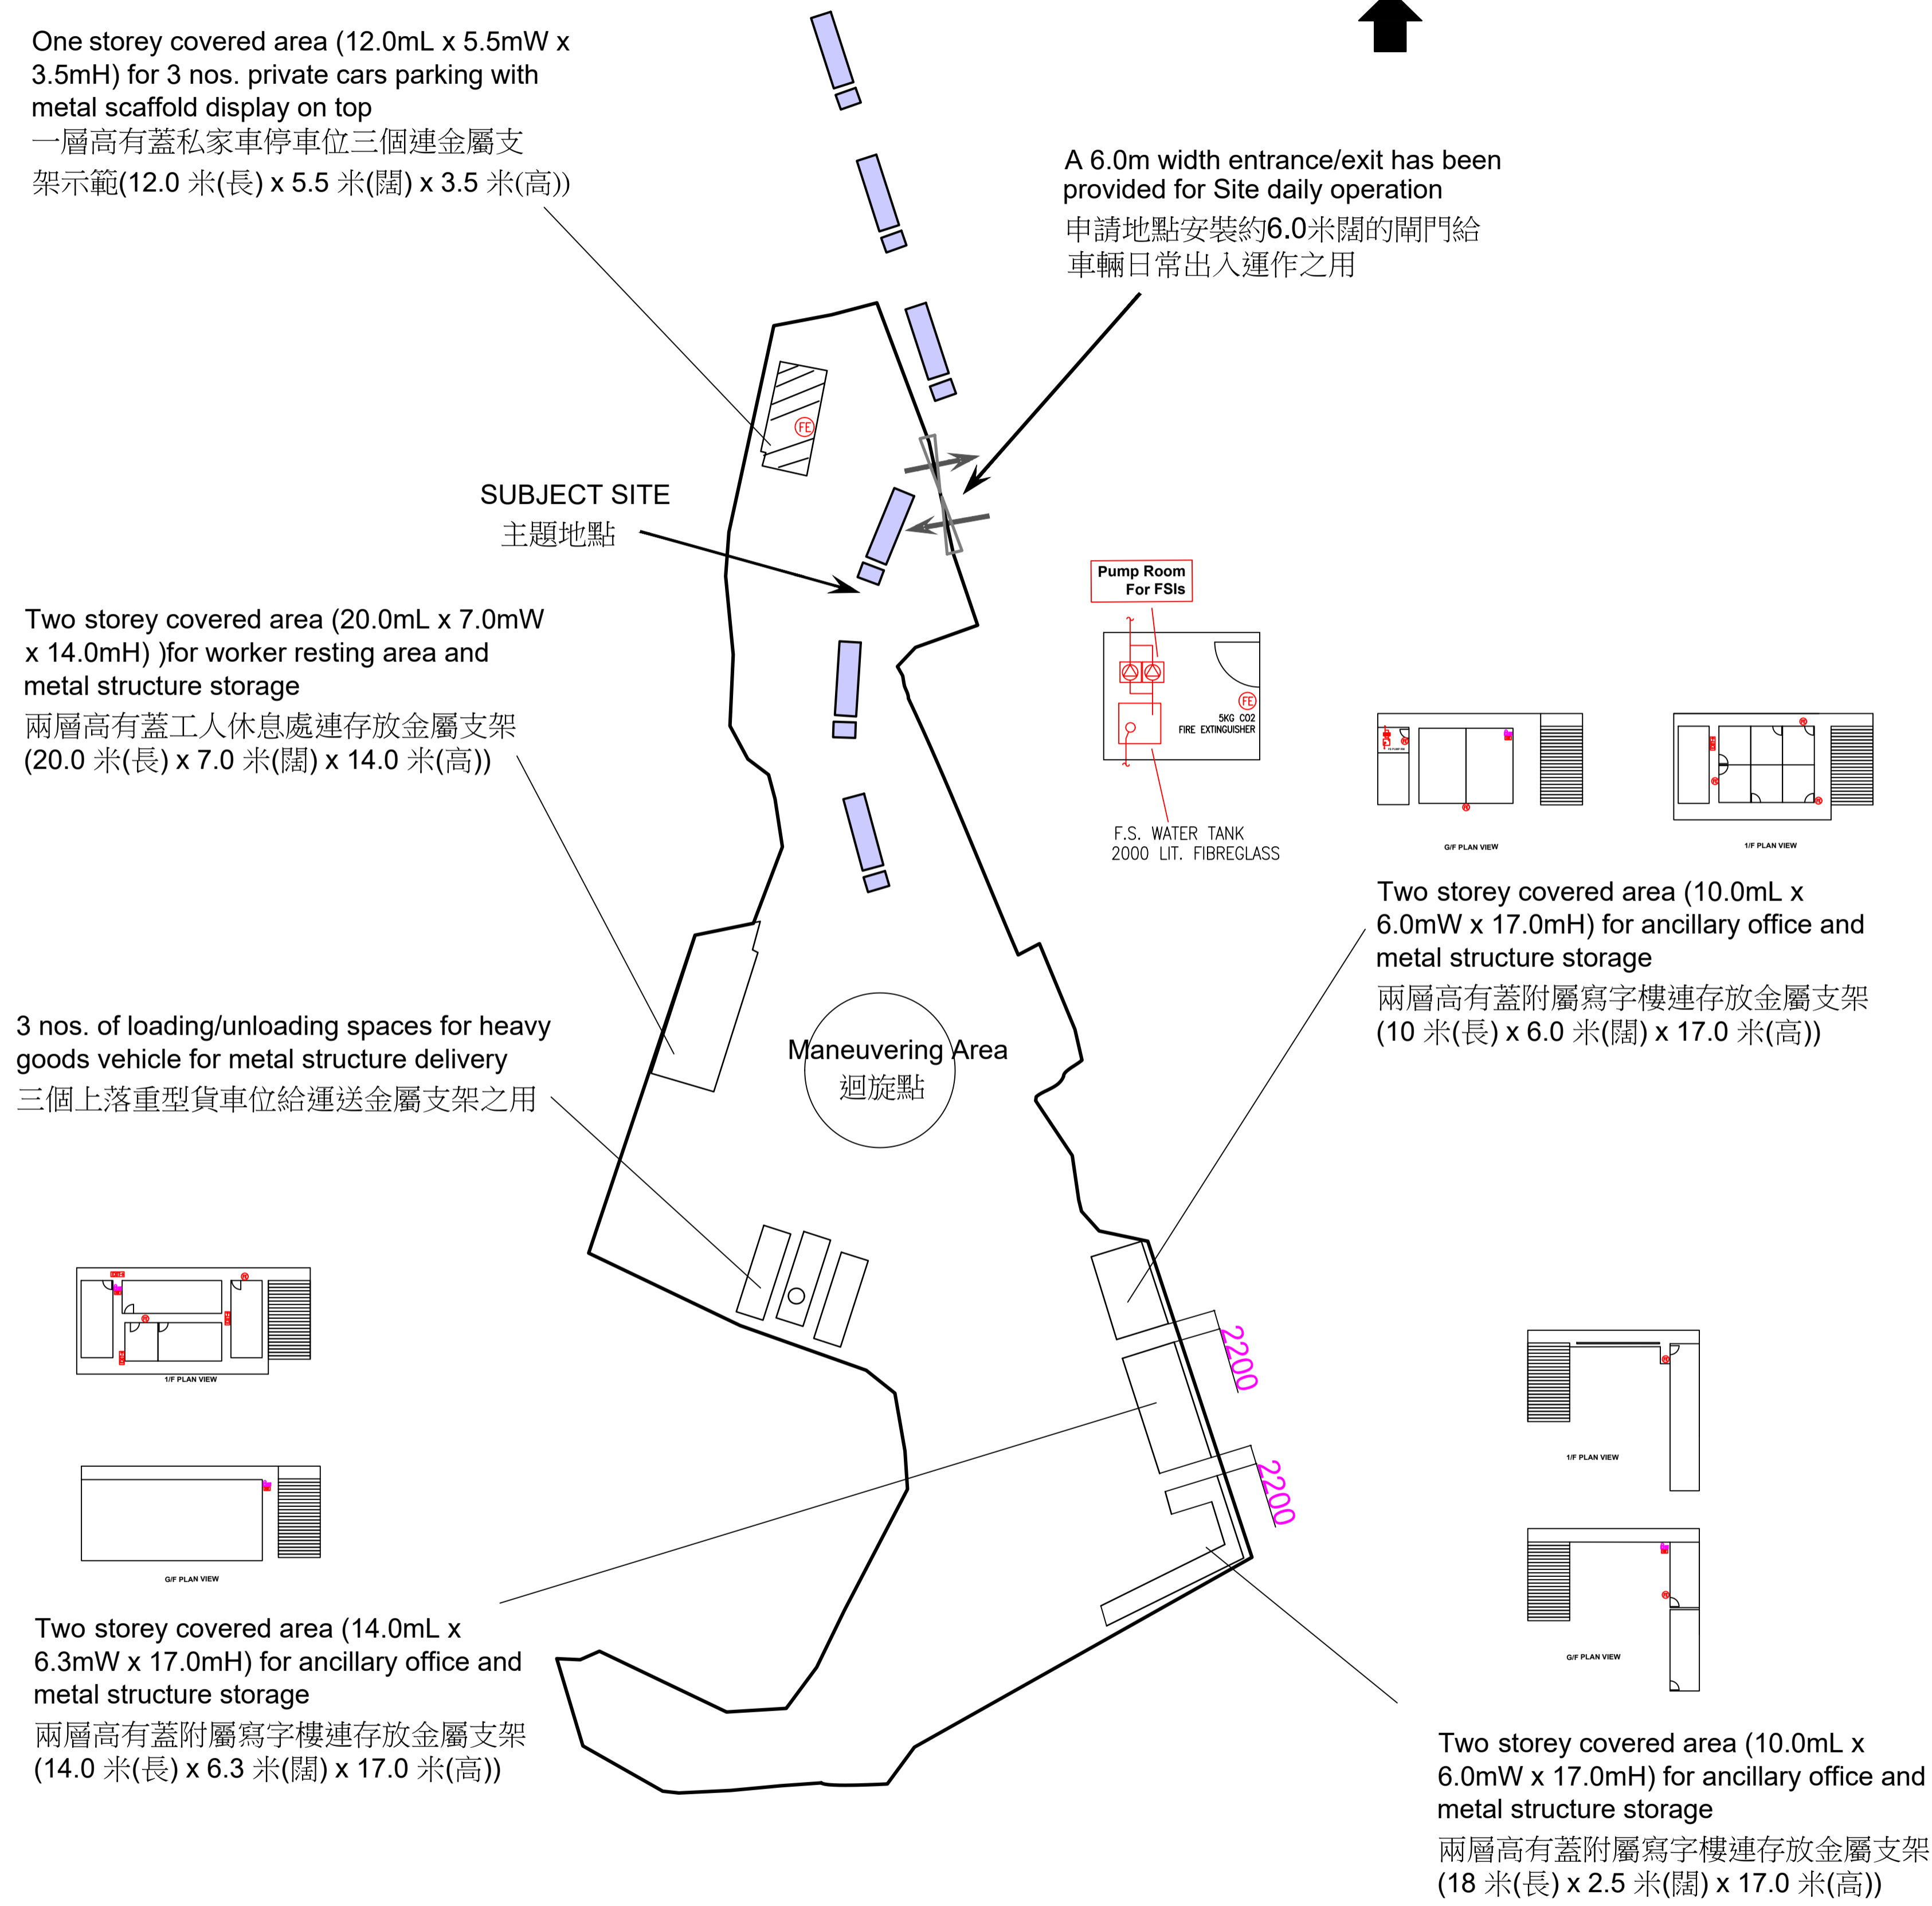

PROJECT :
Temporary Open Storage of Construction Materials with ancillary office and metal scaffold display for a period of 3 years at various lots in DD107 and adjoining Government land, San Tam Road, Kam Tin, Yuen Long, New Territories

DRAWING TITLE :
F.S. Notes, Legend, Fire Service Installation Layout Plan

REV	DESCRIPTION	DATE

ARCHITECT :

CONSULTANT :

FIRE SERVICE CONTRACTOR :
Century Fire Service Engineering Co., Ltd.

NAME	DATE
DRAWN BY: C.K.NG	4 May 2024
CHECKED BY:	
APPROVED BY:	

DRAWING NO : FS-01	REV. 0
SCALE : 1:500 @ A1	
SOURCE : B.O.O. Ref. BD F.S.D. Ref. FP	