


Structure No.	Area (m ²) (Not exceeding)	Height (m)	No. of Storey
A	176	3	1
B	159	3	1
C	28	5	2 (1 for Storage 2 for Site office)
D	15	2.5	1
F	48	3.5	1
F	115	7	2 (1 for Showroom 2 for Retail)
G	115	7	2 (1 for Showroom 2 for Retail)

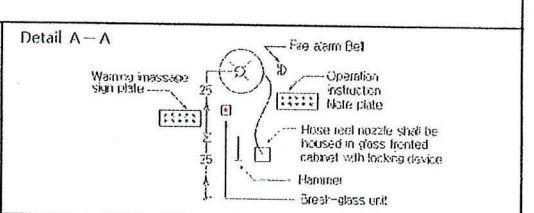

- F.S Notes :**
- Sufficient Emergency lighting shall be provided in accordance with BS 5266: Part 1 and BS EN 1833.
 - Sufficient directional and Exit sign shall be provided in accordance with BS 5266 part 1 and FSD Circular Letter 5/2008.
 - Fire Alarm system shall be provided to the entire building in accordance with BS 5859: Part 1: 2002 + A2: 2008 and FSD Circular Letter No: 1/2009. One actuation point and one audio warning advice to be located at each Hose reel point. This actuation point should include facilities for the start and / visual warning device initiation.
 - Hose reel system supplied by 2m³ FS Water tank shall be provided. There shall be sufficient Hose reel to ensure that every part of each building / Structure can be reached by a length of not more than 30m of Hose reels tubing.
 - Portable hand-operate approved appliance shall be provided as required by occupancy.
 - Two fixed Fire Pump (Duty & Standby) to be provided in the Pump Room.
 - No Emergency Generator to be provided for serving the emergency power.
 - Duplicated power supplies for all Fire Services installations comprising a cable connected from electricity mains directly before the main switch.

Legends :

 Manual Fire Alarm Call Point
 Fire Alarm Bell
 Emergency Light
 [EXIT] Exit Sign
 Hose Reel Pump
 5 kg Co2 Gase Type Fire Extinguisher
 Sand Bucket

Planning No. A/YL-TT/523	Application Address: Lots 4195 S.A, 4195 S.B(Part), 4196 S.A & S.B(Part), 4197 RP(Part), 4198 RP(Part) in DD 116 Tai Tong Road, N.T.		
Drawing Title: Fire Service installation Layout Plan	Drawing No: LOP- 2609m/FS	Scale: 1: 500	Date: 17 Nov 2022