



Proposed Religious Institution (the Supreme Kwan Ti Temple) and Improvement to the Existing Access Road, Tai Tong, Yuen Long Sewerage Impact Assessment

Prepared for:
Kwan Ti Culture Service Limited

31 October 2024

Proposed Religious Institution (the Supreme Kwan Ti Temple) and Improvement to the Existing Access Road, Tai Tong, Yuen Long Sewerage Impact Assessment

Prepared for
Kwan Ti Culture Service Limited

For and on behalf of
EnviroSolutions & Consulting

Alexi BHANJA
Group COO

ESC Project No. EPA23.1060-J.01
Deliverable No. D03
Revision No. 1

File Location

[https://envirosc.sharepoint.com/teams/hkprojects/shared documents/epa23.1060-j.01 kwan ti - temple_tai tong/07 deliverables/sia rev1.docx](https://envirosc.sharepoint.com/teams/hkprojects/shared%20documents/epa23.1060-j.01%20kwan%20ti%20temple_tai%20tong/07%20deliverables/sia%20rev1.docx)

Rev.	Description	Prepared	Reviewed	Approved	Date
0	Sewerage Impact Assessment	MJW	CL	AW	17/07/2024
1	Sewerage Impact Assessment	MJW	JC	AW	31/10/2024

Distribution Internal Confidential Public

This report has been prepared by EnviroSolutions & Consulting Limited with all reasonable skill, care, and diligence within the terms of the Contract with Client, incorporating our General Terms and Conditions of Business and taking account of the resources devoted to it by agreement with Client. We disclaim any responsibility to Client and others in respect or any matters outside the scope of the above. This report is confidential to Client and we accept no responsibility of whatsoever nature to any third parties to whom this report, or any part thereof, is made known.

CONTENTS

1	PROJECT BACKGROUND	1-1
1.1	Introduction	1-1
1.2	Site Description	1-1
1.3	Objectives of this Report	1-1
1.4	Reference Materials	1-1
2	EVALUATION OF SEWERAGE IMPACT	2-1
2.1	Existing Baseline Conditions	2-1
2.2	Sewerage Impact During the Operation Phase	2-1
3	SEWERAGE CALCULATIONS	3-1
3.1	Assumptions	3-1
3.2	Result and Discussion	3-1
4	CONCLUSION AND RECOMMENDATIONS	4-1

APPENDICES

Appendix A	Calculation of Sewage Generation
------------	----------------------------------

FIGURES

Figure 1-1	Site Location and its Environs	1-3
------------	--------------------------------------	-----

TABLES

Table 3-1	Parameters for Estimating Wastewater Generation from the Proposed Development	3-1
-----------	---	-----

1 PROJECT BACKGROUND

1.1 Introduction

- 1.1.1 It is planned to develop a temple for Kwan Ti (“the Proposed Development”) at DD 117 Tai Tong Shan Road Lots Nos. 1622, 1624 and 1629, and the adjoining government land, Yuen Long, N.T., Hong Kong (“the Site”). The site area is approx. 17,393m².
- 1.1.2 The Site is zoned “Recreation” (“REC”) and Green Belt (“GB”) under the Approved Tai Tong Outline Zoning Plan (“OZP”) No. S/YL-TT/20. Referring to the Schedule of Uses under Approved OZP Mo. S/YL-TT/20, “Religious Institution” Use is under Column 2 of both REC and GB zonings. Therefore, a planning application under Section 16 of the *Town Planning Ordinance* (“TPO”) is required for the Proposed Development.
- 1.1.3 EnviroSolutions & Consulting Ltd (“ESC”) has been appointed to prepare this Sewerage Impact Assessment (“SIA”) to support the S16 application for the Proposed Development.

1.2 Site Description

1.2.1 The site location and its environs are summarized below and shown in **Figure 1-1**:

- To the North: Tai Tong Kwan Ti Square, Tai Tong Organic EcoPark
- To the East: access road, slopes
- To the South: Tai Tong Lychee Valley
- To the West: natural stream, Tai Tong Riding Club

1.2.2 The development schedule of the Proposed Development is shown below:

Site Area	About 17,393.3m ²
Maximum Building Height	35.99m

1.3 Objectives of this Report


- 1.3.1 The objectives of this SIA Report are to:
- Estimate the quantity of sewage generating from the Proposed Development and the nearby uses
 - Recommend the necessary mitigation measures to handle the sewage.

1.4 Reference Materials

- 1.4.1 In evaluating the sewerage impacts arising from the Proposed Development, the following sources have been specifically referred to:
- Drainage Services Department (“DSD”) publication *Sewerage Manual (with Eurocodes incorporated) (Part 1) Key Planning Issues and Gravity Collection System, 3rd Edition, May 2013*
 - *Sewerage Manual - Corrigendum No. 1/2024*
 - *Sewerage Manual - Corrigendum No. 2/2024*

- Environmental Protection Department (“EPD”) publication *Guidelines for Estimating Sewage Flows for Sewage Infrastructure Planning Version 1.0, March 2005* (“GESF”)
- Building (Standards of Sanitary Fitments, Plumbing, Drainage Works and Latrines) Regulations (Cap.123I)
- Practice Note for Professional Persons Drainage Plans subject to Comment by the Environmental Protection Department -Building (Standards of Sanitary Fitments, Plumbing, Drainage Works and Latrines) Regulations (ProPECC PN1/23)
- Sewerage data of GeoInfo Map checked on 3 July 2024

Figure 1-1 Site Location and its Environs

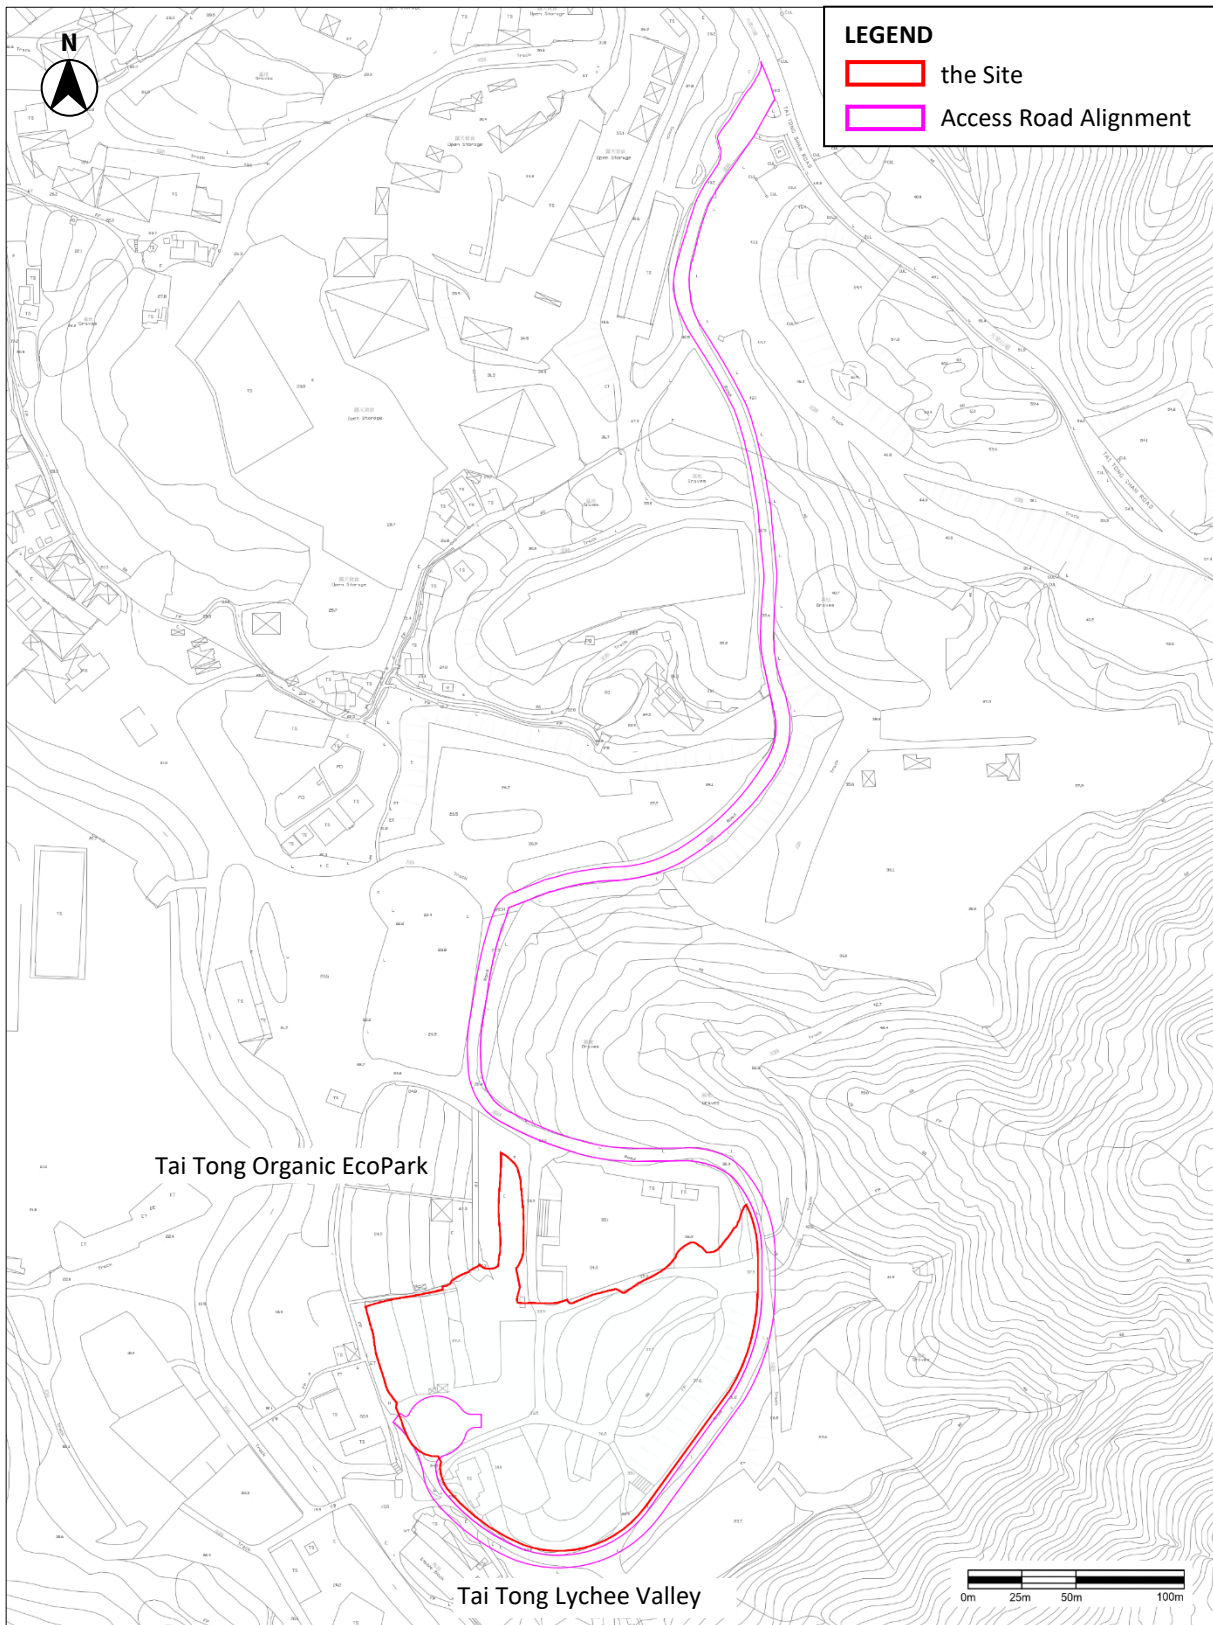

2 EVALUATION OF SEWERAGE IMPACT

2.1 Existing Baseline Conditions

2.1.1 According to the sewerage data of GeoInfo Map checked on 3 July 2024, there is no municipal sewerage system near the Site.

2.2 Sewerage Impact During the Operation Phase

2.2.1 During the operation of the Proposed Development, the major source of sewage will be sewage from the toilets and bathrooms used by on-site staff and visitors. A staff canteen without kitchen will be provided, and no kitchen will be provided within the Site. Food to be provided to the staff will be delivered from the other service providers and/or the staff will bring their own food from outside. Therefore, there will be no cooking within the Proposed Development and no sullage from kitchen will be generated.

2.2.2 Since there is no existing municipal sewerage system near the Site, disposal of sewage from connection to municipal sewerage system is not practicable. Thus, all of the sewage generated by the Proposed Development is proposed to be temporarily stored in sewage storage tanks and then tankered away for off-site disposal in a Sewage Treatment Facility.

2.2.3 The estimated total daily sewage generation from the Proposed are discussed in the subsequent sections. The proposed sewage handling method will be further considered in the detailed design stage.

3 SEWERAGE CALCULATIONS

3.1 Assumptions

3.1.1 As the Proposed Development is a Religious Institution, it will hold ceremonies/events on certain days. On these days there will be more site staff and visitors than normal situation, and sewage generation will be greater than normal situation. The number of staff on Normal and Ceremony/Event Days is summarised below, and the calculations and assumptions are provided in detail in **Appendix A**:

- Normal (Non-Ceremony/Event) Days: 1,000 visitors/day and 60 site staff
- Ceremony/Event Days: 4,000 visitors/day and 150 site staff

3.1.2 In order to review whether the proposed sewage handling method mentioned in **Paragraph 2.2.2** is practicable to handle the sewage arising from the Proposed Development, the maximum sewage generation during normal days and ceremony/event days has been estimated based on the assumptions listed in **Table 3-1**, below. The Average Dry Weather Flows (“ADWFs”) of the Proposed Development have been estimated based on the Unit Flow Factors (“UFFs”) recommended in GESF.

Table 3-1 Parameters for Estimating Wastewater Generation from the Proposed Development

PARAMETER	VALUE	UNIT	REMARK
GENERATION FROM STAFF			
Max. No. of site staff (Normal Days)	60	staff	Information provided by the applicant
Max. No. of site staff (Ceremony/Event Days)	150	staff	Information provided by the applicant
UFF of staff	0.280	m ³ /day/staff	Unit flow factor for “Commercial Employee + J11 Community, Social & Personal Services” given in Table T-2 of GESF
Max. No. of visitors (Ceremony/Event Days)	0.0028	m ³ /visitor/day	Unit factor for flushing, hand washing and micturition

3.2 Result and Discussion

3.2.1 Detailed sewage generation calculations are provided in **Appendix A**. The estimated ADWF from the Proposed Development is calculated to be 19.6m³/day on normal days and 53.2m³/day on ceremony/event days, respectively.

3.2.2 As mentioned in **Paragraph 2.2.2**, sewage arising from the Proposed Development would be temporarily stored in sewage holding tanks and then tankered away for off-site disposal in a Sewage Treatment Facility, which is further discussed below.

3.2.3 As advised by the Applicant, five (5) sewage holding tanks with the capacity of 11m³ for each will be provided on-site. With the total capacity of 55m³, the proposed sewage holding tanks is sufficient to cater the sewage generation. The details of sewage holding tanks will be further reviewed in the detailed design. The Applicant (or Project Proponent) will be responsible for the operation and maintenance of the proposed sewage holding tanks.

3.2.4 With the provision of sewage holding tanks and following tanker-away for off-site disposal, no adverse sewerage impact from the Proposed Development is anticipated.

4 CONCLUSION AND RECOMMENDATIONS

- 4.1.1 It is planned to develop the Supreme Kwan Ti Temple at DD 117 Tai Tong Shan Road Lots Nos. 1622, 1624 and 1629, and the adjoining government land, Yuen Long, N.T., Hong Kong. The Site is zoned "Recreation" ("REC") and Green Belt ("GB") under the Approved Tai Tong Outline Zoning Plan ("OZP") No. S/YL-TT/20. This Sewerage Impact Assessment is carried out in order to support the Section 16 planning application for the Proposed Development.
- 4.1.2 During operation, detailed sewage generation calculations demonstrate that total estimated ADWF from the Proposed Development will be approx. 19.6m³/day on normal days and 53.2m³/day on ceremony/event days, respectively.
- 4.1.3 Due to lack of public sewerage system in the vicinity of the Site, the sewage generated from the Proposed Development is proposed to be temporarily stored in sewage storage tanks and then tankered away for off-site disposal in a Sewage Treatment Facility.
- 4.1.4 Five (5) sewage holding tanks with total capacity of 55m³ will be proposed to temporarily store the sewage before final off-site disposal. The details of sewage holding tanks will be further reviewed in the detailed design.
- 4.1.5 Overall, with the provision of sewage holding tanks and following tanker-away for off-site disposal, no adverse sewerage impact from the Proposed Development is anticipated.

Appendix A Calculation of Sewage Generation

Appendix A - Calculation of Sewage Generation

Sewage Calculations for the Proposed Development		Notes
Sewage generated by the Site		
1) Wastewater generated by Visitors		
Max No of Site Staff (Normal Days)	= 60 staff	As advised by the Applicant
Max No of Site Staff (Ceremony/Event Days)	= 150 staff	As advised by the Applicant
Unit Flow Factor (UFF) per staff	= 0.280 m ³ /day-staff	Refer to "Commercial Employee" and "J11 Community, Social & Personal Services" of Table T-2. [Note 1 &2]
Total Average Dry Weather Flow (Normal Days)	= 16.800 m ³ /day	Average Dry Weather Flow
Total Average Dry Weather Flow (Ceremony/Event Days)	= 42.000 m ³ /day	Average Dry Weather Flow
2) Wastewater generated by Visitors		
Max No of Visitors (Normal Days)	= 1,000 visitors	As advised by the Applicant
Max No of Visitors (Ceremony/Event Days)	= 4,000 visitors	As advised by the Applicant
Flow rate per flushing	= 1.2 L/flush	As advised by the supplier of chemical/container toilet [Reference 2] (c)
Flow rate per hand washing	= 1.4 L/per hand washing	BEAM Plus New Buildings Version 2.0 (2023 Edition), Non-mixing Type Water Taps (bathrooms and toilets) (4.0L/min x 20s), [Reference 3] (d)
Flow rate from micturition per visit	= 0.2 L/per visit	Refer to Human's micturition is assumed to be 200mL in accordance with p. 3081 of "Magill's Medical Guide", 6th ed., various medical editors, Salem Press, USA, 2011. [Reference 4] (e)
Percentage of visitors will go to toilet	= 100 %	
UFF per visitor	= 0.0028 m ³ /day-visitor	(c) + (d) + (e)
Total Average Dry Weather Flow (Normal Days)	= 2.800 m ³ /day	Average Dry Weather Flow (f)
Total Average Dry Weather Flow (Event/Ceremony Days)	= 11.200 m ³ /day	Average Dry Weather Flow (g)
Overall Average Daily Dry Weather Flow of Proposed Development (Normal Days)	= 19.600 m ³ /day	(a) + (f)
Overall Average Daily Dry Weather Flow of Proposed Development (Ceremony/Event Days)	= 53.200 m³/day	(b) + (g)
Sewage Handling Options		
Normals Days (Staff and Visitors)		
Overall Average Daily Dry Weather Flow of Proposed Development	= 19.600 m ³	[Note 3]
Ceremony/Event Days (Staff and Visitors)		
Overall Average Daily Dry Weather Flow of Proposed Development	= 53.200 m ³	[Note 3]
Size of a Sewage Holding Tank	= 11 m ³ / tank	As advised by the Applicant
No. of Sewage Holding Tanks	= 4.84 tanks	

Note:

- Guidelines for Estimating Sewage Flows for Sewage Infrastructure Planning ("GESF") Version 1.0, Environmental Protection Department of HK Government, March 2005.
- As per the GESF, for job types J10 and J11, the "per-employee" UFF takes into account the flows of visitors.
- The sewage will be temporarily stored in the sewage holding tanks and tankered away for off-site disposal.



EnviroSolutions & Consulting Ltd

16/F & 17/F
700 Nathan Road
Mong Kok
Kowloon
Hong Kong

Tel: No. +852 3960 7000 | Fax: +852 3960 7111

Email: enquiries@envirosc.com

Web: www.envirosc.com | www.simplyehs.com



Accountability

We understand the importance of being accountable to each other and our clients.



Passion

We are completely passionate about providing practical solutions and outcomes that deliver for our clients.



Insight

We work in an environment that encourages and values insight as a critical quality which informs our decisions and our clients and supports practical solutions and project delivery.



Integrity

We behave with respect and honesty toward each other, our clients and our stakeholders.